

SANTA MARGARITA RIVER WATERSHED

ANNUAL WATERMASTER REPORT

WATER YEAR 2011-12

UNITED STATES OF AMERICA

V.

FALLBROOK PUBLIC UTILITY DISTRICT, ET AL.

CIVIL NO. 51-CV-1247-GPC-RBB

**CHARLES W. BINDER
WATERMASTER
P. O. BOX 631
FALLBROOK, CA 92088
(760) 728-1028
FAX (760) 728-1990**

July 2013

TABLE OF CONTENTS

	<u>Page No.</u>
1. Summary _____	1
2. Introduction	
2.1 Background _____	5
2.2 Authority _____	5
2.3 Scope _____	5
3. Surface Water Availability and Use	
3.1 Surface Flow _____	7
3.2 Surface Water Diversions _____	13
3.3 Water Storage _____	13
4. Subsurface Water Availability	
4.1 General _____	19
4.2 Extractions _____	19
4.3 Water Levels _____	21
4.4 Groundwater Storage _____	26
5. Imports/Exports	
5.1 General _____	33
5.2 Water Year 2011-12 _____	37
5.3 Water Years 1966-2012 _____	37
5.4 Lake Skinner _____	41
5.5 Diamond Valley Lake _____	42
6. Water Rights	
6.1 General _____	45
6.2 Appropriative Surface Water Rights _____	47
6.3 Fallbrook PUD Changes of Point of Diversion and Place of Use _____	51
6.4 Federal Reserved Water Rights Claims By Cahuilla and Ramona Bands _____	52
6.5 Federal Reserved Water Rights Claims by Pechanga Band _____	52
7. Water Production and Use	
7.1 General _____	53
7.2 Water Purveyors _____	54
7.3 Indian Reservations _____	74
7.4 Small Water Systems _____	77
7.5 Irrigation Water Use _____	77

	<u>Page No.</u>
8. Unauthorized Water Use	
8.1 General	79
8.2 Unauthorized Small Storage Ponds	79
8.3 Rancho California Water District Water Use	79
8.4 Exportation of Treated Wastewater Derived from Native Waters	80
9. Threats to Water Supply	
9.1 General	81
9.2 High Nitrate Concentrations	81
9.3 Potential Overdraft Conditions	82
9.4 Salt Balance	83
9.5 High Arsenic Concentrations	85
9.6 High Fluoride Concentrations	85
9.7 High Manganese Concentrations	86
9.8 Quagga Mussel	86
10. Water Quality	
10.1 Surface Water Quality	89
10.2 Groundwater Quality	89
11. Cooperative Water Resource Management Agreement	
11.1 General	95
11.2 Required Flows	98
11.3 Water Quality	100
11.4 Monitoring Programs	100
12. Five Year Projection of Watermaster Office Tasks, Expenditures and Requirements	
12.1 General	103
12.2 Normal Tasks	103
12.3 Additional Tasks	103
12.4 Projected Expenditures	104
13. Watermaster Office Budget 2013-14	105

LIST OF TABLES

	<u>Page No.</u>
3.1 – Stream Gaging Stations _____	8
3.2 – Measured Surface Water Flow 2011-12 _____	9
3.3 – Surface Water Diversions to Storage for Vail Lake _____	14
3.4 – Surface Water Diversions to Storage for Lake O'Neill _____	15
3.5 – Surface Water Diversions to Use _____	16
3.6 – Water in Storage _____	17
4.1 – Water Production by Substantial Users _____	20
4.2 – Groundwater Storage at Camp Pendleton _____	27
4.3 – Changes in Groundwater Storage Murrieta-Temecula Groundwater Area ____	29
4.4 – Changes in Useable Groundwater Storage Murrieta-Temecula Groundwater Area _____	30
5.1 – Storage in State Water Project and Colorado River Reservoirs _____	34
5.2 – Imports/Exports 2011-12 _____	38
5.3 – Total Dissolved Solids Concentration of Imported Water _____	39
5.4 – Imports/Exports 1966-2012 _____	40
6.1 – Appropriative Water Rights, Permits & Licenses _____	48
6.2 – Pre-1914 Appropriative Water Rights _____	50
7.1 – Water Production and Use _____	55
7.2 – Definitions of Water Use by Municipal Water Purveyors _____	56
7.3 – Water Deliveries to Temecula Valley Regional Water Reclamation Facility Service Area _____	59

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

	<u>Page No.</u>
7.4 – Rancho California Water District, Permit 7032 Operations _____	64
7.5 – Rancho California Water District, Rancho Division Return Flow Credit 2011-12 _____	66
7.6 – Rancho California Water District, Santa Rosa Division Return Flow Credit 2011-12 _____	67
7.7 – Percent Production from Younger Alluvium In Rancho California Water District Wells _____	69
7.8 – Rancho California Water District Well Production From Younger and Older Alluvium _____	70
10.1 – Ranges in Average Daily Concentration of Dissolved Oxygen, pH, Specific Conductance and Temperature at Santa Margarita River Near Temecula _____	90
11.1 – Monthly Summary of Required Flows, Discharges, Credits and Accounts, Cooperative Water Resource Management Agreement 2012 Calendar Year _____	96
11.2 – Monthly Summary of Required Flows, Discharges, Credits and Accounts, Cooperative Water Resource Management Agreement 2011 Calendar Year _____	97

LIST OF FIGURES

1.1 – Local Production 2003 – 2012	2
1.2 – Imports 2003 – 2012	2
1.3 – Total Production 2003 – 2012	3
3.1 – Annual Streamflow for Santa Margarita River near Temecula	11
3.2 – Annual Precipitation for Wildomar Gage	12
4.1 – Water Level Elevations Well No. 8S/2W-12H1	21
4.2 – Water Level Elevations Well No. 10S/4W-7J1	22
4.3 – Water Level Elevations Well No. 7S/3W-20C9	23
4.4 – Water Level Elevations Well No. 7S/3E-21G1	24
4.5 – Water Level Elevations Pechanga Indian Reservation Wells	25
5.1 – Storage in State Water Project 2003 – 2012	35
5.2 – Storage in Colorado River Reservoirs 2003 – 2012	35
10.1 – Total Dissolved Solids Concentration RCWD Well 8S/2W-12K	91
10.2 – Total Dissolved Solids Concentration Camp Pendleton Well 10S/4W-7A2	92
10.3 – Nitrate Concentration Camp Pendleton Well 10S/4W-7A2	93

APPENDICES

Appendix A - Production and Use Water Year 2011-12

Table A-1	Eastern Municipal Water District
Table A-2	Elsinore Valley Municipal Water District
Table A-3	Fallbrook Public Utility District
Table A-4	Metropolitan Water District
Table A-5	Pechanga Indian Reservation
Table A-6	Rainbow Municipal Water District
Table A-7	Rancho California Water District
Table A-8	U.S.M.C. - Camp Pendleton
Table A-9	U. S. Naval Weapons Station, Fallbrook Annex
Table A-10	Western Municipal Water District – Murrieta Division
Table A-11	Miscellaneous Water Production and Import

Appendix B - Production and Use Water Years 1965-66 to 2011-12

Table B-1	Eastern Municipal Water District
Table B-2	Elsinore Valley Municipal Water District
Table B-3.1	Fallbrook Public Utility District
Table B-3.2	Fallbrook Public Utility District
Table B-4	Fallbrook Public Utility District (Wastewater)
Table B-5	Metropolitan Water District
Table B-6	Pechanga Indian Reservation
Table B-7	Rainbow Municipal Water District
Table B-8	Rancho California Water District
Table B-9	U.S.M.C. - Camp Pendleton
Table B-10	U. S. Naval Weapons Station, Fallbrook Annex
Table B-11	Western Municipal Water District – Murrieta Division
Table B-12	Miscellaneous Water Production and Import

Appendix C - Substantial Water Users 2011-12

Appendix D - Water Quality Data

		<u>Last Published</u>
Table D-1	Surface Streams Sampled by Camp Pendleton	1992-93
Table D-2	Surface Streams Sampled by Rancho California Water District	1998-99
Table D-2.1	Nutrient Sampling by Rancho California Water District	2002-03
Table D-3	Wells in Western Municipal Water District - Murrieta Division	2011-12
Table D-4	Wells in Rancho California Water District	2011-12
Table D-5	Wells on Indian Reservations	2011-12
Table D-6	Wells on Camp Pendleton	2011-12
Table D-7	Eastern Municipal Water District	1992-93
Table D-8	Eastern Municipal Water District	1992-93
Table D-9	Eastern Municipal Water District	1992-93
Table D-10	Eastern Municipal Water District	1993-94
Table D-11	Wells in Domenigoni Valley	1994-95
Table D-12	Surface Water Sampled by USGS on Cahuilla Creek	2011-12

**Appendix E – Cooperative Water Resource Management Agreement
Required Flows and Accounts – Calendar Year 2012**

**Appendix F – Annual Report Issues Subordinated During Effective Period
of the Cooperative Water Resource Management Agreement**

MAP

Major Water Purveyors

Bound at back of Report

SECTION 1 - SUMMARY

Section 1 - A summary of the Santa Margarita River Watershed Annual Watermaster Report for the 2011-12 Water Year.

Section 2 - This Annual Watermaster Report is prepared pursuant to Section II of the U. S. District Court Order dated March 13, 1989. The Court has retained jurisdiction over all surface flows of the Santa Margarita River Watershed and all underground waters determined by the Court to be subsurface flow of streams or creeks or which is determined by the Court to add to, support, or contribute to the Santa Margarita River stream system. Local vagrant groundwaters that do not support the Santa Margarita River stream system are outside Court jurisdiction.

Section 3 - Surface water flows varied in Water Year 2011-12. Flows for long-term stations on Murrieta Creek at Temecula, the Santa Margarita River near Temecula, and the Santa Margarita River at Ysidora were 24%, 43% and 25% of their long-term averages, respectively. Flows at Temecula Creek near Aguanga were 32% of the long-term average. Direct surface diversions to use totaled 721 acre feet, which reflects no change from the prior year. The total quantity of water in storage in the Watershed on September 30, 2012, was 800,026 acre feet, of which 27,206 acre feet were Santa Margarita River water and 772,820 acre feet were imported water.

Section 4 - Groundwater extractions were 39,163 acre feet in 2011-12 as shown on Table 4.1, compared to 41,832 acre feet in 2010-11. Water purveyors pumped 31,936 acre feet, and 7,227 acre feet were pumped by other substantial users. Total local production, including groundwater extractions and surface diversions in 2011-12 was 39,884 acre feet. This compares with 42,837 acre feet in 2010-11, and represents a decrease of seven percent. Total annual local production for use for the period 2003-2012 is shown on Figure 1.1.

Section 5 - During 2011-12, 75,440 acre feet of net imports were distributed for use within the Santa Margarita River Watershed, as shown on Table 5.2. This compares with 71,029 acre feet in 2010-11, and represents an increase of six percent. Annual imports for the period 2003-2012 are shown on Figure 1.2 and Table 5.4. Exports of wastewater and native water for use outside the Watershed in 2011-12 were 18,898 acre feet. This compares with 18,797 acre feet in 2010-11, and represents an increase of one percent.

Section 6 - Water rights consist primarily of riparian and overlying rights. Other rights include appropriative rights and federal reserved rights. Water purveyors in the Watershed also exercise groundwater appropriative rights. Except for surface water appropriative rights, water rights generally have not been quantified in the Watershed. Appropriative surface water rights on file with the State Water Resources Control Board (SWRCB) amount to 990,719 gallons per day. This corresponds to 1.53 cfs or 3.04 acre feet per day of direct diversion rights and 54,313.5 acre feet of active storage rights.

Figure 1.1


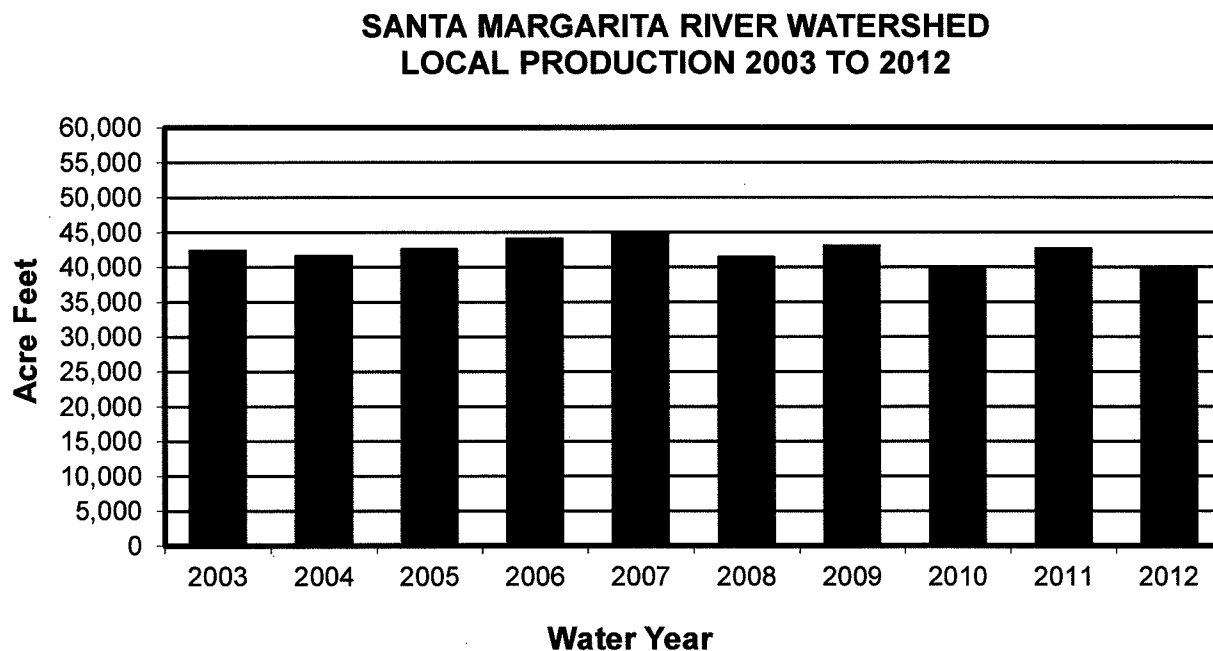


Figure 1.2

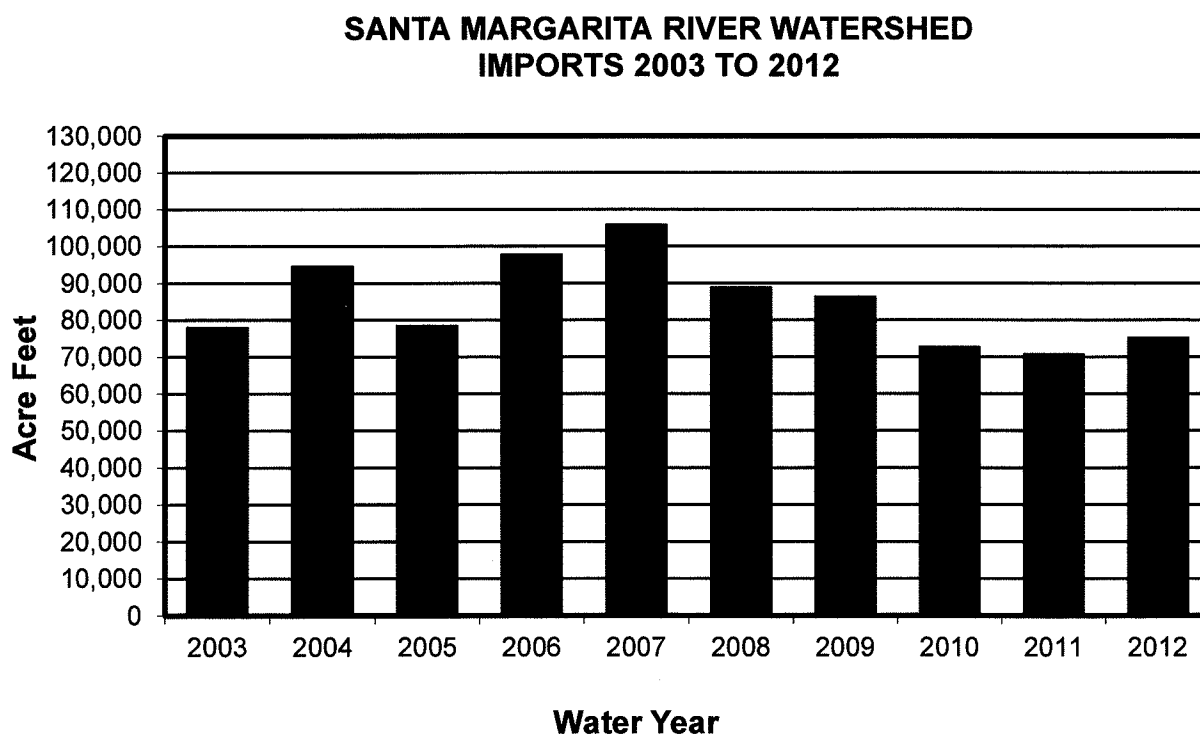


WATERMASTER
SANTA MARGARITA RIVER WATERSHED

Section 7 – Total imported supplies plus local production during 2011-12 totaled 115,324 acre feet compared to 113,866 acre feet reported in 2010-11. Of that quantity, 44,179 acre feet were used for agriculture; 10,512 acre feet were used for commercial purposes; 48,885 acre feet were used for domestic purposes; 32 acre feet were discharged to Murrieta Creek; 54 acre feet were discharged to Santa Gertrudis Creek; 3,470 acre feet were discharged by Rancho California WD from MWD WR-34 during 2011-12, pursuant to the Cooperative Water Resource Management Agreement (CWRMA); 2,807 acre feet of fresh water were exported by Camp Pendleton; and 702 acre feet were recharged by Rancho California WD to storage. It is noted, the agriculture use includes 329 acre feet of reclaimed water and thus the agriculture use of production is 43,850 acre feet. The overall system loss was 4,818 acre feet. System gain or loss is the result of many factors including errors in measurement, differences between periods of use and periods of production, leakage and unmeasured uses. These data are shown on Table 7.1.

Total annual production for the period 2003-2012 is shown on Figure 1.3.

Figure 1.3

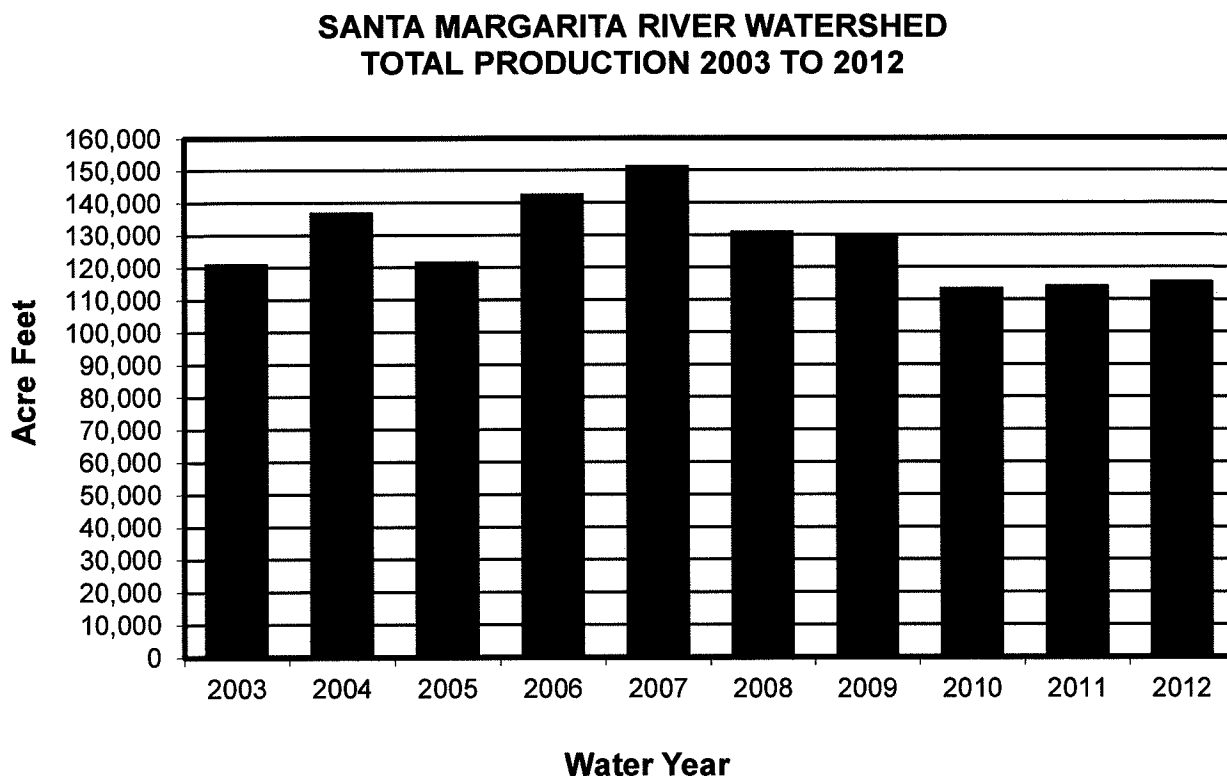

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

Section 8 - Use of water from small storage ponds may be unauthorized. Camp Pendleton has taken the position that exportation of treated wastewater, the source of which is the native waters of the Santa Margarita River system, without legal authority for such exportation, is an unauthorized use of water.

Section 9 - Threats to water supply include high nitrate levels in Rainbow Creek and Anza Valley in past years, potential overdraft conditions in the Murrieta-Temecula and Anza groundwater basins, and salt balance issues in the upper Watershed. Additional threats have been recently identified, including high concentrations of nitrates, arsenic, fluoride and manganese in the Murrieta-Temecula area, as well as the discovery of the Quagga mussel in imported supplies.

Section 10 - The U. S. Geological Survey (USGS) monitored surface water quality at the Temecula gaging station on the Santa Margarita River.

Groundwater samples from wells were analyzed for water quality by Camp Pendleton, Western MWD - Murrieta Division, Rancho California WD, and the Pechanga Band during 2011-12. The two primary constituents of interest are nitrates and total dissolved solids (TDS). The Basin Plan Objective for TDS of 750 mg/l was exceeded in eleven of twelve wells at Camp Pendleton. One well sampled by Rancho California WD showed concentrations exceeding 750 mg/l, the Basin Plan Objective.

Section 11 - The Cooperative Water Resource Management Agreement between Camp Pendleton and Rancho California Water District was approved by the District Court on August 20, 2002. During the 2012 calendar year, Rancho California WD discharged 3,434 acre feet to the Santa Margarita River to meet flow requirements under the Agreement.

Section 12 - Projected Watermaster expenditures for the next five years are listed.

Section 13 - A total Watermaster budget for the Water Year 2013-14 is proposed to be \$658,840. This budget includes \$419,715 for the Watermaster Office and \$239,125 for operation of gaging stations and groundwater monitoring by the USGS.

SECTION 2 - INTRODUCTION

2.1 Background

On January 25, 1951, the United States of America filed Complaint No. 1247 in the United States District Court for the Southern District of California to seek a judicial determination of all respective water rights within the Santa Margarita River Watershed. The Final Judgment and Decree was entered on May 8, 1963, and appealed to the U. S. Court of Appeals. A Modified Final Judgment and Decree was entered on April 6, 1966. Among other things, the Decree provided that the Court:

. . . retains continuing jurisdiction of this cause as to the use of all surface waters within the watershed of the Santa Margarita River and all underground or sub-surface waters within the watershed of the Santa Margarita River, which are determined in any of the constituent parts of this Modified Final Judgment to be a part of the sub-surface flow of any specific river or creek, or which are determined in any of the constituent parts of this Modified Final Judgment to add to, contribute to, or support the Santa Margarita River stream system.

In March 1989, the Court issued an Order appointing the Watermaster to administer and enforce the provisions of the Modified Final Judgment and Decree and subsequent orders of the Court. The appointing Order described the Watermaster's powers and duties as well as procedures for funding and operating the Watermaster's office. Also in 1989, the Court appointed a Steering Committee that at the conclusion of 2011-12 was comprised of representatives from the United States, Eastern Municipal Water District, Fallbrook Public Utility District, Metropolitan Water District of Southern California, Pechanga Band, Western Municipal Water District, and Rancho California Water District. The purposes of the Steering Committee are to assist the Court, to facilitate litigation, and to assist the Watermaster.

2.2 Authority

Section II of the appointing Order requires that the Watermaster submit a written report containing findings and conclusions to the Court promptly after the end of each water year.

2.3 Scope

The subjects addressed in this report are responsive to Section II of the appointing Order. Information and data contained in this report are based on information reported to the Watermaster by the various water users within the Watershed and others. Therefore, the Watermaster does not guarantee the completeness and accuracy of the information presented in this report, although most of the data presented are based on measurements. Estimates by the Watermaster are so noted.

Page Intentionally Blank

SECTION 3 - SURFACE WATER AVAILABILITY AND USE

3.1 Surface Flow

Over the years, flows in the Santa Margarita River Watershed have been measured at the stations listed on Table 3.1. A number of these stations have been discontinued. During Water Year 2011-12, the USGS operated 13 stations under an agreement with the Watermaster. These include three stations where Riverside County Flood Control and Water Conservation District shares the local costs with the Watermaster. In addition to stream flows, the USGS also measures water elevation and precipitation at Vail Lake.

The USGS also operates several stations in the Watershed under contract with Camp Pendleton. These include stream gaging stations on Fallbrook Creek and on the outlet channel and spillway for Lake O'Neill. The USGS also operates a tidal water level recorder on the Santa Margarita River at its mouth.

Monthly flows for stations in Water Year 2011-12 are shown on Table 3.2. Those flows consist of final USGS discharge determinations approved for publication by the USGS. Official USGS discharges for 2011-12 are published by the USGS at the following website: <http://waterdata.usgs.gov/ca/nwis/sw>.

In considering the historical record of flow at these stations, it should be recognized that the long term averages include variations in watershed conditions such as level of development, groundwater production, return flows, impoundments and vegetative use as well as hydrologic conditions, changes in gaging station locations and other factors. Descriptions of the various historical locations of gaging stations may be found in the publication, *Water Resources Data - California*, which was published annually by the USGS in hard copy form through Water Year 2003-04. For subsequent years, the gaging station descriptions can be found at the website provided above.

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE 3.1
SANTA MARGARITA RIVER WATERSHED
STREAM GAGING STATIONS
2011-12

STATION NAME	STN. NO.	AREA SQ MI	RECORDS FROM	PERIOD OF RECORD									
				1920	1930	1940	1950	1960	1970	1980	1990	2000	2010
Temecula Creek Near Aguanga	1104 2400	131	USGS				8/57 ..						...
Wilson Creek Above Vail Lake	1104 2490	122	USGS							10/89	10/94		
Temecula Creek At Vail Dam	1104 2520	320	USGS	2/23					10/77				
Vail Lake at Temecula (Reservoir Storage)	1104 2510	320	USGS			10/48 .							...
Pechanga Creek Near Temecula	1104 2631	13.8	USGS							10/87 ..			...
Warm Springs Creek Near Murrieta	1104 2800	55.4	USGS							10/87 ..			...
Santa Gertrudis Creek Near Temecula	1104 2900	90.1	USGS							10/87 ..			...
Murrieta Creek Near Murrieta	1104 2700	30	USGS								10/97 ..		...
Murrieta Creek At Temecula	1104 3000	222	USGS	10/25									...
Santa Margarita River Near Temecula	1104 4000	588	USGS	2/23									...
Rainbow Creek Near Fallbrook	1104 4250	10.3	USGS								9/89		...
Sandia Creek Near Fallbrook	1104 4350	21.1	USGS								9/89		...
Santa Margarita River At FPU D Sump 1/	1104 4300	620	USGS	10/24						9/80 .	9/89		...
Santa Margarita River Tributary Near Fallbrook	1104 4600	0.52	USGS					10/61 9/65					
DeLuz Creek Near DeLuz	1104 4800	33	USGS								10/92		...
DeLuz Creek Near Fallbrook 2/	1104 4900	47.5	USGS/ USMC				2/51		77		9/89-9/90 .	4/02-2/03 .	
Santa Margarita River Near DeLuz Station	1104 5000	705	USGS	10/24 - 9/26 ..									
Fallbrook Creek 3/ Near Fallbrook	1104 5300	6.97	USGS/ USMC					10/64	9/76	12/88 .			...
Santa Margarita River At Ysidora 4/	1104 6000	723	USGS	3/23									...
WATER YEAR ENDING				1920	1930	1940	1950	1960	1970	1980	1990	2000	2010

1/ Period of record includes measurements for Santa Margarita near Fallbrook (#11044500) for period October 1924 to September 1980

2/ Recorded by USMC, Camp Pendleton October 1966 to 1977

3/ Recorded by USMC, Camp Pendleton prior to October 1993

4/ Station temporarily operated as SMR at USMC Diversion Dam near Ysidora #11045050 from February 26, 1999 to September 27, 2001

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE 3.2
SANTA MARGARITA RIVER WATERSHED
MEASURED SURFACE WATER FLOW
 2011-12
 Quantities in Acre Feet

GAGING STATION	DRAINAGE AREA SQ MI	OCT	NOV	DEC	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	WATER YEAR TOTAL	ANNUAL AVERAGE THROUGH 2011	YEARS OF RECORD THROUGH 2011
Temecula Creek Near Aguanga	131	62	150	193	222	192	346	361	150	43	13	21	20	1,773	5,590	54
Pechanga Creek Near Temecula 1/	13.1	0	0	0	0	0	0	0	0	0	0	0	0	0	482	24
Warm Springs Creek Near Murrieta	55.4	7	146	106	43	127	200	63	0	0	0	0	0	692	3,270	24
Santa Gertrudis Creek Near Temecula	90.2	15	53	41	9	54	145	49	0	0	0	0	0	366	2,890	24
Murrieta Creek Near Murrieta 2/	30	0	34	31	26	63	190	73	0	0	0	0	0	417	____ 3/ 4,430	____ 8 (1998-2005)
Murrieta Creek At Temecula	222	4	380	222	55	330	1,060	364	15	8	10	8	11	2,467	10,386	87
Santa Margarita River Near Temecula	588	282	679	591	686	900	1,670	729	314	332	190	185	179	6,737	15,605 20,390	63 (1949-2011) 26 (1923-48)
Rainbow Creek Near Fallbrook	10.3	90	95	48	87	71	142	106	44	11	9	3	2	708	2,770	22
Sandia Creek Near Fallbrook	21.1	179	277	272	254	231	290	229	159	86	95	48	56	2,176	7,100	22
Santa Margarita River At FPUD Sump	620	374	862	915	868	1,080	1,840	1,020	240	279	220	251	159	8,108	31,620	22
DeLuz Creek Near DeLuz	33	0	60	104	88	36	136	74	8	0	0	0	0	506	8,890	19 (1993-2011)
Santa Margarita River At Ysidora	723	339	563	972	815	982	2,420	1,310	553	259	0	0	0	8,213	32,930 4/ 31,390	63 (1949-2011) 26 (1923-48)
Fallbrook Creek Near Fallbrook	6.97	8	45	33	43	46	62	72	22	6	2	2	0	341	1,224 1,462 5/	23 (1989-2011) 12 (1965-76)

1/ In summer 2006, gaging location was moved upstream 0.4 miles from prior location to current location 100 feet upstream of Metropolitan Water District pipe crossing, 0.4 miles upstream of the Rainbow Canyon Road/Old Highway 395 Bridge.

2/ Previously published as Murrieta Creek at Tenaja Road.

3/ Continuous record stopped on February 22, 2005, in lieu of bridge installation. Only discharge measurements were taken from February 2005 until September 2007.

4/ Includes record of two years at Santa Margarita River at USMC Diversion Dam near Ysidora station.

5/ Includes wastewater flows.

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

Total flows at four long-term stations, for Water Years 2010-11 and 2011-12, are compared with their averages in the tabulation below. Average flows for the Santa Margarita River stations near Temecula and near Ysidora are shown for two periods: before and after Vail Dam was constructed (1923 to 1948, and 1949 to 2011).


	<u>TOTAL FLOW</u>		<u>AVERAGE FLOW</u>
	<u>2010-11 Acre Feet</u>	<u>2011-12 Acre Feet</u>	<u>Through 2011 Acre Feet</u>
Temecula Creek Near Aguanga	7,168	1,773	5,590 (1957-2011)
Murrieta Creek At Temecula	28,722	2,467	10,386 (1925-2011)
Santa Margarita River Near Temecula	36,922	6,737	15,605 (1949-2011) 20,390 (1923-1948)
Santa Margarita River At Ysidora*	97,892	8,213	32,930 (1949-2011) 31,390 (1923-1948)

* At various locations

The foregoing tabulation indicates the flows for Water Year 2011-12 were below normal for all four stations. Flows for long-term stations on Temecula Creek near Aguanga, Murrieta Creek at Temecula, the Santa Margarita River near Temecula and the Santa Margarita River at Ysidora were 32%, 24%, 43% and 25% of their long-term averages, respectively.

The Santa Margarita River near Temecula station is of particular interest relative to discharge requirements specified in the Cooperative Water Resource Management Agreement (CWRMA) between Camp Pendleton and Rancho California WD, as described in Section 11. The long-term time series for annual streamflow for Santa Margarita River near Temecula is provided on Figure 3.1, showing the 2011-12 flows were in the third quartile and 82% less than the flows for the prior year.

Figure 3.1

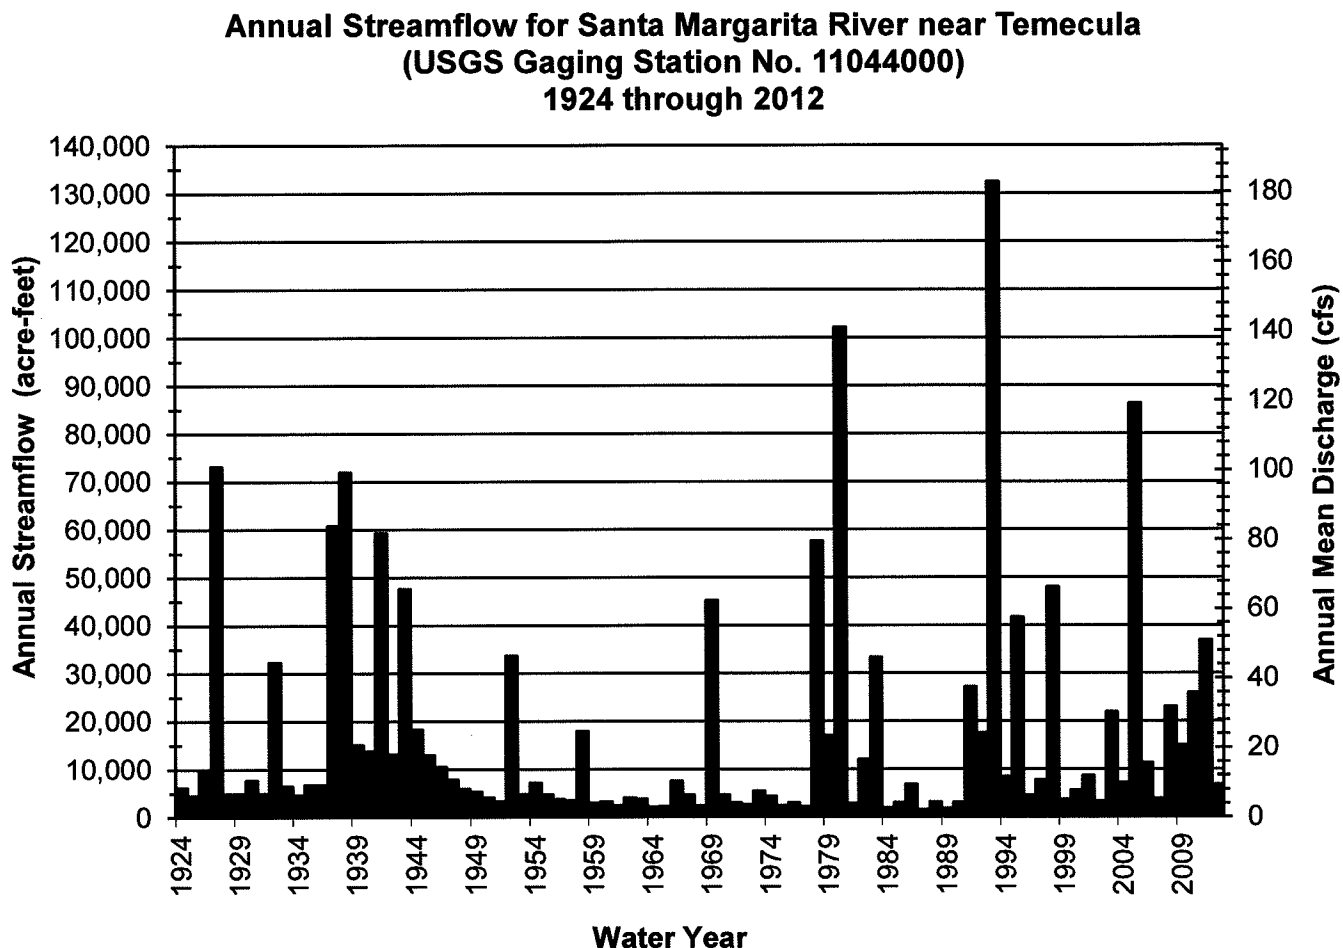


It is also interesting to review long-term precipitation records relative to long-term streamflow. Figure 3.2 shows the long-term time series for annual precipitation for the Wildomar gage maintained by the Riverside County Flood Control and Water Conservation District. The Wildomar gage is specified in the CWRMA for determining water year types in establishing Rancho California WD discharge requirements to meet flows for the Santa Margarita River near Temecula. The long-term average precipitation for the Wildomar Gage for the period 1914 through 2012 is 14.11 inches. The reported precipitation for Water Year 2011-12 is 10.81 inches, which is in the second quartile for the period of record.

Monthly flows shown on Table 3.2 consist primarily of naturally occurring surface runoff, including return flows, except for Rancho California WD discharges into the Santa Margarita River and Murrieta Creek. Most of the Rancho California WD discharges are pursuant to the CWRMA. During Water Year 2011-12, the total discharges from MWD Meter WR-34 into the Santa Margarita River equaled 3,470 acre feet. The outlet from WR-34 is located just upstream from the Santa Margarita River near Temecula gaging station. In 2009, Rancho California WD extended a pipeline from its distribution system to discharge at the same location as the outlet WR-34. Discharges from the potable connection to the Santa Margarita River totaled 152 acre feet. During Water Year 2011-12, there were no discharges to Murrieta Creek from the System River Meter.

Figure 3.2

**Annual Precipitation for Wildomar Gage
1914 through 2012**

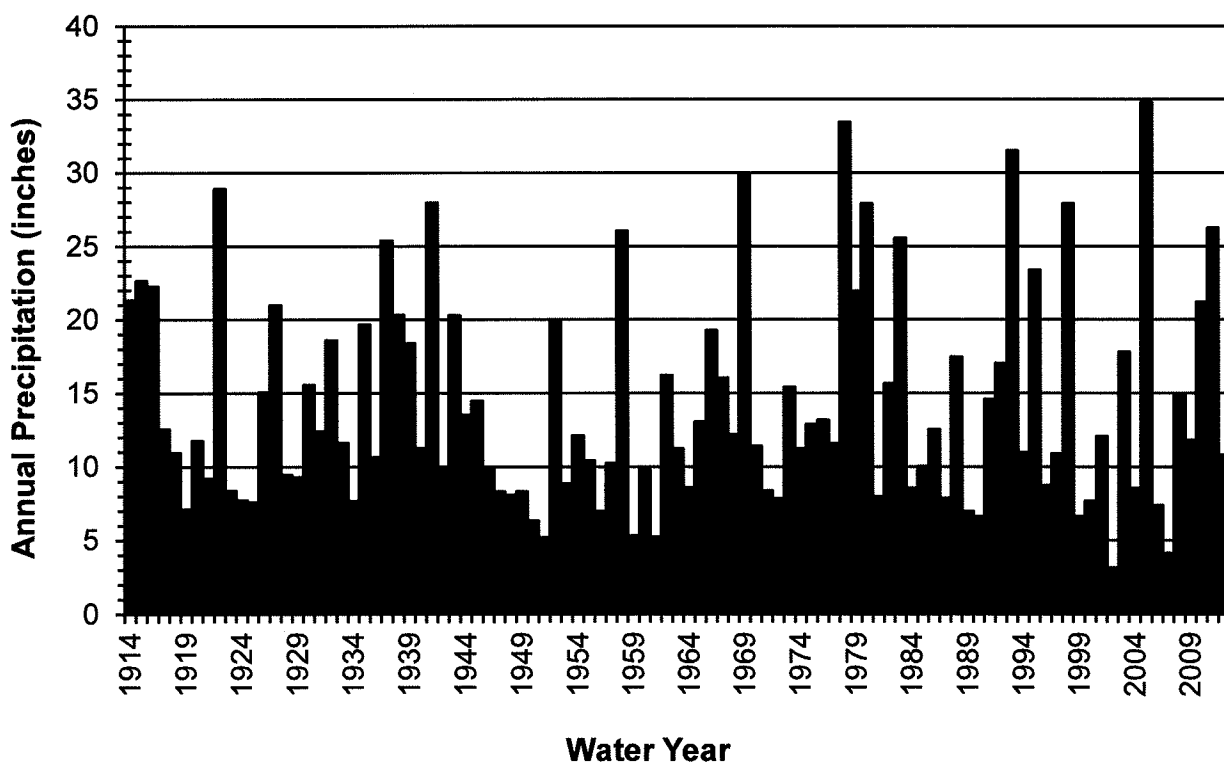

During 2011-12, Rancho California WD also released 32 acre feet from wells into Murrieta Creek, and 54 acre feet from wells into Santa Gertrudis Creek.

3.2 Surface Water Diversions

Surface diversions to surface water storage and groundwater storage are shown on Table 3.3 for Vail Lake and Table 3.4 for Lake O'Neill. In general, diversions to surface storage at Vail Lake and Lake O'Neill are computed as being equal to inflow less spill, however, diversion to surface storage at Vail Lake excludes inflow during the period from May 1 through October 31 when Permit 7032 does not allow such diversions. Inflow to Vail Lake is calculated as the sum of evaporation, spill, releases and change of storage. Inflow into Vail Lake during the period when diversions are not permitted is released and not credited to groundwater storage.

Direct surface diversions for 2011-12 are shown on Table 3.5. The use is primarily irrigation. Estimated consumptive uses, losses and returns are also shown.

3.3 Water Storage

Major water storage facilities in the Santa Margarita River Watershed are listed on Table 3.6, together with the water in storage on September 30, 2011 and September 30, 2012. Total Santa Margarita River stream system water in storage at the end of Water Year 2011-12 totaled 27,206 acre feet, compared to 30,032 acre feet at the end of the previous year. Imported water in storage in Lake Skinner and Diamond Valley Lake, both operated by Metropolitan Water District of Southern California (MWD), is also shown on Table 3.6.

TABLE 3.3

**SANTA MARGARITA RIVER WATERSHED
SURFACE WATER DIVERSIONS TO STORAGE FOR VAIL LAKE
2011-12**

Quantities in Acre Feet

	Surface Water Storage		
	2009-10	2010-11	2011-12
Storage end of prior year	21,920	23,850	29,390
Inflow - Total	7,466	13,944	2,964
Inflow to be Bypassed ^{1/}	571	1,262	906
Spill	0	0	0
Diversions to Surface Storage ^{2/}	6,895	12,682	2,058
Annual Evaporation	4,164	4,672	4,893
Releases - Total	1,372	3,732	901
Release to GW Storage ^{3/ 4/}	801	2,470	(5)
Change of Storage	1,930	5,540	(2,830)
Storage End of Year	23,850	29,390	26,560
Groundwater Storage			
Recharge Release from Vail Lake	801	2,470	0

Data reported by Rancho California WD except end of year storage reported by USGS.

1/ Inflow to be bypassed Oct 1 to Oct 31 and May 1 to Sept 30.

2/ Inflow less Spill less Inflow to be Bypassed.

3/ Total Release less Inflow to be Bypassed.

4/ Vail Lake operations shown in Table 3.3 reflect water year operations to be consistent with reporting in the Annual Watermaster Report. However, Permit 7032 specifies calendar year reporting and a continuous operating season of May through October for bypasses overlapping two water years. The value of negative 5 acre feet for Release to GW Storage is correct but misleading because the bypass season continues into October 2012. Inspection of Rancho California WD records for May through October 2012 shows total Inflow to be Bypassed in the amount of 915 acre feet with total Releases of 1,085 acre feet, resulting in 160 acre feet of excess releases during the bypass season.

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE 3.4

SANTA MARGARITA RIVER WATERSHED
SURFACE WATER DIVERSIONS TO STORAGE FOR LAKE O'NEILL
2011-12

Quantities in Acre Feet

	Surface Water Storage		
	2009-10	2010-11	2011-12
Storage end of prior year	789	653	642
Inflow - Total	3,080 ¹	3,456 ²	2,248 ³
Spill	265	979	8
Diversions to Surface Storage	2,815 ⁴	2,477 ⁴	2,240 ^{4,7}
Annual Evaporation	405	380	364
Releases - Total	1,790	683	107
Release to GW Storage	1,790	683	107
Apparent Seepage to GW	756 ⁵	1,423 ⁵	1,765 ⁵
Change of Storage	(136)	(11)	4
Storage End of Year	653	642	646
	Groundwater Storage		
	2009-10	2010-11	2011-12
Recharge Release from Lake O'Neill	2,546 ⁶	2,106 ⁶	1,872 ^{6,7}
Deliveries to Recharge Ponds	5,931	3,921	559 ⁷
Indirect Recharge from Ditch System	<u>1,124</u>	<u>839</u>	<u>881</u>
TOTAL	9,601	6,866	3,312

1/ 1,787 AF diverted from the Santa Margarita River, 849 AF estimated inflow from Fallbrook Creek, 296 AF from local runoff, and 148 AF from rainfall on lake surface.

2/ 1,185 AF diverted from the Santa Margarita River, 1,504 AF estimated inflow from Fallbrook Creek, 545 AF from local runoff, and 222 AF from rainfall on lake surface.

3/ 1,657 AF diverted from the Santa Margarita River, 341 AF estimated inflow from Fallbrook Creek, 141 AF from local runoff, and 109 AF from rainfall on lake surface.

4/ Inflow less Spill.

5/ Includes seepage losses, leakage through flashboards and unaccounted for water.

6/ Includes Release to GW Storage and Apparent Seepage to GW from Lake O'Neill.

7/ Dredging operations for Lake O'Neill in 2012 affected timing and amount of diversions from Santa Margarita River for both deliveries to Lake O'Neill and recharge ponds.

TABLE 3.5

**SANTA MARGARITA RIVER WATERSHED
SURFACE WATER DIVERSIONS TO USE
2011-12**

Quantities in Acre Feet

DIVERTER	Surface Diversions	Consumptive		Return ³
		Use ¹	Loss ²	
Blue Bird Ranch	31.5	21.2	3.2	7.1
James Carter	52.0	35.1	5.2	11.7
Chambers Family, LLC	8.0	5.4	0.8	1.8
Cal June, Inc.	9.0	6.1	0.9	2.0
Sage Ranch Nursery	100.0	67.5	10.0	22.5
Rose Lake, LLC	7.0	4.7	0.7	1.6
Val Verde Partners (Strange)	56.8	38.3	5.7	12.8
Wilson Creek Development, LLC	410.0	276.7	41.0	92.3
Cahuilla Indian Reservation	5.6	3.8	0.5	1.3
San Diego State University	41.3	27.9	4.1	9.3
TOTAL	721.2	486.8	72.1	162.3

¹ Consumptive use equals 75% of Diversions less Losses

² Losses equal 10% of Diversions

³ Returns equal 25% of Diversions less Losses

TABLE 3.6

SANTA MARGARITA RIVER WATERSHED
WATER IN STORAGE
2011-12
Quantities in Acre Feet

Santa Margarita River Storage	Total Capacity 1/	Water in Storage	
		9/30/2011	9/30/2012
Dunn Ranch Dam	90	0	0
Upper Chihuahua Creek Reservoir	47	0	0
Vail Lake	49,370	29,390	26,560
Lake O'Neill	1,670 R	642	646
SUBTOTAL	51,177	30,032	27,206
 Imported Water Storage			
Lake Skinner	44,000	38,919	40,888
Diamond Valley Lake	810,000	764,301	731,932
SUBTOTAL	854,000	803,220	772,820
 TOTAL STORAGE	 905,177	 833,252	 800,026

1/ Capacity shown is current capacity reported by owner. Original capacity or decreed capacity may not be reflected in this table.
R - Revised, dredging operations for Lake O'Neill completed in 2012.

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

Page Intentionally Blank

SECTION 4 - SUBSURFACE WATER AVAILABILITY

4.1 General

Much of the water from the Santa Margarita River stream system is obtained by pumping subsurface water. The Court has identified two basic types of subsurface water in its interlocutory judgments. One type is vagrant, local, percolating waters that do not add to, support or contribute to the Santa Margarita River or its tributaries. Such waters have been determined to be outside the continuing jurisdiction of the Court. These waters are typically found in the basement complex and/or residuum deposits in the Watershed. Wells tapping these deposits typically have low yields.

Other subsurface waters were found by the Court to add to, support and contribute to the Santa Margarita River and/or its tributaries. Aquifers containing such waters have been designated by the Court as younger alluvium and older alluvium. Younger alluvial deposits are commonly exposed along streams and in valleys. Older alluvium may be found underneath younger alluvium and is not limited to areas along stream channels. Older alluvium may or may not be exposed at ground surface. The use of subsurface water found in younger and older alluvium is generally under the continuing jurisdiction of the Court and is reported upon in this report.

4.2 Extractions

Total production of Santa Margarita River water by substantial water users in the Watershed from all sources is listed on Table 4.1 by hydrologic area, along with estimated consumptive use and return flows. Recovery of imported water that has been directly recharged is not included on Table 4.1. Substantial water users include water purveyors as well as private irrigators who irrigate eight acres or more or use an equivalent quantity of water.

In 2011-12, production by water purveyors totaled 31,936 acre feet, compared to 34,992 acre feet in 2010-11. Monthly quantities are shown in Appendix A and annual production for water years between 1966 and 2012 is shown in Appendix B.

The quantities of subsurface extractions by private irrigators are based on the irrigated acreage and the crop type. These quantities are reported in Appendix C to total 7,236 acre feet in 2011-12. Of the subsurface extractions, 75 percent is estimated to have been consumptively used and 25 percent to have been return flow. Return flow is that portion of the total deliveries that is not consumed. Although return flows average about 25 percent, such flows are affected with the type of use (domestic, commercial and irrigation), the type of irrigation application (drip, micro-sprinkler, furrow), and exports from watersheds.

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE 4.1

SANTA MARGARITA RIVER WATERSHED
SANTA MARGARITA RIVER WATER PRODUCTION BY SUBSTANTIAL USERS
2011-12

HYDROLOGIC AREA	WATER PURVEYOR PRODUCTION	OTHER IRRIGATED ACRES *	OTHER IRRIGATION PRODUCTION ACRE FEET *	TOTAL GROUNDWATER PRODUCTION ACRE FEET	SURFACE WATER DIVERSIONS ACRE FEET *	TOTAL PRODUCTION ACRE FEET	ESTIMATED CONSUMPTIVE USE 1/ ACRE FEET	ESTIMATED RETURN FLOW ACRE FEET
Wilson Creek	382	640 ^{2/}	1,975	2,357	6	2,363	1,772	591
Above Aguanga GWA (Lake Riverside, Includes Anza Valley (Anza MWC, Cahuilla))								
Temecula Creek	23	410	1,325	1,348	0	1,348	1,011	337
Above Aguanga GWA (Quiet Oaks MHP)								
Aguanga GWA	575	723	2,051	2,626	467	3,093	2,285	808
(Outdoor Resorts) (Jojoba Hills)								
Upper Murrieta Creek	0	0	0	0	0	0	0	0
(Warm Springs Creek above 7S/3W-14)								
Lower Murrieta Creek	0	310	44	44	100	144	100	44
(Santa Gertrudis/Tucalota Creek above 7S/2W-18 -- Includes FPUD Diversion from Lake Skinner)								
Murrieta-Temecula GWA	26,280	852	1,358	27,638	52	27,690	20,764	6,926
(RCWD **, WMWD (Murrieta Division), EMWD, Pechanga and Hawthorn)								
Santa Margarita River Below the Gorge								
Deluz Creek	0	275	470	470	46	516	384	132
Sandia Creek	0	55	0	0	9	9	6	3
Rainbow Creek	0	0	0	0	0	0	0	0
Santa Margarita River	4,676	20	4	4,680	41	4,721	1,433	482
(USMC)								
TOTAL	31,936	3,285	7,227	39,163	721 ^{3/}	39,884	27,755	9,323

1/ Estimated consumptive use is equal to 75% of Total Groundwater Production plus 75% of Surface Diversions less 10% (CU = .75{GW + .90 * SW}0, except for Camp Pendleton where export of 2,807 acre feet is excluded and return flows include any measured wastewater returns to the Watershed.

2/ Includes lands overlying deep aquifer in Anza Valley.

3/ Includes surface water diversion for irrigation, commercial and domestic use.

* Data taken from Appendix C.


** RCWD pumped an additional 284 AF that was exported to the San Mateo Watershed

4.3 Water Levels

Water levels in selected wells in the Watershed are measured periodically by various entities. Historical water levels in five wells at various locations in the Watershed are shown in this report on Figures 4.1, 4.2, 4.3, 4.4 and 4.5.

Figure 4.1 shows water levels in Well No. 8S/2W-12H1 (Windmill Well) located in the Rancho California WD service area downstream from Vail Lake. Note the extended drawdown from 1945 to 1978, the major recoveries during the wet years in 1980 and 1993, and the effect of relatively dry years after 1980 and after 1993. Water levels declined by 5.3 feet between September 30, 2011 and September 30, 2012. It should be noted that the Windmill Well is located in Pauba Valley about 1.5 miles downslope from the Valle de los Caballos (VDC) recharge area, where releases from Vail Lake as well as imported water are recharged. In Water Year 2011-12, 14,643 acre feet of imported water were recharged in the VDC of which 95 percent was recovered in the same year.

FIGURE 4.1

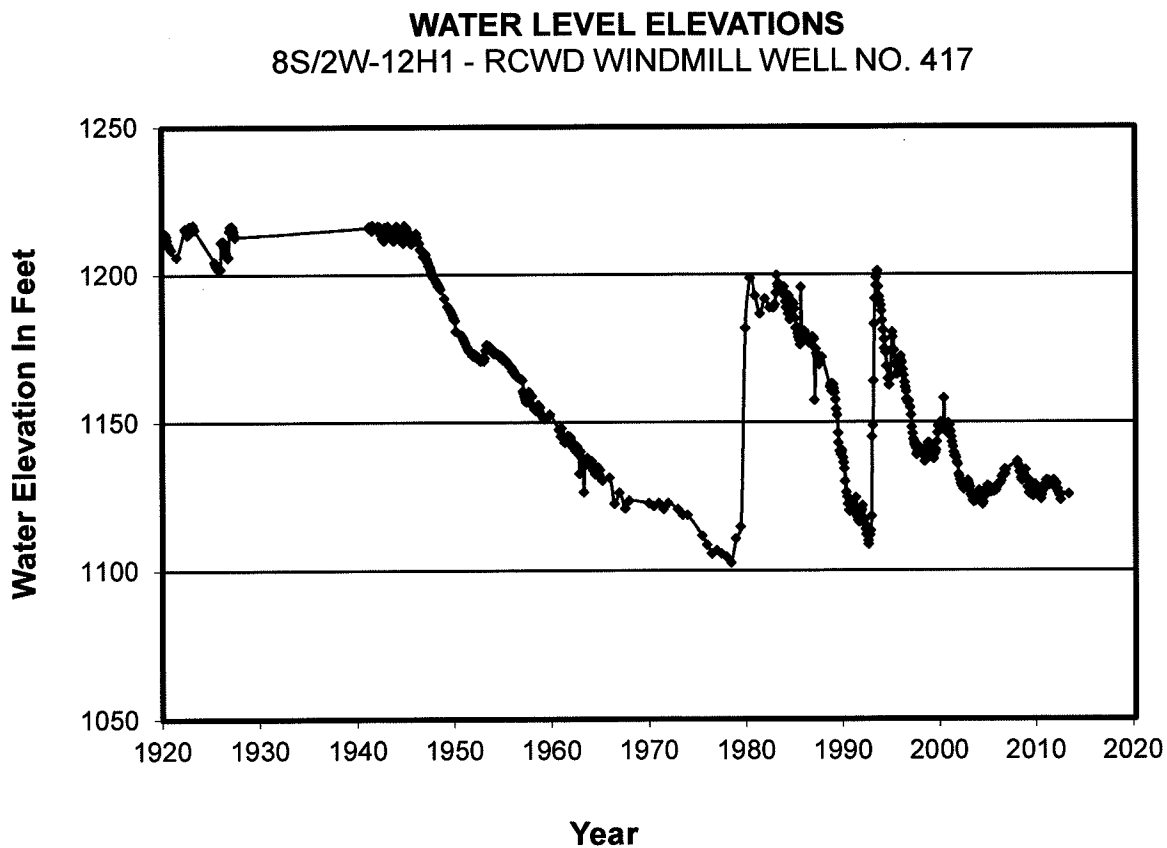


Collar El. 1216.7 Feet; Depth 515 Feet; Drilled in Alluvium
Ref: RCWD reports (1920-2012)

Figure 4.2 shows water levels at Camp Pendleton in Well No. 10S/4W-7J1 (previously referred to as 10S/4W-7J4), a monitoring well located in the Upper Sub-basin. Fluctuations in recent years illustrate recharge during the winter months and drawdown each summer, with the water levels ranging from approximately 82 to 92 feet in elevation. Water levels in Well 7J1 declined 1.4 feet in the period between September 2011 and September 2012.

FIGURE 4.2

WATER LEVEL ELEVATIONS
10S/4W-7J1 - CAMP PENDLETON *

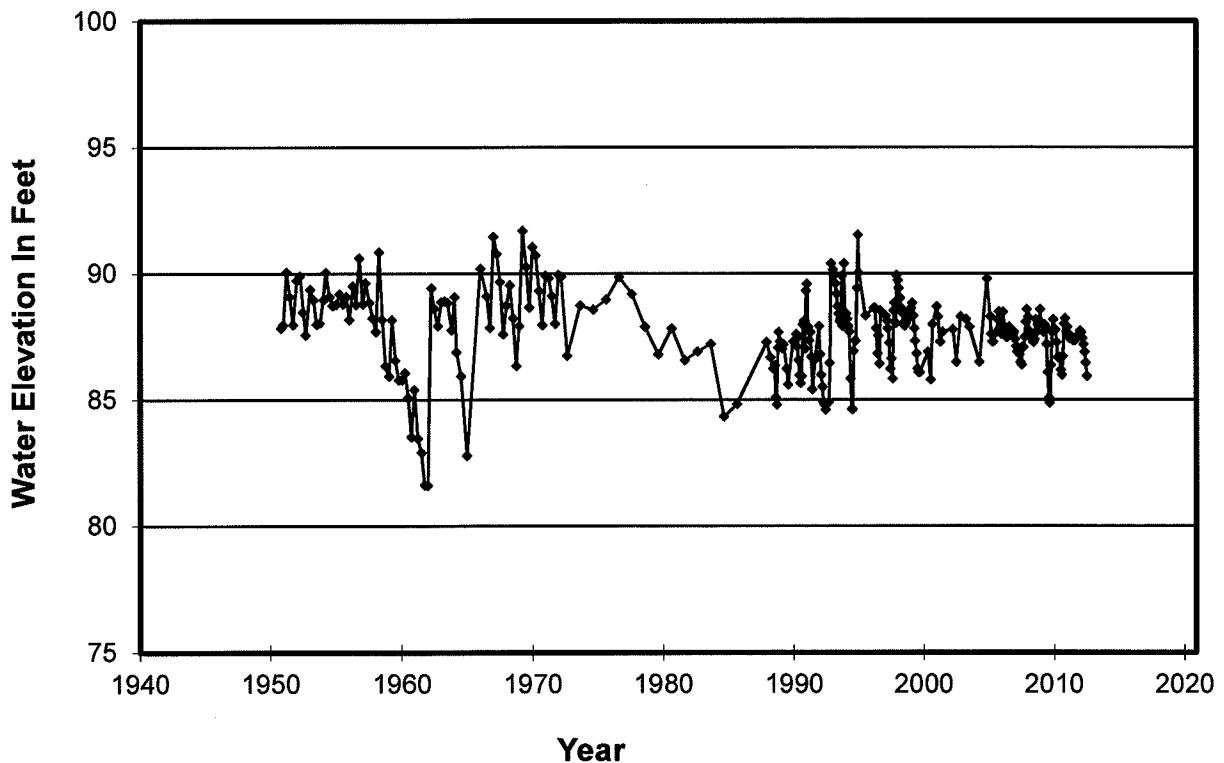

Ground El. 93.8 Feet; Depth 141 Feet; Perf. Unknown; Drilled in Alluvium


Camp Pendleton Records (1950-72) (1988-2012); Leeds Hill Study (1973-85) Dates Estimated

* Data shown for Well No. 10S/4W-7J1 except for period October 1999 through September 2007 data shown for Well No. 10S/4W-7J4.

Figure 4.3 shows water levels from Holiday Well No. 7S/3W-20C9 in the Murrieta Division service area of Western Municipal Water District. The Holiday Well was used as a production well until February 2006, but now is used only as a monitoring well. Water levels in this well rose by 5.0 feet between September 30, 2011 and September 30, 2012. Water levels in the Lynch Well, 7S/3W-17R2, which serves as a monitoring well and had no production in 2011-12, rose by 5 feet.

FIGURE 4.3

WATER LEVEL ELEVATIONS
7S/3W-20C9 - WMWD HOLIDAY WELL

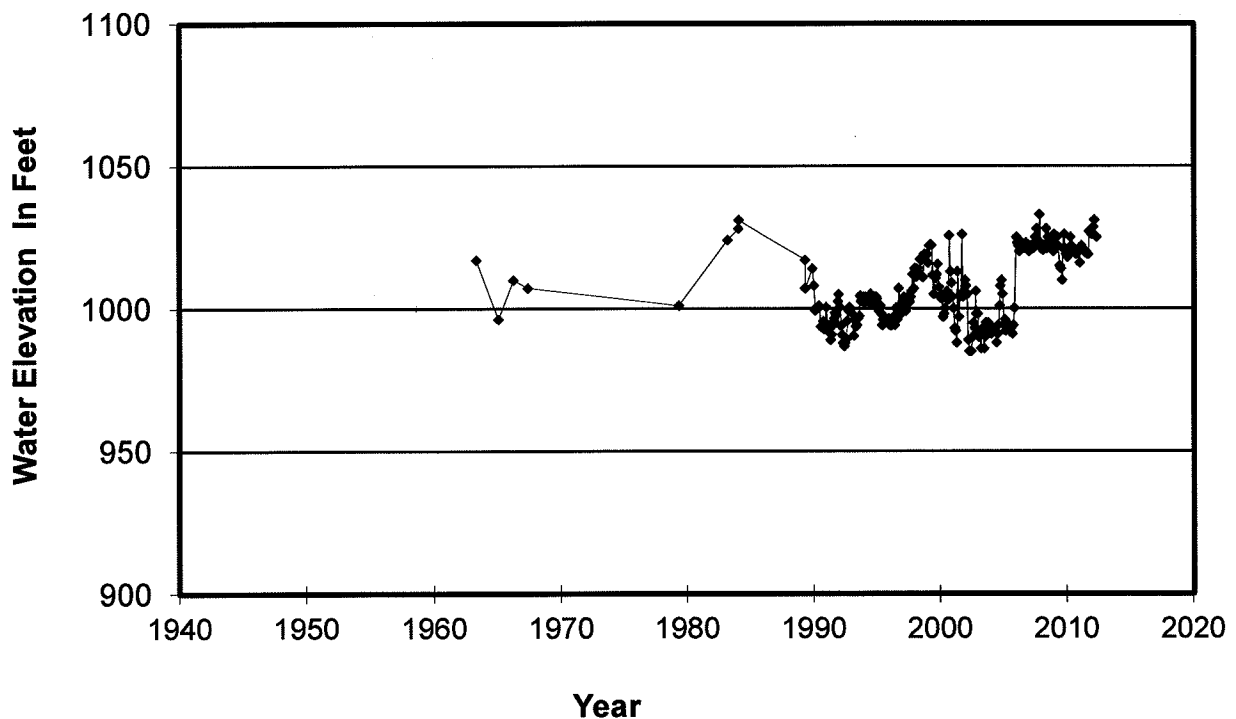


Ground El. 1090 Feet; Depth 307 Feet; Perf. 60 - 307 Feet
Western Municipal Water District

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

Figure 4.4 shows water levels for Well No. 7S/3E-21G1, Anza Mutual Water Company Well No. 1, a production well located in the Anza Valley. Water levels in this well declined by 35 feet by the end of 2011-12. As may be noted from Figure 4.4, recent measurements show annual 50 foot fluctuations in groundwater levels at this well, partly in response to the operation of nearby irrigation wells. Current levels are at or near the lowest elevation for the period of record.

FIGURE 4.4

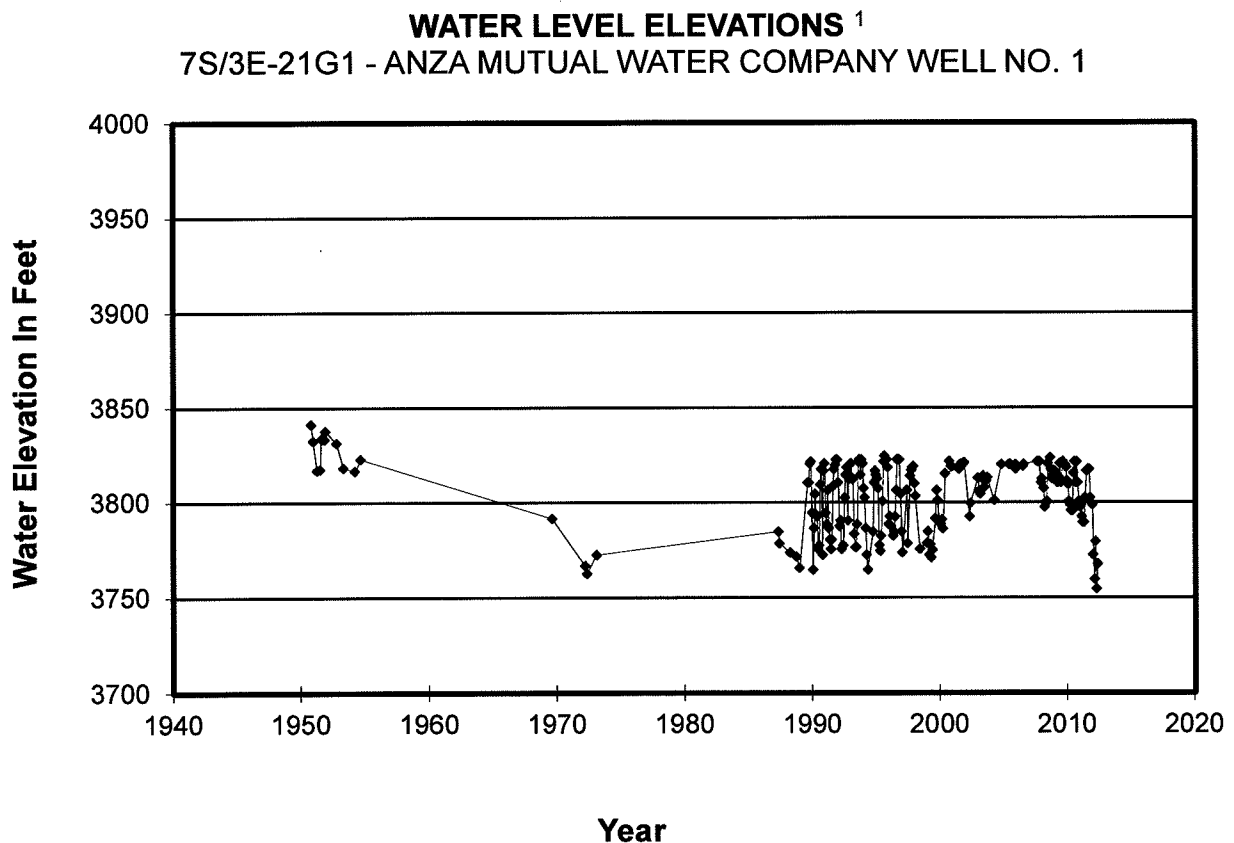


¹ Static water levels plotted after April 1999
Ground El. 3862.6 Feet; Depth 260 Feet; Perf. 20 - 260 Feet; Drilled in Alluvium
Anza Mutual Water Co. Well No. 1 (1987-2012); DWR Bulletin 91-22 (1950-73)

Figure 4.5 shows water levels at Well No. 8S/2W-29G1, located in Wolf Valley on the Kelsey Tract of the Pechanga Indian Reservation. The well is not used for water production. Water levels collected since 1925 reflect unconfined groundwater levels. As shown on Figure 4.5 the groundwater levels have fluctuated within a 44 foot range above and below elevation 1050 feet in response to wet years and dry periods until recently. In the past few dry years, levels have declined below their usual range. In November 2004, this well went dry due to the preceding relatively dry hydrological conditions and pumping of the nearby New Kelsey Well on the Pechanga Reservation. In order to continue to monitor water levels on the Pechanga Indian Reservation, water levels for Well No. 8S/2W-29B9 are also shown on Figure 4.5. Well No. 8S/2W-29B9 is completed in the younger alluvium. As shown on Figure 4.5, water levels for Well No. 8S/2W-29B9 coincide with water levels for the common period of record for Well No. 8S/2W-29G1. Water levels in Well 8S/2W-29B9 rose by 1.0 feet in 2011-12.

FIGURE 4.5

**WATER LEVEL ELEVATIONS
PECHANGA INDIAN RESERVATION WELLS**

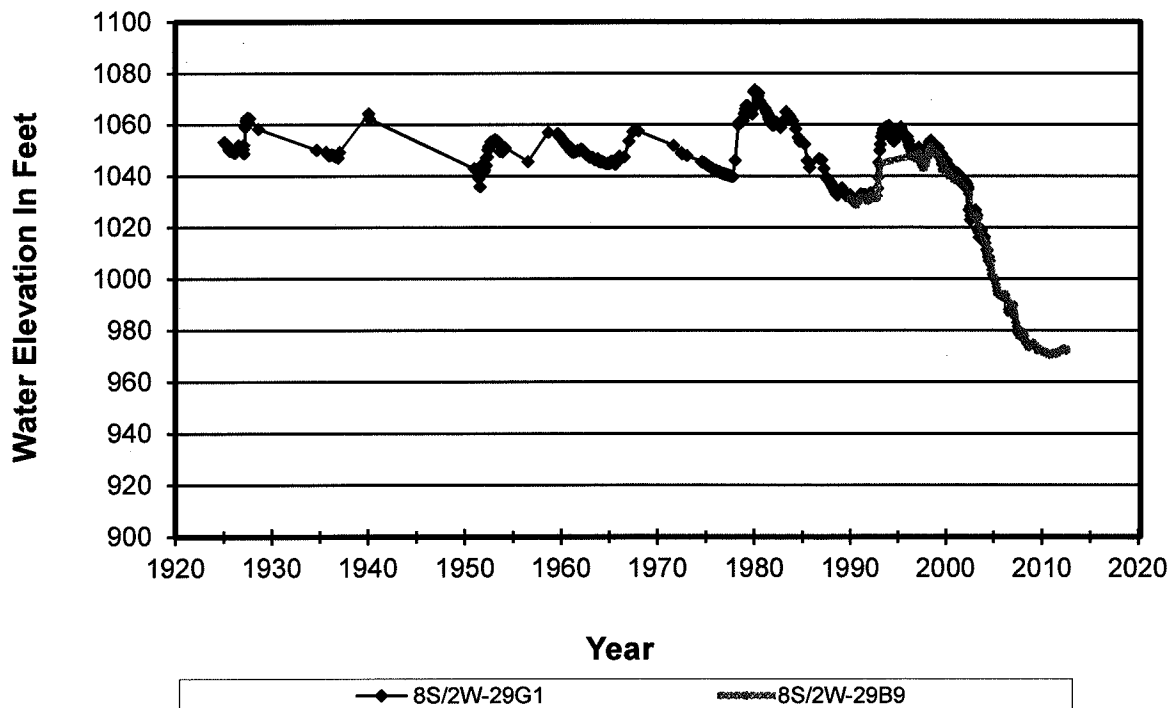

8S/2W-29G1: Ground El. 1091.1 Feet; Depth 159.1 Feet
8S/2W-29B9: Ground El. 1075.93 Feet; Depth 113.0 Feet
U.S. Geological Survey Records

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

Changes in water levels in the above noted wells between the end of the previous Water Year and the end of the 2012 Water Year are shown below:

<u>Well</u>	<u>Water Elevation 2011 Feet</u>	<u>Water Elevation 2012 Feet</u>	<u>Change in Water Level Feet</u>
RCWD 8S/2W-12H1	1129.0	1123.7	Down 5.3
USMC 10S/4W-7J1*	87.3 R	85.9	Down 1.4
WMWD 7S/3W-20C9	1020.0	1025.0	Up 5.0
Anza MWC 7S/3E-21G1	3802.6	3767.6	Down 35.0
Pechanga IR 8S/2W-29B9	971.2	972.2	Up 1.0

* Well previously referred to as 10S/4W-7J4
R - Revised

4.4. Groundwater Storage

Bulletin 118 Update 2003 prepared by the State of California Department of Water Resources describes three groundwater basins in the Santa Margarita River Watershed: Santa Margarita Valley, Temecula Valley, and Coahuila (Cahuilla) Valley. These basins are also known as the Santa Margarita Groundwater Basin, the Murrieta-Temecula Groundwater Basin, and the Anza Groundwater Basin. Groundwater storage in each of these basins is described in this section.

Santa Margarita Groundwater Basin – The Santa Margarita Groundwater Basin is located along the Santa Margarita River at Camp Pendleton and includes three sub-basins: Upper, Chappo, and Ysidora. Useable groundwater storage is summarized on Table 4.2. Table 4.2 shows that the total combined storage for all the sub-basins between the depths of 5 and 100 feet is 48,100 acre feet. However, much of that storage is below sea level. Thus, the useable capacity is considered to be 28,700 acre feet as shown on Table 4.2. In 2011-12, useable groundwater storage in place was computed for all three sub-basins to be 25,467 acre feet. The useable storage in place for the three sub-basins amounted to 27,322 acre feet in 2010-11. Thus, there was a decrease in groundwater storage in place of 1,855 acre feet for the water year. It may be noted that classification of storage as useable is made without allowances for maintenance of riparian habitat.

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE 4.2
SANTA MARGARITA RIVER WATERSHED
GROUNDWATER STORAGE AT CAMP PENDLETON
2011-12
Quantities in Acre Feet

	Sub-basin			Total
	Upper	Chappo	Ysidora	
I. Available Storage				
A. Total Storage ¹	12,500	27,000	8,600	48,100
B. Useable Storage	12,500	15,000 ²	1,200 ³	28,700
II. Unused Storage				
A. Wells used for Depth	10S/4W-7J1	10S/4W-18L1 *	11S/5W-11D4	
B. Land Surface Elevation - Feet	93.8 **	75.9 **	18.8	
C. Depth to Water - Feet ⁴	7.9	11.7	10.0	
D. Depth below 5 Feet	2.9	6.7	5.0	----
E. Average Area - Acres ⁵	840	2,560	1,060	----
F. Specific Yield ⁶	0.216	0.130	0.090	----
G. Unused Storage below 5 Feet	526	2,230	477	----
III. Useable Storage in Place ⁷	11,974	12,770	723	25,467
IV. Useable Storage in Place 2010-11	12,246 R	14,324 R	752	27,322 R
V. Change in Storage 2011-12	(272)	(1,554)	(29)	(1,855)

1 Computed by USGS (Worts, F. C., Jr. and Boss, R. F., *Geology and Ground-Water Resources of Camp Pendleton, CA, July 1954*) as the storage between depths of 5 and 100 feet.

2 Storage between 5 foot depth and sea level.

3 Storage between 5 foot depth and 10 feet above sea level.

4 Reported by Camp Pendleton as average values for month of September unless noted otherwise.

5 Average area estimated over depth interval for unused storage.

6 From Worts and Boss for depth interval of 5 to 50 feet.

7 Useable storage includes stored water reserved for riparian habitat; however specific amount stored for such purposes not delineated.

* Well 10S/4W-18L1 was destroyed during 2012, depth to water extrapolated from measurements for well 10S/5W-13G1.

** Revised to conform to NAVD88 datum as reported by Camp Pendleton.

R-Revised

Murrieta-Temecula Groundwater Basin – The Murrieta-Temecula Groundwater Basin is located along Murrieta and Temecula creeks in the Upper Santa Margarita River Watershed. Total groundwater storage at the end of Water Year 2001 was computed for each of 22 hydrologic sub-areas that make up the Groundwater Basin. These computations were based on the areal extent of each sub-area, the thickness of each of three aquifers, (younger alluvium, Pauba aquifer and Temecula aquifer), a specific yield for each aquifer, and the depth to water in each aquifer at the end of the water year. Specific yields were based on unconfined conditions for all aquifers. The total groundwater storage in the uppermost 500 feet as of September 30, 2001, was estimated at 1,340,556 acre feet.

Annual changes in groundwater storage have been computed for the years since 2001 using two methodologies – a water budget method and a groundwater level method. The water budget method determines the change in storage as the difference between the major elements of inflow and outflow to the groundwater area. Table 4.3 shows the changes for Water Years 2008 through 2012. The change in groundwater storage for 2011-12, calculated using the water budget method is a decline of 11,785 acre feet.

The groundwater level method is based on the changes in water levels in key wells in the hydrologic sub-areas as shown on Table 4.4. Changes in storage under the groundwater level method for Water Years 2008 through 2012 are shown on Table 4.4. The change in groundwater storage for Water Year 2012 is calculated as a decline of 11,113 acre feet.

The foregoing two methods are based on independent measurements and estimates. The estimates from the two methods are generally comparable for 2012, as well as other years for the period 2001 through 2011. However, the estimates from the two methods for certain years indicate differences in the results. It will take testing over a number of years under varying hydrologic conditions to refine these approaches. These values will be compared with those computed with the groundwater model that is used for implementation of the Cooperative Water Resource Management Agreement between Camp Pendleton and Rancho California WD when the model update is completed. It is noted, as part of the groundwater model update that the two methods are also being updated. A review of the various elements of the water budget method will be conducted. With respect to the groundwater level method, key wells for all sub-areas will be reviewed for suitability. The values for storativity and aquifer area will also be evaluated.

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE 4.3

SANTA MARGARITA RIVER WATERSHED
CHANGES IN GROUNDWATER STORAGE
MURRIETA-TEMECULA GROUNDWATER AREA
Water Budget Method
Quantities in Acre Feet

<u>Elements of Inflow</u>	<u>Water Year Ending</u>				
	2008	2009	2010	2011	2012
Releases from Vail ¹	5,061 R	1,461 R	1,372 R	3,732 R	901
Releases from Lake Skinner ²	132	142	156	471	0
Freshwater Releases to Stream ³	4,092	5,302	3,913	4,399	3,708
Reclaimed Water Released to Stream ⁴	0	0	0	0	0
Recharged Imported Water ⁵	12,419	14,828	12,858	13,873	14,643
Return Flow from RCWD Groundwater Production ⁶	8,660	9,325	8,441	8,409	8,984
Return Flow from Import Direct Use ⁷	4,725	3,903	2,999	2,668	3,015
Return Flow from Applied Wastewater ⁸	1,335	1,565	1,582	1,391	1,288
Underflow and Tributary Inflow ⁹	27,906	15,251	30,674	47,957	4,119
Subtotal	64,330 R	51,777 R	61,995 R	82,900 R	36,658
<u>Elements of Outflow</u>					
Riparian Evapotranspiration and Underflow ¹⁰	508	508	508	508	508
Total RCWD Groundwater Production ¹¹	37,653	40,541	36,698	36,560	39,060
Net Pumping by Others ¹²	1,841	2,225	2,042	2,002	2,138
Surface Outflow ¹³	23,071	14,948	25,894	36,922	6,737
Subtotal	63,073	58,222	65,142	75,992	48,443
<u>Change in Groundwater Storage</u>	1,257 R	(6,445) R	(3,147) R	6,908 R	(11,785)

1 - Table 3.3, Total Releases

2 - Section 5.4

3 - Table A-7, SMR Release

4 - Table A-7, Reclaimed Wastewater, Murrieta Creek Discharge (ceased October 18, 2002)

5 - Table A-7, Footnote 3

6 - Table 7.8, Total Production times 0.23

7 - Rancho Division Direct Use Imports, Table A-7 Footnote 3, times 0.23

8 - The sum of: (Reclaimed Wastewater Table A-7, Reuse in SMRW) plus (Table A-1, Reuse in SMRW), times 0.23

9 - Murrieta Creek at Temecula Flow times 1.6697 which is based on a correlation between Murrieta Creek at Temecula flow and Tributary Inflow, Areal Recharge and Subsurface Inflow for the period 1977-1998 as shown in Table II-10, Vol. II, Geology and Hydrology, Surface and Ground Water Model of the Murrieta-Temecula Ground Water Basin, California, dated January 31, 2003.

10 - Table II-10, Vol. II, Geology and Hydrology, Surface and Ground Water Model of the Murrieta-Temecula Ground Water Basin, California, dated January 31, 2003.

11 - Table 7.8 Total Production

12 - The sum of Groundwater Production from: [Table A-1 (EMWD), A-5 (Pechanga IR), A-10 (WMWD Murieta Division, previously A-5), Appendix C, Murrieta-Temecula Groundwater Area], times .77

13 - Table 3.2 Santa Margarita River near Temecula

R - Revised

TABLE 4.4

SANTA MARGARITA RIVER WATERSHED
CHANGES IN USEABLE GROUNDWATER STORAGE
MURRIETA-TEMECULA GROUNDWATER AREA
 Groundwater Level Method

Sub-area	Key Aquifer	Specific Yield/ Storativity	Key Well	Aquifer Area Acres	Water Depth at end of Water Year					Change in Depth Feet					Change in Storage in Water Year Acre Feet				
					2008	2009	2010	2011	2012	2007 - 2008	2008 - 2009	2009 - 2010	2010 - 2011	2011 - 2012	2008	2009	2010	2011	2012
1	Temecula	0.0036	510 ⁸	1371	166.96	198.02	199.60	211.71	215.40	(37.96)	(31.06)	(1.58)	(12.11)	(3.69)	(187)	(153)	(8)	(60)	(18)
2	Pauba	0.0398	439 ¹	479	39.81	34.73	28.67	26.00	30.75	(2.71)	5.08	6.06	2.67	(4.75)	(52)	97	116	51	(91)
3	Pauba	0.0309	146 ¹	802	43.80	34.38	28.62	26.22	29.61	(10.44)	9.42	5.76	2.40	(3.39)	(259)	233	143	59	(84)
4	Pauba	0.0350	101 ^{3,5}	694	174.47	113.37	79.04	161.11	175.15	(91.86)	61.10	34.33	(82.07)	(14.04)	(2,231)	1484	834	(1,993)	(341)
5	Pauba	0.0319	102 ^{3,6}	1322	112.27	119.74	119.52	84.98	62.05	20.23	(7.47)	0.22	34.54	22.93	853	(315)	9	1457	967
6	Pauba	0.0698	495	1562	107.68	105.95	96.55	89.12	78.76	(6.44)	1.73	9.40	7.43	10.36	(702)	189	1025	810	1130
7	Pauba	0.0012	211	719	172.33	160.02	153.00	118.00	108.66	(27.48)	12.31	7.02	35.00	9.34	(24)	11	6	30	8
8	Oyal	0.20	492 ¹	339	29.61	28.35	28.47	28.60	27.79	(0.81)	1.26	(0.12)	(0.13)	0.81	(55)	85	(8)	(9)	55
9	Pauba	0.0891	492 ¹	496	29.61	28.35	28.47	28.60	27.79	(0.81)	1.26	(0.12)	(0.13)	0.81	(36)	56	(5)	(6)	36
10	Temecula	0.0036	410	2066	327.10	334.60	333.96	338.00	318.00	2.41	(7.50)	0.64	(4.04)	20.00	18	(56)	5	(30)	149
11	Oyal	0.20	426	1438	43.19	41.12	38.29	33.04	40.05	1.01	2.07	2.83	5.25	(7.01)	290	595	814	1510	(2,016)
12	Pauba	0.0746	426	1165	43.19	41.12	38.29	33.04	40.05	1.01	2.07	2.83	5.25	(7.01)	88	180	246	456	(609)
13	Oyal	0.20	422	1405	61.33	62.32	63.39	62.60	65.00	0.16	(0.99)	(1.07)	0.79	(2.40)	45	(278)	(301)	222	(674)
14	Pauba	0.0634	422	1413	61.33	62.32	63.39	62.60	65.00	0.16	(0.99)	(1.07)	0.79	(2.40)	14	(89)	(96)	71	(215)
15	Oyal	0.20	417 ⁴	1769	85.74	91.19	92.65	87.66	93.00	4.38	(5.45)	(1.46)	4.99	(5.34)	1550	(1,928)	(517)	1765	(1,889)
16	Pauba	0.0422	417 ⁴	752	85.74	91.19	92.65	87.66	93.00	4.38	(5.45)	(1.46)	4.99	(5.34)	139	(173)	(46)	158	(169)
17	Oyal	0.20	484 ^{3,7}	898	36.45	50.57	50.58	27.48	55.25	10.34	(14.12)	(0.01)	23.10	(27.77)	1857	(2,536)	(2)	4149	(4,987)
18	Pauba	0.0198	484 ^{3,7}	398	36.45	50.57	50.58	27.48	55.25	10.34	(14.12)	(0.01)	23.10	(27.77)	81	(111)	0	182	(219)
19	Temecula	0.0036	462 ¹	2084	407.13	423.20	416.80	408.50	409.80	13.33	(16.07)	6.40	8.30	(1.30)	100	(121)	48	62	(10)
20	Temecula	0.0036	464 ¹	1347	325.67	325.30	326.00	328.50	329.60	(1.66)	0.37	(0.70)	(2.50)	(1.10)	100	(121)	48	62	(10)
21	Temecula	0.0036	509 ^{1,9}	1967	---	503.60	511.70	521.60	527.30	---	---	(8.10)	(9.90)	(5.70)	---	---	(57)	(70)	(40)
17	Temecula	0.0036	139 ¹	2008	---	---	512.74	530.39	536.90	---	---	---	(17.65)	(6.51)	---	---	---	(128)	(47)
18	Pauba	0.0967	129 ²	1546	212.51	217.39	221.44	225.96	230.25	(7.29)	(4.88)	(4.05)	(4.52)	(4.29)	(1,090)	(730)	(605)	(676)	(641)
19	Temecula	0.0036	466 ¹	1562	292.00	297.70	314.00	325.22	336.22	(4.97)	(5.70)	(16.30)	(11.22)	(11.00)	(28)	(32)	(92)	(63)	(62)
20	Pauba	0.0738	493	3231	268.02	270.75	274.78	275.51	279.64	(0.07)	(2.73)	(4.03)	(0.73)	(4.13)	(17)	(651)	(961)	(174)	(985)
21	Pauba	0.1392	463 ¹	2303	55.44	55.46	54.80	53.80	54.40	0.37	(0.02)	0.66	1.00	(0.60)	119	(6)	212	321	(192)
*	Pauba	0.0325	Lynch	1008	72.00	69.00	71.00	72.00	77.00	(9.00)	3.00	(2.00)	(1.00)	(5.00)	(295)	98	(66)	(33)	(164)
TOTAL															170	(4,149)	691	8,049	(11,113)

1 - Well not measured for year with dashes; Sub-area excluded for change in storage calculation for years with no measurement.

2 - For 2007 used reading of April 28, 2007.

3 - Data for wells 101, 102, and 484 were revised for years 2007, 2008, 2009 and 2010.

4 - For 2007 data was revised to use the reading of October 28, 2007.

5 - Key Well 101 designated for Sub-area 4 in Year 2011; previously Well 401 designated as the Key Well.

6 - Key Well 102 designated for Sub-area 5 in Year 2011; previously Well 402 designated as the Key Well.

7 - Key Well 484 designated for Sub-area 13 in Year 2011; previously Well 414 designated as the Key Well.

8 - Key Well 510 for Sub-area 1 renamed in Year 2012; previously the well was named as Well 301.

9 - Key Well 509 for Sub-area 16 renamed in Year 2012; previously the well was named as Well 209.

* Sub-area is located within Murrieta Division of Western MWD; Sub-areas 1 through 21 are located in Rancho California WD.

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

Anza Groundwater Basin – The Anza Groundwater Basin is located along Cahuilla Creek in the upper portion of the Santa Margarita River Watershed.

The most recent study that determined storage volumes was conducted by Riverside County in 1990. That study concluded that the groundwater storage of about 182,200 acre feet in 1950 had decreased to about 165,000 acre feet in 1986. The study also concluded that “. . . basin hydrogeologic features, production facilities conditions, and locations/depths of storage . . .” limited the useable portion to 40% of the groundwater storage or about 56,200 acre feet in 1986.

During Water Years 2005 through 2009, a series of water level measurements were made by the USGS in Anza Valley under contract with the Bureau of Indian Affairs. The data from these measurements are available at the USGS website: <http://nwis.waterdata.usgs.gov/ca/nwis/gwlevels>.

The wells included in the program can be located by selecting the latitude-longitude box selection criteria and specifying the following bounds:

North Latitude - 33° 37' 00"
South Latitude - 33° 30' 00"
West Longitude - 116° 48' 00"
East Longitude - 116° 38' 00"

Page Intentionally Blank

SECTION 5 - IMPORTS/EXPORTS

5.1 General

Court Orders require the Watermaster to determine the quantities of imported water used in the Watershed. Most of the water imported into the Santa Margarita River Watershed is delivered by Metropolitan Water District of Southern California (MWD) to local districts. MWD obtains its water from the State Water Project (SWP) and the Colorado River. Both the SWP and the Colorado River system have major storage reservoirs to provide long-term carryover storage. The quantities of water in storage at the end of the water year in the major reservoirs in each system are indicated on Table 5.1. Total storage in the SWP for the last ten years is shown graphically on Figure 5.1. Similarly, total storage for the Colorado River Reservoirs for the last ten years is shown on Figure 5.2. It may be seen from Table 5.1 that during Water Year 2011-12, water in storage in the SWP decreased from 4.50 million acre feet on September 30, 2011, to 2.94 million acre feet on September 30, 2012. Storage on September 30, 2012 corresponds to about 56 percent of the total SWP storage capacity.

Water in storage in the Colorado River system decreased 4.7 million acre feet from 38.3 million acre feet in the prior year to 33.6 million acre feet on September 30, 2012. On September 30, 2012, those reservoirs contained 52 percent of their total combined capacity.

The California Department of Water Resources prepares projections of water availability in the SWP for the coming year (2013) on a monthly basis from February through May. The report DWR Bulletin 120-4-13 dated May 1, 2013, indicated that statewide precipitation October 1 through April 30 was 75 percent of average compared to 75 percent last year. As of March 22, 2013, the SWP allocation for 2013 will meet 35 percent of contractors' requests.

The following entities imported water directly or indirectly from MWD into the Santa Margarita River Watershed:

- Eastern Municipal Water District
- Elsinore Valley Municipal Water District
- Fallbrook Public Utility District
- Rainbow Municipal Water District
- Rancho California Water District
- U. S. Naval Weapons Station – Fallbrook Annex
- Western Municipal Water District

TABLE 5.1

**SANTA MARGARITA RIVER WATERSHED
STORAGE IN STATE WATER PROJECT
AND COLORADO RIVER RESERVOIRS**

Thousands of Acre Feet 1/

STATE WATER PROJECT RESERVOIRS

Reservoir	Total Capacity	2003	2004	2005	2006	2007	2008	2009	2010	2011	2012
Oroville	3,540	2,284	1,753	2,877	2,833	1,568	1,097	1,337	1,755	3,045	1,977
San Luis (State Share)	1,060	653	514	925	911	445	200	224	415	874	389
Pyramid	171	165	161	160	163	166	163	166	164	164	169
Castaic	324	314	298	306	266	313	268	200	260	284	264
Silverwood	73	70	72	72	72	73	71	70	70	71	71
Perris	132	114	116	82	72	66	69	62	61	66	72
Total	5,300	3,600	2,914	4,422	4,317	2,631	1,868	2,059	2,725	4,504	2,942
Percent of Capacity		68%	55%	83%	81%	50%	35%	39%	51%	85%	56%

MAJOR COLORADO RIVER RESERVOIRS

Reservoir	Total Capacity	2003	2004	2005	2006	2007	2008	2009	2010	2011	2012
Flaming Gorge	3,789	2,635	2,679	3,177	3,130	3,063	3,024	3,394	3,154	3,467	3,030
Blue Mesa	941	387	507	588	667	687	650	651	609	699	340
Navajo	1,709	729	935	1,516	1,420	1,510	1,319	1,314	1,412	1,327	1,035
Powell	27,000	12,109	9,170	11,939	11,917	11,929	14,509	15,463	15,267	17,593	13,929
Mead	28,537	15,618	13,937	15,219	13,887	12,505	12,013	10,933	10,092	12,977	13,135
Mohave	1,818	1,643	1,605	1,573	1,584	1,545	1,586	1,501	1,575	1,610	1,606
Havasu	648	562	589	554	555	576	584	564	560	585	561
Total	64,442	33,683	29,422	34,566	33,160	31,815	33,685	33,820	32,669	38,258	33,636
Percent of Capacity		52%	46%	54%	51%	49%	52%	52%	51%	59%	52%

1/ Storage reported for end of water year on September 30

FIGURE 5.1

STORAGE IN STATE WATER PROJECT
Water Years 2003 To 2012
Total Capacity is 5.3 Million Acre Feet


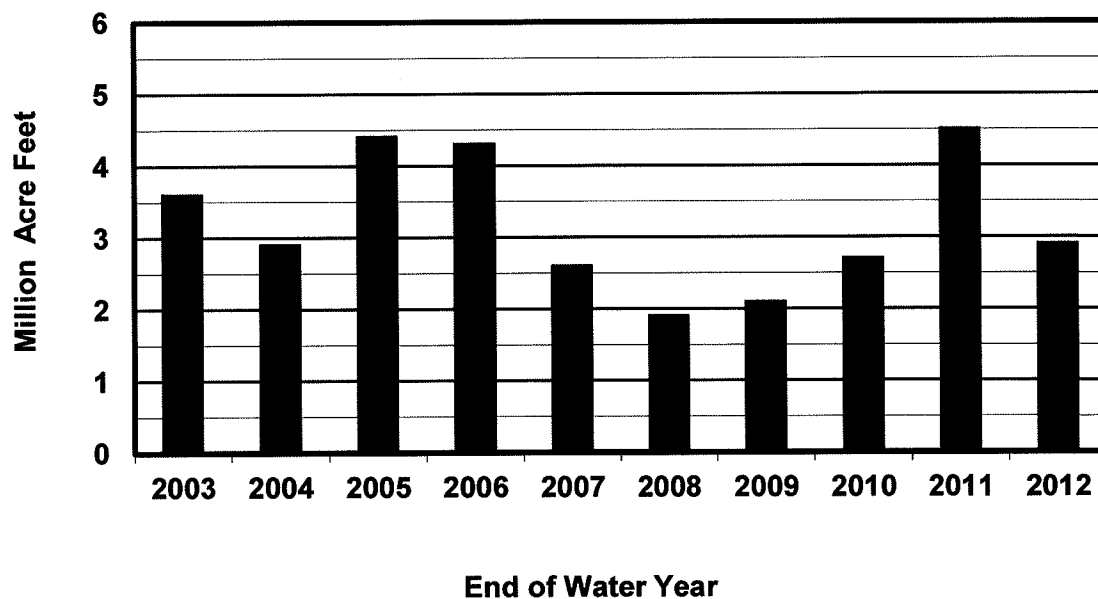


FIGURE 5.2

STORAGE IN COLORADO RIVER RESERVOIRS
Water Years 2003 To 2012
Total Capacity is 64.4 Million Acre Feet

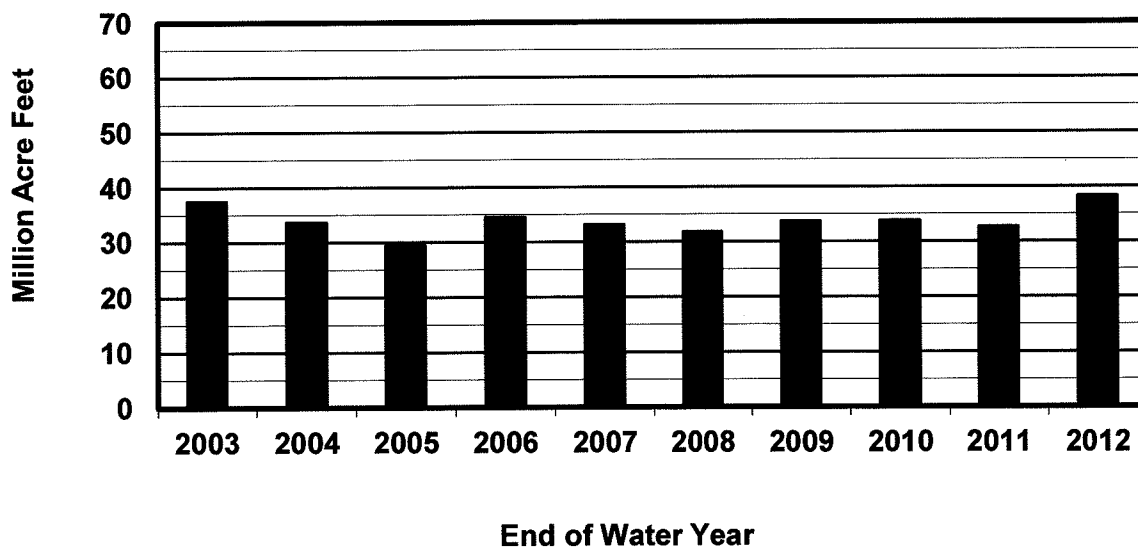

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

In addition to net deliveries through member agencies, MWD, pursuant to a Court Order, imported 466 acre feet of water into the Santa Margarita River Watershed for irrigation of lands in Domenigoni Valley during 2011-12.

Water is also imported into the Santa Margarita River Watershed from adjacent watersheds. Such importation occurs from the Santa Ana Watershed where Elsinore Valley MWD delivers water to a portion of its service area that is inside the Santa Margarita River Watershed. Elsinore Valley MWD obtains its supply from imports or from wells outside the Santa Margarita River Watershed.

At Camp Pendleton there is a pipeline connection to wells located in the Las Flores Creek Watershed to the north of the Santa Margarita River Watershed. Water can be either imported or exported through that line, depending on relative water demands and pumping capacities.

Exportations from the Santa Margarita River Watershed include water pumped at Camp Pendleton that is used in the San Luis Rey River Watershed to the south or in the Las Flores Creek Watershed to the north. The wastewater that is derived from the exported fresh water is returned to the Watershed for treatment at the Southern Region Tertiary Treatment Plant. Reclaimed wastewater is used for irrigation both within and outside the Watershed. Treated wastewater in excess of reclaimed use is exported for discharge at the Oceanside Outfall. Wastewater from the Fallbrook area and the Naval Weapons Station is exported by the Fallbrook Public Utility District and wastewater in the Elsinore Valley MWD is exported by Elsinore Valley MWD. Rancho California WD exports water into the San Mateo Creek Watershed.

Eastern MWD uses a 24-inch pipeline along Winchester Road to transport wastewater from the Temecula Valley Regional Water Reclamation Facility to areas within the Watershed for reuse as well as for export of up to 10 MGD from the Watershed. Eastern MWD uses a second, 48-inch pipeline along Palomar Valley for delivery of reclaimed wastewater for reuse and export from the Watershed. Rancho California WD also uses the Palomar Valley pipeline for exporting wastewater from the Watershed. The exported wastewater can be reused outside the Watershed, delivered to storage facilities or discharged to Temescal Creek. In 2011-12, Eastern MWD's export of wastewater that was discharged to Temescal Creek was 285 acre feet. Rancho California WD had no export of wastewater for discharge to Temescal Creek in 2012.

The following paragraphs of this report describe imports and exports during Water Year 2011-12 and during the period 1966-2012. There is also discussion of MWD's Lake Skinner and Diamond Valley Lake operations.

5.2 Water Year 2011-12

During 2011-12, a total of 75,440 acre feet of water of net imported supplies were distributed for use in the Santa Margarita River Watershed. This compares with 71,029 acre feet in 2010-11 and represents an increase of approximately six percent. The term net imports is used because several entities report gross imports into the Santa Margarita River Watershed but due to system configurations and operations, a portion of the gross imports may be transported to serve areas outside of the Watershed. Thus, the net imports reflect the quantities of imported supplies used within the Santa Margarita River Watershed. Net imports into the Santa Margarita River Watershed are listed on Table 5.2 for Water Year 2011-12.

The water exported from the Santa Margarita River Watershed for 2011-12 primarily includes wastewater except for Camp Pendleton and Rancho California WD. As described in Section 7, Camp Pendleton exports native water for use outside the Watershed. Also, Rancho California WD exports groundwater as part of a blended water supply to serve customers in the San Mateo Watershed. Exports from the Santa Margarita River Watershed for 2011-12 were 18,898 acre feet as shown on Table 5.2. This compares to 18,797 acre feet in 2010-11 and represents an increase of about one percent.

The quality of the water supplies imported through the MWD system in 2011-12 is indicated by the average monthly total dissolved solids at the Skinner Treatment Plant effluent line as shown on Table 5.3. The table also shows the percent of imported water obtained from the SWP. Water imported by Elsinore Valley MWD has the same quality as the MWD system.

5.3 Water Years 1966-2012

Water quantities imported by districts into the Santa Margarita River Watershed during Water Years 1966-2012 are shown on Table 5.4. Total imports to these districts are measured; however some districts serve lands outside the Watershed. For these districts, which include Eastern MWD, Elsinore Valley MWD, Fallbrook PUD and Rainbow MWD, the portion delivered in the Santa Margarita River Watershed must be estimated.

Review of the historical trend of total imports shown on Table 5.4 indicates significant year-to-year variations with relatively low imports in wet years and higher imports in dry years, combined with an underlying growth rate to serve increasing municipal water demands in the Murrieta-Temecula area.

SANTA MARGARITA RIVER WATERSHED IMPORTS/EXPORTS

Quantities in Acre Feet

NET IMPORTS										EXPORTS 3/																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																									
-----CAMP PENDLETON-----																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																			
YEAR MONTH	ELSI MORE VALLEY			FALLBROOK			MURRIETA DIVISION			U.S. NAVAL			WASTEWATER			NET EXPORT			U.S. NAVAL			FALLBROOK			RANCHO CALWD			TOTAL EXPORTS																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																							
	EASTERN MWD	VALLEY MWD		RAINBOW MWD	RANCHO CALWD	U.S. NAVAL	WESTERN MWD	WESTERN MWD	2/ MWD	TOTAL IMPORTS	4/ IMPORTS	5/ RETURNS	NET EXPORT	U.S. NAVAL	6/ MWD	VALLEY MWD	PUD	7/ MWD	8/ MWD	9/ MWD	10/ MWD	11/ MWD	12/ MWD	13/ MWD	14/ MWD	15/ MWD	16/ MWD	17/ MWD	18/ MWD	19/ MWD	20/ MWD	21/ MWD	22/ MWD	23/ MWD	24/ MWD	25/ MWD	26/ MWD	27/ MWD	28/ MWD	29/ MWD	30/ MWD	31/ MWD	32/ MWD	33/ MWD	34/ MWD	35/ MWD	36/ MWD	37/ MWD	38/ MWD	39/ MWD	40/ MWD	41/ MWD	42/ MWD	43/ MWD	44/ MWD	45/ MWD	46/ MWD	47/ MWD	48/ MWD	49/ MWD	50/ MWD	51/ MWD	52/ MWD	53/ MWD	54/ MWD	55/ MWD	56/ MWD	57/ MWD	58/ MWD	59/ MWD	60/ MWD	61/ MWD	62/ MWD	63/ MWD	64/ MWD	65/ MWD	66/ MWD	67/ MWD	68/ MWD	69/ MWD	70/ MWD	71/ MWD	72/ MWD	73/ MWD	74/ MWD	75/ MWD	76/ MWD	77/ MWD	78/ MWD	79/ MWD	80/ MWD	81/ MWD	82/ MWD	83/ MWD	84/ MWD	85/ MWD	86/ MWD	87/ MWD	88/ MWD	89/ MWD	90/ MWD	91/ MWD	92/ MWD	93/ MWD	94/ MWD	95/ MWD	96/ MWD	97/ MWD	98/ MWD	99/ MWD	100/ MWD	101/ MWD	102/ MWD	103/ MWD	104/ MWD	105/ MWD	106/ MWD	107/ MWD	108/ MWD	109/ MWD	110/ MWD	111/ MWD	112/ MWD	113/ MWD	114/ MWD	115/ MWD	116/ MWD	117/ MWD	118/ MWD	119/ MWD	120/ MWD	121/ MWD	122/ MWD	123/ MWD	124/ MWD	125/ MWD	126/ MWD	127/ MWD	128/ MWD	129/ MWD	130/ MWD	131/ MWD	132/ MWD	133/ MWD	134/ MWD	135/ MWD	136/ MWD	137/ MWD	138/ MWD	139/ MWD	140/ MWD	141/ MWD	142/ MWD	143/ MWD	144/ MWD	145/ MWD	146/ MWD	147/ MWD	148/ MWD	149/ MWD	150/ MWD	151/ MWD	152/ MWD	153/ MWD	154/ MWD	155/ MWD	156/ MWD	157/ MWD	158/ MWD	159/ MWD	160/ MWD	161/ MWD	162/ MWD	163/ MWD	164/ MWD	165/ MWD	166/ MWD	167/ MWD	168/ MWD	169/ MWD	170/ MWD	171/ MWD	172/ MWD	173/ MWD	174/ MWD	175/ MWD	176/ MWD	177/ MWD	178/ MWD	179/ MWD	180/ MWD	181/ MWD	182/ MWD	183/ MWD	184/ MWD	185/ MWD	186/ MWD	187/ MWD	188/ MWD	189/ MWD	190/ MWD	191/ MWD	192/ MWD	193/ MWD	194/ MWD	195/ MWD	196/ MWD	197/ MWD	198/ MWD	199/ MWD	200/ MWD	201/ MWD	202/ MWD	203/ MWD	204/ MWD	205/ MWD	206/ MWD	207/ MWD	208/ MWD	209/ MWD	210/ MWD	211/ MWD	212/ MWD	213/ MWD	214/ MWD	215/ MWD	216/ MWD	217/ MWD	218/ MWD	219/ MWD	220/ MWD	221/ MWD	222/ MWD	223/ MWD	224/ MWD	225/ MWD	226/ MWD	227/ MWD	228/ MWD	229/ MWD	230/ MWD	231/ MWD	232/ MWD	233/ MWD	234/ MWD	235/ MWD	236/ MWD	237/ MWD	238/ MWD	239/ MWD	240/ MWD	241/ MWD	242/ MWD	243/ MWD	244/ MWD	245/ MWD	246/ MWD	247/ MWD	248/ MWD	249/ MWD	250/ MWD	251/ MWD	252/ MWD	253/ MWD	254/ MWD	255/ MWD	256/ MWD	257/ MWD	258/ MWD	259/ MWD	260/ MWD	261/ MWD	262/ MWD	263/ MWD	264/ MWD	265/ MWD	266/ MWD	267/ MWD	268/ MWD	269/ MWD	270/ MWD	271/ MWD	272/ MWD	273/ MWD	274/ MWD	275/ MWD	276/ MWD	277/ MWD	278/ MWD	279/ MWD	280/ MWD	281/ MWD	282/ MWD	283/ MWD	284/ MWD	285/ MWD	286/ MWD	287/ MWD	288/ MWD	289/ MWD	290/ MWD	291/ MWD	292/ MWD	293/ MWD	294/ MWD	295/ MWD	296/ MWD	297/ MWD	298/ MWD	299/ MWD	300/ MWD	301/ MWD	302/ MWD	303/ MWD	304/ MWD	305/ MWD	306/ MWD	307/ MWD	308/ MWD	309/ MWD	310/ MWD	311/ MWD	312/ MWD	313/ MWD	314/ MWD	315/ MWD	316/ MWD	317/ MWD	318/ MWD	319/ MWD	320/ MWD	321/ MWD	322/ MWD	323/ MWD	324/ MWD	325/ MWD	326/ MWD	327/ MWD	328/ MWD	329/ MWD	330/ MWD	331/ MWD	332/ MWD	333/ MWD	334/ MWD	335/ MWD	336/ MWD	337/ MWD	338/ MWD	339/ MWD	340/ MWD	341/ MWD	342/ MWD	343/ MWD	344/ MWD	345/ MWD	346/ MWD	347/ MWD	348/ MWD	349/ MWD	350/ MWD	351/ MWD	352/ MWD	353/ MWD	354/ MWD	355/ MWD	356/ MWD	357/ MWD	358/ MWD	359/ MWD	360/ MWD	361/ MWD	362/ MWD	363/ MWD	364/ MWD	365/ MWD	366/ MWD	367/ MWD	368/ MWD	369/ MWD	370/ MWD	371/ MWD	372/ MWD	373/ MWD	374/ MWD	375/ MWD	376/ MWD	377/ MWD	378/ MWD	379/ MWD	380/ MWD	381/ MWD	382/ MWD	383/ MWD	384/ MWD	385/ MWD	386/ MWD	387/ MWD	388/ MWD	389/ MWD	390/ MWD	391/ MWD	392/ MWD	393/ MWD	394/ MWD	395/ MWD	396/ MWD	397/ MWD	398/ MWD	399/ MWD	400/ MWD	401/ MWD	402/ MWD	403/ MWD	404/ MWD	405/ MWD	406/ MWD	407/ MWD	408/ MWD	409/ MWD	410/ MWD	411/ MWD	412/ MWD	413/ MWD	414/ MWD	415/ MWD	416/ MWD	417/ MWD	418/ MWD	419/ MWD	420/ MWD	421/ MWD	422/ MWD	423/ MWD	424/ MWD	425/ MWD	426/ MWD	427/ MWD	428/ MWD	429/ MWD	430/ MWD	431/ MWD	432/ MWD	433/ MWD	434/ MWD	435/ MWD	436/ MWD	437/ MWD	438/ MWD	439/ MWD	440/ MWD	441/ MWD	442/ MWD	443/ MWD	444/ MWD	445/ MWD	446/ MWD	447/ MWD	448/ MWD	449/ MWD	450/ MWD	451/ MWD	452/ MWD	453/ MWD	454/ MWD	455/ MWD	456/ MWD	457/ MWD	458/ MWD	459/ MWD	460/ MWD	461/ MWD	462/ MWD	463/ MWD	464/ MWD	465/ MWD	466/ MWD	467/ MWD	468/ MWD	469/ MWD	470/ MWD	471/ MWD	472/ MWD	473/ MWD	474/ MWD	475/ MWD	476/ MWD	477/ MWD	478/ MWD	479/ MWD	480/ MWD	481/ MWD	482/ MWD	483/ MWD	484/ MWD	485/ MWD	486/ MWD	487/ MWD	488/ MWD	489/ MWD	490/ MWD	491/ MWD	492/ MWD	493/ MWD	494/ MWD	495/ MWD	496/ MWD	497/ MWD	498/ MWD	499/ MWD	500/ MWD	501/ MWD	502/ MWD	503/ MWD	504/ MWD	505/ MWD	506/ MWD	507/ MWD	508/ MWD	509/ MWD	510/ MWD	511/ MWD	512/ MWD	513/ MWD	514/ MWD	515/ MWD	516/ MWD	517/ MWD	518/ MWD	519/ MWD	520/ MWD	521/ MWD	522/ MWD	523/ MWD	524/ MWD	525/ MWD	526/ MWD	527/ MWD	528/ MWD	529/ MWD	530/ MWD	531/ MWD	532/ MWD	533/ MWD	534/ MWD	535/ MWD	536/ MWD	537/ MWD	538/ MWD	539/ MWD	540/ MWD	541/ MWD	542/ MWD	543/ MWD	544/ MWD	545/ MWD	546/ MWD	547/ MWD	548/ MWD	549/ MWD	550/ MWD	551/ MWD	552/ MWD	553/ MWD	554/ MWD	555/ MWD	556/ MWD	557/ MWD	558/ MWD	559/ MWD	560/ MWD	561/ MWD	562/ MWD	563/ MWD	564/ MWD	565/ MWD	566/ MWD	567/ MWD	568/ MWD	569/ MWD	570/ MWD	571/ MWD	572/ MWD	573/ MWD	574/ MWD	575/ MWD	576/ MWD	577/ MWD	578/ MWD	579/ MWD	580/ MWD	581/ MWD	582/ MWD	583/ MWD	584/ MWD	585/ MWD	586/ MWD	587/ MWD	588/ MWD	589/ MWD	590/ MWD	591/ MWD	592/ MWD	593/ MWD	594/ MWD	595/ MWD	596/ MWD	597/ MWD	598/ MWD	599/ MWD	600/ MWD	601/ MWD	602/ MWD	603/ MWD	604/ MWD	605/ MWD	606/ MWD	607/ MWD	608/ MWD	609/ MWD	610/ MWD	611/ MWD	612/ MWD	613/ MWD	614/ MWD	615/ MWD	616/ MWD	617/ MWD	618/ MWD	619/ MWD	620/ MWD	621/ MWD	622/ MWD	623/ MWD	624/ MWD	625/ MWD	626/ MWD	627/ MWD	628/ MWD	629/ MWD	630/ MWD	631/ MWD	632/ MWD	633/ MWD	634/ MWD	635/ MWD	636/ MWD	637/ MWD	638/ MWD	639/ MWD	640/ MWD	641/ MWD	642/ MWD	643/ MWD	644/ MWD	645/ MWD	646/ MWD	647/ MWD	648/ MWD	649/ MWD	650/ MWD	651/ MWD	652/ MWD	653/ MWD	654/ MWD	655/ MWD	656/ MWD	657/ MWD	658/ MWD	659/ MWD	660/ MWD	661/ MWD	662/ MWD	663/ MWD	664/ MWD	665/ MWD	666/ MWD	667/ MWD	668/ MWD	669/ MWD	670/ MWD	671/ MWD	672/ MWD	673/ MWD	674/ MWD	675/ MWD	676/ MWD	677/ MWD	678/ MWD	679/ MWD	680/ MWD	681/ MWD	682/ MWD	683/ MWD	684/ MWD	685/ MWD	686/ MWD	687/ MWD	688/ MWD	689/ MWD	690/ MWD	691/ MWD	692/ MWD	693/ MWD	694/ MWD	695/ MWD	696/ MWD	697/ MWD	698/ MWD	699/ MWD	700/ MWD	701/ MWD	702/ MWD	703/ MWD	704/ MWD	705/ MWD	706/ MWD	707/ MWD	708/ MWD	709/ MWD	710/ MWD	711/ MWD	712/ MWD	713/ MWD	714/ MWD	715/ MWD	716/ MWD	717/ MWD	718/ MWD	719/ MWD	720/ MWD	721/ MWD	722/ MWD	723/ MWD	724/ MWD	725/ MWD	726/ MWD	727/ MWD	728/ MWD	729/ MWD	730/ MWD	731/ MWD	732/ MWD	733/ MWD	734/ MWD	735/ MWD	736/ MWD	737/ MWD	738/ MWD	739/ MWD	740/ MWD	741/ MWD	742/ MWD	743/ MWD	744/ MWD	745/ MWD	746/ MWD	747/ MWD	748/ MWD	749/ MWD	750/ MWD	751/ MWD	752/ MWD	753/ MWD	754/ MWD	755/ MWD	756/ MWD	757/ MWD	758/ MWD	759/ MWD	760/ MWD	761/ MWD	762/ MWD	763/ MWD	764/ MWD	765/ MWD	766/ MWD	767/ MWD	768/ MWD	769/ MWD	770/ MWD	771/ MWD	772/ MWD	773/ MWD	774/ MWD	775/ MWD	776/ MWD	777/ MWD	778/ MWD	779/ MWD	780/ MWD	781/ MWD	782/ MWD	783/ MWD	784/ MWD	785/ MWD	786/ MWD	787/ MWD	788/ MWD	789/ MWD	790/ MWD	791/ MWD	792/ MWD	793/ MWD	794/ MWD	795/ MWD	796/ MWD	797/ MWD	798/ MWD	799/ MWD	800/ MWD	801/ MWD	802/ MWD	803/ MWD	804/ MWD	805/ MWD	806/ MWD	807/ MWD	808/ MWD	809/ MWD	810/ MWD	811/ MWD	812/ MWD	813/ MWD	814/ MWD	815/ MWD	816/ MWD	817/ MWD	818/ MWD	819/ MWD	820/ MWD	821/ MWD	822/ MWD	823/ MWD	824/ MWD	825/ MWD	826/ MWD	827/ MWD	828/ MWD	829/ MWD	830/ MWD	831/ MWD	832/ MWD	833/ MWD	834/ MWD	835/ MWD	836/ MWD	837/ MWD	838/ MWD	839/ MWD	840/ MWD	841/ MWD	842/ MWD	843/ MWD	844/ MWD	845/ MWD	846/ MWD	847/ MWD	848/ MWD	849/ MWD	850/ MWD	851/ MWD	852/ MWD	853/ MWD	854/ MWD	855/ MWD	856/ MWD	857/ MWD	858/ MWD	859/ MWD	860/ MWD	861/ MWD	862/ MWD	863/ MWD	864/ MWD	865/ MWD	866/ MWD	867/ MWD	868/ MWD	869/ MWD	870/ MWD	871/ MWD	872/ MWD	873/ MWD	874/ MWD	875/ MWD	876/ MWD	877/ MWD	878/ MWD	879/ MWD	880/ MWD	881/ MWD	882/ MWD	883/ MWD	884/ MWD	885/ MWD	886/ MWD	887/ MWD	888/ MWD	889/ MWD	890/ MWD	891/ MWD	892/ MWD	893/ MWD	894/ MWD	895/ MWD	896/ MWD	897/ MWD	898/ MWD	899/ MWD	900/ MWD	901/ MWD	902/ MWD	903/ MWD	904/ MWD	905/ MWD	906/ MWD	907/ MWD	908/ MWD	909/ MWD	910/ MWD	911/ MWD	912/ MWD	913/ MWD	914/ MWD	915/ MWD	916/ MWD	917/ MWD	918/ MWD	919/ MWD	920/ MWD	921/ MWD	922/ MWD	923/ MWD	924/ MWD	925/ MWD	926/ MWD	927/ MWD	928/ MWD	929/ MWD	930/ MWD	931/ MWD	932/ MWD	933/ MWD	934/ MWD	935/ MWD	936/ MWD

7/ Includes groundwater used in San Mateo Watershed and wastewater exported via Palomar Valley pipeline.

TABLE 5.3

**SANTA MARGARITA RIVER WATERSHED
TOTAL DISSOLVED SOLIDS
CONCENTRATION OF IMPORTED WATER**

YEAR MONTH	TOTAL DISSOLVED SOLIDS MG/L 1/		PERCENT STATE PROJECT WATER 2/	
	<u>2010-11</u>	<u>2011-12</u>	<u>2010-11</u>	<u>2011-12</u>
OCT	489	302	30	71
NOV	496	269	33	79
DEC	486	261	35	81
JAN	456	264	36	76
FEB	406	329	51	73
MAR	424	344	45	74
APR	451	386	40	66
MAY	429	447	43	51
JUNE	416	459	46	43
JULY	376	442	54	46
AUG	333	398	56	54
SEPT	317	386	67	56

1/ As measured in the Skinner Treatment Effluent line.

2/ Skinner Plant treated a blend of California State Project Water and Colorado River water.

TABLE 5.4

SANTA MARGARITA RIVER WATERSHED

IMPORTS/EXPORTS

Quantities in Acre Feet

NET IMPORTS

EXPORTS

WATER YEAR	EASTERN MWD	ELSINORE VALLEY MWD	FALLBROOK PUD 1/	MURRIETA DIVISION WESTERN MWD 2/	RANCHO CAL VAL MWD 3/	U.S. NAVAL WS	WESTERN MWD 4/	TOTAL IMPORTS	CAMP PENDLETON		NET EXPORT	U.S. NAVAL WS	EASTERN MWD	ELSINORE VALLEY MWD		FALLBROOK PUD	RANCHO CAL VAL EXPORTS 7/	TOTAL EXPORTS
									WASTEWATER RETURNS	EXPORTS								
1966	1,604	N/R	3,351	0	0	0	24	6,287	3,251	974	2,277	0	0	0	0	0	2,277	
1967	1,630	N/R	2,852	0	0	0	20	5,597	3,180	1,243	1,937	0	0	0	0	0	1,937	
1968	1,464	N/R	3,423	0	0	0	27	6,291	3,368	1,214	2,154	0	0	0	0	0	2,154	
1969	1,741	N/R	2,837	0	0	0	25	5,856	3,276	1,170	2,106	0	0	0	0	0	2,106	
1970	1,417	N/R	3,538	0	0	0	31	6,675	3,099	1,113	2,696	0	0	0	0	0	2,696	
1971	1,383	N/R	3,405	0	0	76 E	34	6,548	3,527	1,090	2,437	0	0	0	0	0	2,437	
1972	1,470	N/R	3,916	0	0	115 E	34	7,572	3,543	1,168	2,375	0	0	0	0	0	2,375	
1973	1,533	N/R	3,210	0	0	115 E	30	6,504	3,544	1,187	2,357	0	0	0	0	0	2,357	
1974	1,601	N/R	3,967	0	0	115 E	36	7,768	3,532	1,140	2,392	0	0	0	0	0	2,392	
1975	1,969	N/R	3,597	0	0	115 E	34	6,962	3,098	1,530	1,568	0	0	0	0	0	1,568	
1976	2,493	N/R	4,627	0	0	115 E	35	9,628	3,619	1,497	2,122	0	0	0	0	0	2,122	
1977	2,947	N/R	5,212	0	0	115 E	24	12,486	3,194	1,416	1,778	0	0	0	0	0	1,778	
1978	2,551	569	5,202	0	0	115 E	26	16,425	3,071	1,283	1,788	0	0	0	0	0	1,788	
1979	1,894	712	5,723	0	0	115 E	24	17,824	4,756	1,427	3,329	0	0	0	0	0	3,329	
1980	1,192	696	6,404	0	0	115 E	25	21,047	3,651	1,405	2,246	0	0	0	0	0	2,246	
1981	716	798	8,543	0	0	115 E	34	28,642	3,892	1,249	2,643	0	0	0	0	0	2,643	
1982	1,112	678	7,079	0	0	115 E	34	24,856	3,761	1,273	2,488	0	0	0	0	0	2,488	
1983	1,211	658	6,720	0	0	115 E	26	16,672	3,000	1,242	1,758	26 E	0	0	0	1,003	2,787	
1984	699	816	8,506	0	0	115 E	26	19,946	3,243	1,120	2,123	26 E	0	0	0	1,032	3,181	
1985	679	808	7,831	0	0	115 E	27	20,015	3,377	1,200	2,177	26 E	0	0	0	1,060	3,263	
1986	760	882	8,585	0	0	115 E	34	24,474	3,326	981	2,345	16 P	0	0	0	1,096	3,457	
1987	1,155	938	8,656	0	0	115 E	36	21,855	3,444	1,799	1,645	26	0	4	0	1,129	2,805	
1988	2,047	1,032	8,033	0	0	115 E	36	32,108	3,457	1,872	1,585	26	0	55	0	1,154	2,820	
1989	3,746	1,341	9,066	0	0	115 E	23	40,202	3,418	1,446	1,972	23	0	74	0	1,181	3,250	
1990	5,601	2,255	10,103	0	0	115 E	22	43,974	2,971	1,451	1,520	27	0	114	0	1,271	2,932	
1991	9,479	2,421	7,962	0	0	115 E	21	44,134	2,168	1,219	949	13	0	134	0	960	2,056	
1992	8,593	2,190	7,893	0	0	115 E	25	38,008	2,426	1,548	878	7	0	140	0	1,083	2,108	
1993	5,393	1,914	6,925	0	0	115 E	31	27,756	2,329	1,926	403	16	705	150	1,255	2,529		
1994	7,150	3,221	7,250	0	0	115 E	37	35,768	2,702	1,501	1,201	5	3,159	170	1,068	5,603		
1995	4,625	3,117	6,538	547	0	125	39	31,750	2,781	1,611	1,170	12	3,908	185	1,153	6,428		
1996	4,960	4,181	7,993	1,005	0	100	35	43,689	3,577	1,493	2,084	5	2,993	213	1,035	6,330		
1997	3,284	4,283	7,894	3,521	0	109	30	47,542	3,643	1,932	1,711	6	3,201	226	1,021	6,165		
1998	5,117	5,100	6,382	5,023	0	97	31	42,935	3,742	2,073	1,669	8	4,513	247	1,482	7,919		
1999	4,327	6,134	7,430	3,781	0	111	41	58,041	3,558	2,130	1,428	5	4,133	254	1,377	7,197		
2000 R	7,256	7,172	9,365	712	0	104	42	82,277	4,072	2,115	1,957	7	3,649	279	1,419	7,311		
2001 R	5,948	6,592	8,398	689	0	73	59	65,386	3,653	2,075	1,578	8	4,457	310	1,392	7,745		
2002 R	8,117	7,596	9,580	595	0	97	64	81,873	3,701	1,950	1,751	9	5,325	412	1,225	8,722		
2003 R	9,062	7,091	9,130	495	102	88	42	78,264	3,767	1,688	2,079	10	7,636	483	1,359	64 11,631		
2004 R	9,138	8,438	11,749	766	330	73	50	94,840	4,951	0	4,951	8	9,115	600	1,329	312 16,315		
2005 R	10,858	8,215	8,108	556	75	40	62	77,138	4,625	0	4,625	16	11,676	927	1,417	1,574 20,235		
2006 R	14,161	9,819	10,573	506	316	64	66	97,967	4,912	0	4,912	8	10,906	938	1,395	1,379 19,538		
2007 R	15,398	10,811	12,292	660	723	70	45	106,079	5,152	0	5,152	12	10,553	837	891	364 17,809		
2008 R	14,952	9,951	8,920	493	2,180	82	54	89,105	4,774	0	4,774	11	12,789	901	799	361 19,635		
2009 R	14,472	9,075	8,557	607	1,654	74	51	86,612	5,362	1,119	4,243	12	12,027	1,069	829	367 18,547		
2010 R	13,552	7,926	7,183	385	1,462	69	62	72,986	5,143	1,075	4,068	7	11,829	1,120	926	318 18,268		
2011	14,392	7,425	6,234	336	1,642	45	52	71,029	5,516	1,441	4,075	8	12,381	1,130	901	302 18,797		
2012	15,063	7,398	7,254	466	1,371	48	48	75,440	5,595	1,672	3,923	9	12,550	1,205	928	283 18,898		

1/ Includes Deluz Heights MWD prior to 1991.
 2/ Metropolitan Water District direct deliveries in Domenigoni Valley plus miscellaneous maintenance releases beginning 2009.
 3/ For period 2003 to present values shown are net imports excluding imported water delivered to San Mateo Watershed.
 4/ Improvement District A - Rainbow Canyon Only (WR-13).
 5/ All exports are wastewater except as noted for Camp Pendleton and Rancho Cal W.D.
 6/ Includes export of native water plus wastewater from in-basin use.
 7/ Includes groundwater used in San Mateo Watershed and wastewater exported to Santa Ana Watershed.
 8/ Includes export of native water plus reclaimed wastewater.
 9/ Fallbrook PUD's total export data were revised in 2011 due to reporting methodology changes. In 2012, Fallbrook PUD's total SMRW import data were revised due to error in reporting Lake Skinner diversions delivered.

N/R - Not Reported
 P - Partial year data
 E - Estimate
 R - Revised

Exports over the 1966-2012 period are also shown on Table 5.4. These include estimated water exports on Camp Pendleton less estimated wastewater returns, as well as an estimate of exports by the Fallbrook Public Utility District and the Naval Weapons Station after 1983, and Elsinore Valley MWD after 1986. Exports by Eastern MWD were initiated in 1992-1993, and Rancho California WD began quantifying export of water in 2002-03. Exports do not include water that naturally flows from the Santa Margarita River into the Pacific Ocean.

5.4 Lake Skinner

Lake Skinner is a 44,000 acre foot reservoir constructed by MWD on Tualota Creek, within the Santa Margarita River Watershed. The purpose of Lake Skinner is to provide regulatory and emergency storage capacity for water imported to southern California. MWD does not have a water right to store or divert water in Lake Skinner. Accordingly, a Memorandum of Understanding and Agreement on Operation of Lake Skinner (MOU), dated November 12, 1974, approved by the Court on January 16, 1975, contains provisions to protect Santa Margarita River Watershed water users from potential effects of Lake Skinner on either subsurface or surface flows.

Protection against a decrease in subsurface flows caused by the dam is afforded by a provision in the MOU that requires that MWD release water from Lake Skinner into Tualota Creek if groundwater levels in Well AV-28B fall below an elevation of 1356.64 feet. At the end of September 30, 2012, the well level was 1359.10 feet, a decrease of 4.3 feet compared to September 30, 2011.

The MOU also provides that all local surface inflow that enters Lake Skinner will be released into Tualota Creek. In its 1980 modification, the MOU provides that local surface inflow is to be determined by using the hydrologic equation for Lake Skinner that is specified in the MOU. That equation is used to determine inflow and the related release for large flood events. However, in many years the local inflow is small compared to the large quantities of imported water inflow and outflow at Lake Skinner. The error of measurement for these large inflows and outflows is larger than the local inflow in many instances. Accordingly, MWD also monitors the flow in Tualota Creek, Rawson Creek and Middle Creek during storms and uses those observations to supplement the hydrologic equation.

On February 16, 2005, the Court approved an Order Amending the MOU to provide for diversion from Lake Skinner on Fallbrook PUD's behalf after specified releases are made, according to State Water Resource Control Board Permit 11356 and the amended Lake Skinner MOU. In 2011-12, no water was accumulated in Lake Skinner for diversion to Fallbrook PUD.

In 2011-12, MWD records show no local inflow to Lake Skinner and subsequently there were no required releases in accordance with the MOU.

5.5 Diamond Valley Lake

Diamond Valley Lake is located in Diamond and Domenigoni Valleys within the Santa Margarita River Watershed. The Lake was created by three dams, one each at the east and west ends of Domenigoni/Diamond Valley and a saddle dam at the low point on the north rim. The East Dam diverts surface and groundwater flows from a 4.2 square mile drainage area in the Santa Margarita River Watershed, known as Goodhart Canyon, into the Santa Ana River Watershed. The West Dam intercepts existing westward surface and subsurface flows from an additional 13.19 square mile area.

MWD does not have a water right to store local waters in the reservoir, so a Memorandum of Understanding and Agreement on Operation of Domenigoni Valley Reservoir (now known as Diamond Valley Lake) (MOU) was developed and approved by the Court on January 19, 1995. Among other things, the MOU provides:

The quantity and quality of surface runoff that would flow past the West Dam in the absence of the Reservoir will be determined and a like quantity of water of similar quality will be released from the Reservoir or San Diego Canal (SDC) into Warm Springs Creek.

The MOU indicates that the required releases would be determined by measuring the surface inflows into Goodhart Canyon Detention Basin. A quantity equal to 4.1 times the measured flow will be released into Warm Springs Creek.

There were no required releases into Warm Springs Creek during 2011-12.

Although all surface waters within the Santa Margarita River Watershed in Domenigoni Valley and Diamond Valley are subject to the continuing jurisdiction of the Court, groundwater contained within the younger alluvium, north of the south line of Section 9, Township 6 South, Range 2 West, SBM is not considered by the Court to be a part of the Santa Margarita River system as long as groundwater levels are below an elevation of 1400 feet. During 2011-12, groundwater elevations in Well MO-6, which is located along the south line of Section 9, decreased 4.72 feet from 1374.30 feet at the beginning of the water year to 1369.58 feet on October 2, 2012.

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

During 2011-12, there were no injections into the Domenigoni Valley groundwater basin pursuant to Agreements for Mitigation of Groundwater. However, pursuant to a Court Order, MWD imported 466 acre feet of water into the Santa Margarita River Watershed for irrigation of lands in Domenigoni Valley. As previously noted, the groundwater in the Domenigoni Valley groundwater basin is outside this Court's jurisdiction when groundwater levels are below an elevation of 1400 feet.

Page Intentionally Blank

SECTION 6 - WATER RIGHTS

6.1 General

Water is used in the Santa Margarita River Watershed under a variety of water rights. In the early 1960's, the U. S. District Court in its Interlocutory Judgments described water rights in the Watershed as primarily riparian rights and overlying rights. Riparian rights belong to owners of land parcels located adjacent to streams in the Watershed or overlying younger alluvium deposits generally along the stream channels. Overlying rights were divided by the Court into two categories based on the location where the water is obtained and used. Water extracted from lands where subsurface waters add to, contribute to and support the Santa Margarita River stream system was found to be subject to the continuing jurisdiction of the Court. Lands in this category were identified by the Court and listed in Interlocutory Judgments. In general, these parcels of land overlie younger or older alluvium deposits. The Court has stated that the issue of apportionment of water rights has not been presented to the Court, but the Court would litigate the apportionment if and when in the future it becomes necessary to do so.

The other category of overlying use applies to parcels of land where subsurface flows do not add to, contribute to or support the Santa Margarita River stream system. These parcels were also identified by the Court and found to be outside the continuing jurisdiction of the Court. In general, these lands overlie basement complex or residuum deposits.

The Court also described a number of other rights in the Watershed. These included surface water appropriative water rights that have been administered by the State of California since 1914. These rights are discussed in the following subsection of this report.

In Interlocutory Judgment No. 41, the Court found that the United States reserved rights to the use of the waters of the Santa Margarita River stream system which under natural conditions would be physically available on the Cahuilla, Pechanga and Ramona Indian Reservations, including rights to the use of groundwater, sufficient for the present and future needs of the Indians residing thereon. In Interlocutory Judgment No. 44, the Court recognized and reserved water rights for lands within the Cleveland and San Bernardino National Forests and for lands being administered pursuant to the Taylor Grazing Act.

Since the early 1960's, there have been substantial changes in water use in the Watershed, especially in the Murrieta-Temecula Groundwater Area. During the 1950's and early 1960's, when this case was under active litigation, most of the water use in the Murrieta-Temecula area consisted of individual property owners pumping water for use on their own properties. In 1965, the Rancho California WD was formed. The District developed Agency Agreements with most of the landowners within the District. In these

Agency Agreements, the landowners "...without transferring any water rights and privileges pertaining to said land..." designated the District as their exclusive agent for the development and management of their water supply.

Thus, many landowners within the Rancho California WD are not exercising their overlying rights. Instead, Rancho California WD pumps groundwater and uses it throughout the District area as agent on behalf of the landowners.

Rancho California WD also pumps water as a groundwater appropriator along with Western Municipal Water District within its Murrieta Division.

Another change from the early 1960's is the large scale importation of water into the Santa Margarita River Watershed by Rancho California WD. A portion of such importation finds its way into the groundwater aquifers. The legal status of return flows from imported supplies as well as direct recharge of imported water was clarified by the final judgment in *City of Los Angeles v. City of San Fernando, et al.*, 1975 14 Cal.3d 199. This decision in the Supreme Court of the State of California made two major findings with respect to imported water.

The first was that agencies have the right to recharge and store imported water in a groundwater basin and to extract the imported water for use, subject to applicable state and federal laws. In addition, agencies that import and deliver water to lands overlying a groundwater basin have a continuing right to extract the return flow from such water. The return flow is that portion of the imported supply that percolates into the groundwater basin. In the San Fernando case this portion was found to range from 20 percent to 35.7 percent of the imported supplies.

The Rancho Division of the Rancho California WD overlies the Murrieta-Temecula Groundwater Area. Thus a portion of the import supply delivered to the Rancho Division of Rancho California WD percolates into the underlying aquifers.

Imported water is also supplied to the Santa Rosa Division within Rancho California WD, however only a relatively small part of this division overlies the Murrieta-Temecula Groundwater Area. Thus there is less imported water return flow from the Santa Rosa Division.

Classification of Rancho California WD supplies into various water right categories is discussed in Section 7 of this Report.

Camp Pendleton representatives contend that the Court has jurisdiction over imported water to the full extent that imported water, as well as its use, its returns and its products, affects in any significant manner the water rights within the Watershed over which the Court has traditionally asserted its jurisdiction. Other parties dispute the Court's jurisdiction over imported water.

6.2 Appropriative Surface Water Rights

Another broad category of water rights used in the Watershed is surface water appropriative rights. Since 1914, these rights have been administered by the SWRCB.

A list of current permits, licenses and other active rights obtained from the SWRCB is shown on Table 6.1. A permit by the SWRCB authorizes water diversion, sets terms for the water project's completion and development of water use, and may impose other conditions. After the permittee demonstrates that construction is complete, water is being put to use and the permit conditions have been met, the SWRCB can issue a license. The license remains in effect as long as the license conditions are met and the water is put to beneficial use.

Active direct diversion rights and storage rights from creeks in the Watershed are summarized below:

	<u>Direct Diversions</u> <u>Gallons Per Day</u>	<u>Storage</u> <u>Acre Feet</u>
Cahuilla Valley	720	5
Cottonwood Creek	485,000	60
Cutca Creek	5,825	---
DeLuz Creek	4,700	100
Fern Creek	213,000	100
Kohler Canyon	158,000	40
Long Canyon Spring	89	---
Rainbow Creek	---	0.5
Rattlesnake Canyon	12,000	---
Temecula Creek	13,050	40,000
Tucalota Creek	---	10,000
Sandia Canyon	---	8
Sourdough Spring	55	---
Santa Margarita River	96,730	4,000
Nelson Creek	<u>1,550</u>	<u>---</u>
TOTAL	990,719	54,313.5

These direct diversion rights of 990,719 gallons per day correspond to 1.53 cfs or 3.04 acre feet per day.

**WATERMASTER
SANTA MARGARITA RIVER WATERSHED**

TABLE 6.1

**SANTA MARGARITA RIVER WATERSHED
APPROPRIATIVE WATER RIGHTS
PERMITS AND LICENSES**

APPLICATION I.D.	OWNER	FILING DATE	SOURCE OF WATER	POINT OF DIVERSION	AMOUNT	USE	STATUS
A006629	William H. & Sandra J. Cyrus	4/9/30	Coahuila Valley	Sec. 4, 7S, 3E	DD-720 gpd	D	License
A007035	Nyla Lawler Trust	8/10/31	Cutca Creek	Sec. 29, 9S, 1E	DD-5725 gpd	D/I	License
A009137	JR SA, LLC	10/07/37	Temecula Creek	Sec. 12, 9S, 1E	DD-400 gpd	D	License
A009291	Richard W. Long	5/13/38	Nelson Creek	Sec. 23, 8S, 5W	DD-1550 gpd	D	License
A010806	James R., Phyllis & Bruce Grammer	4/22/44	Temecula Creek	Sec. 34, 9S, 2E	DD-2880 gpd	D	License
A011161	Roy C. Pursche & Barbara Booth	9/26/45	Rattlesnake Canyon	Sec. 28, 9S, 2E	DD-12,000 gpd	D/I	License
A011518	Rancho California Water District	8/16/46	Temecula Creek	Sec. 10, 8S, 1W	ST-40,000 AF	D//IN/M/R	Permit
A011587	U. S. Bureau of Reclamation	10/11/46	Santa Margarita River	Sec. 12, 9S, 4W	ST-10,000 AF	D//I/M	Permit
A012178	Fallbrook Public Utility District	11/28/47	Tucalota Creek	Sec. 3, 7S, 2W	ST-10,000 AF	D//I/M	Permit
A012179	U. S. Bureau of Reclamation	11/28/47	Santa Margarita River	Sec. 12, 9S, 4W	ST-10,000 AF	D//I/M	Permit
A013505	Robert R. Baum	12/12/49	Cottonwood Creek	Sec. 30, 8S, 4W	DD-0.75 cfs & ST-42 AF	R/S	License
A017239	Nancy A. Wiley	8/15/56	Temecula Creek	Sec. 20, 9S, 2E	DD-120 gpd	D/E	License
A020507	Robert R. Baum	11/24/61	Cottonwood Creek	Sec. 19, 8S, 4W	ST-18 AF	I/R	License
A020608	Pete and Dorothy Prestininzi	2/13/62	DeLuz Creek	Sec. 30, 8S, 4W	ST-100 AF	D//R	License
A020742	U. S. Cleveland National Forest	4/24/62	Sourdough Spring	Sec. 25, 9S, 1E	DD-55 gpd	E	License
A021074	U. S. Cleveland National Forest	12/07/62	Cutca Spring	Sec. 17, 9S, 1E	DD-100 gpd	S/W	License
A021471A	U. S. Department of Navy	9/23/63	Santa Margarita River	Sec. 5, 10S, 4W	ST-4,000 AF	D//I/M/Z	License
A021471B	U. S. Bureau of Reclamation	9/23/63	Santa Margarita River	Sec. 2, 11S, 5W	ST-165,000 AF	D//I/M/Z	Permit
A027756	James R. Grammer	5/23/83	Temecula Creek	Sec. 3, 10S, 2E	DD-9,650 gpd	I/W	License
A028133	B&E Inv., Inc.	5/14/84	Cahuilla Creek	Sec. 15, 8S, 2E	ST-5AF	E/H/I/R/S	Permit

OTHER RIGHTS

F005751S*	U. S. Cleveland National Forest	1/01/70	Long Canyon Spring	Sec. 16, 9S, 1E	DD-89 gpd	E/R/S/W
S000024**	Judge Dial Perkins	12/26/86	Santa Margarita River	Sec. 12, 9S, 4W	DD-133.3 gpd	D
S000751**	Lawrence Butler	5/31/67	Fern Creek	Sec. 31, 8S, 4W	DD-0.33 cfs	I
S011411**	Agri Empire, Inc.	5/16/84	Kohler Canyon	Sec. 33, 9S, 2E	ST-100 AF DD-0.245 cfs	I/S
S012235**	Lenny F. Kuszmaui	8/27/85	DeLuz Creek	Sec. 4, 9S, 4W	ST-40 AF DD-4700 gpd	D/I
S014009**	San Diego State University	6/7/93	Santa Margarita River	Sec. 27, 8S, 3W	DD-0.15 cfs	D//I/Z
001583***	George F. Yackey	12/27/77	Sandia Canyon	Sec. 25, 8S, 4W	ST-8.0 AF	S
002380***	Chris R. & Jeanette L. Duarte	12/16/77	Rainbow Creek	Sec. 12, 9S, 3W	ST-0.5 AF	S

KEY TO USE: DD - Direct Diversion D - Domestic R - Recreation E - Fire Protection H - Fish Culture
ST - Diversion to Storage I - Irrigation M - Municipal S - Stockwatering Z - Other
IN - Industrial W - Fish & Wildlife Protection and/or Enhancement

NOTES: * Federal Filing ** Statement of Diversion and Use *** Stock Filing

Storage rights shown in Table 6.1 include 185,000 acre feet of storage rights on the Santa Margarita River held by the U. S. Bureau of Reclamation (ID Nos. 11587, 12179, and 21471B) that have not been exercised. The deadline for exercising these rights is currently set at December 31, 2008. On November 14, 2008, the U. S. Bureau of Reclamation filed petitions for time extensions for completion of beneficial use under the three permits. On September 14, 2009, change petitions were filed to amend the permits to conform to the Santa Margarita Conjunctive Use Project being developed jointly by the U. S. Bureau of Reclamation, Department of the Navy Marine Corps Base Camp Pendleton, and Fallbrook Public Utility District. Those extension and change petitions have been accepted and in accordance with SWRCB Order 2009-0063-EXEC they are under consideration in tandem.

Table 6.1 also lists other rights recognized by the SWRCB. These rights generally are based on Statements of Water Diversion and Use that have been filed with the SWRCB. Such statements include one by the United States on behalf of the Cleveland National Forest, which states that the diversion and use of water from Long Canyon Spring is made pursuant to a withdrawal and reservation of the land and resources for National Forest System purposes as of February 14, 1907.

Besides the federal filing, there are also Statements of Water Diversion and Use filed by other entities. Four of these statements represent riparian or pre-1914 appropriative diversions from DeLuz Creek, Fern Creek and Santa Margarita River that have been reported to the SWRCB. The other statement represents a pre-1914 appropriative right to divert water from a spring in Kohler Canyon into a 40 acre foot reservoir.

The last two rights noted on Table 6.1 represent filings made in 1977 pursuant to Subchapter 2.5 to Chapter 3 of Title 23 of the California Code of Regulations. That subchapter deals with Water Rights for Stockponds.

In addition to appropriative rights under SWRCB jurisdiction, there are a number of nonstatutory appropriative rights that were established prior to 1914. These rights continue to be used to support diversions of water from the Santa Margarita River stream system. Such rights, which are listed in the various Interlocutory Orders developed in this litigation, are shown on Table 6.2.

In 1990-91, in Order No. 91-07, the SWRCB revised its Order No. 89-25 entitled, "Order Adopting Declaration of Fully Appropriated Stream Systems and Specifying Conditions for Acceptance of Applications and Registrations." These Orders list the Santa Margarita River stream system as fully appropriated "from the confluence of the Santa Margarita River and the Pacific Ocean upstream including all tributaries where hydraulic continuity exists."

**WATERMASTER
SANTA MARGARITA RIVER WATERSHED**

TABLE 6.2

**SANTA MARGARITA RIVER WATERSHED
PRE - 1914 APPROPRIATIVE WATER RIGHTS
Listed in Interlocutory Judgments**

INTERLOCUTORY JUDGMENT	LISTED OWNER	CURRENT OWNER	DATE OF APPROPRIATION	SOURCE OF WATER	POINT OF DIVERSION	AMOUNT	USE
NO. 32	Anderson, Nina B.	Poladian, Jacqueline	April 11, 1892	Fern Creek	NW 1/4 of SE 1/4 Sec 31, T8S, R4W	32 gpm	Irrigation
NO. 32	Butler, Lawrence W. and Mary C.	Vanginkel, Norman Tr and Vanginkel, Deborah Tr San Diego Gas & Electric	Sept. 23, 1896	Fern Creek	NW 1/4 of SE 1/4 Sec 31, T8S, R4W	Capacity of 8 inch pipe	Irrigation
NO. 32	Wilson, Samuel M. and Hazel A.	Shirley, Bobbie	Aug. 3, 1911	DeLuz Creek	NW 1/4 of SW 1/4 Sec 32, T8S, R4W	50 miner's inches 65 AF/Yr	Irrigation
NO. 24	United States	United States	1883	Santa Margarita River	Sec 5, T10S, R4W	20 cfs 1200 AF/Yr	Domestic Irrigation Stock Water

The consequences of this Order are as follows:

1. The Board is precluded from accepting any application to appropriate water from the Santa Margarita River System except where the proposed appropriation is consistent with conditions contained in the Declaration.
2. Initiation of a water right pursuant to the Water Rights Permitting Reform Act of 1988 (Water Code Section 1228 et seq.) --that is, by registering small use domestic appropriations--is precluded, except where the proposed appropriation is consistent with conditions contained in the Declaration. Small use domestic appropriations refer to uses that do not exceed direct diversions of 4,500 gallons per day or diversion by storage of 10 acre feet per year for incidental aesthetic, recreational, or fish and wildlife purposes.
3. Pursuant to Water Code Section 1206(a) the Board is authorized, but not required, to cancel pending applications where inconsistent with conditions contained in the Declaration; previous Orders implement a procedure for disposition of such applications pending on the effective date of the Declaration.

The Order provides for reconsideration of the Order either upon petition of an interested party or upon the Board's own motion.

6.3 Fallbrook PUD Changes of Point of Diversion and Place of Use for Permit No. 11356

On November 20, 2001, the Chief of the Division of Water Rights of the State Water Resources Control Board authorized an Order Approving Changes in Source Point of Diversion, Place of Use and Amending the Permit (No. 11356). The permit allows Fallbrook PUD to divert and store up to 10,000 acre feet per year at Lake Skinner. The Court approved an Order Amending the Memorandum of Understanding and Agreement on Operation of Lake Skinner on February 16, 2005. The Amendment provides for diversions from Lake Skinner after specified releases are made.

On December 18, 2009, Fallbrook PUD filed a petition for a time extension for completion of beneficial use under Permit No. 11356. The petition was accepted and noticed by the SWRCB on February 23, 2009, and no protests were filed.

On May 25, 2012, the SWRCB issued Order WR 2012-0007-EXEC with an amended Permit No. 11356 extending the time to apply the water to full beneficial use by December 31, 2048.

6.4 Federal Reserved Water Rights Claims by Cahuilla and Ramona Bands

On October 6, 2006, the Cahuilla Band of Indians filed a Motion to Intervene as Plaintiff-Intervenor in *United States of America v. Fallbrook Public Utility District, et al.* The Cahuilla Band also filed a Complaint asking the Court to quantify its federal reserved water rights by confirming elements of the water rights as declared and decreed by the Court in Interlocutory Judgment No. 41. On October 16, 2006, the Ramona Band of Cahuilla filed a similar motion and Complaint. On January 22, 2007, the Court issued an Order granting the Motions to Intervene and filing the Complaints in Intervention. On February 25, 2009, the Court ordered the Cahuilla Band and Ramona Band as plaintiffs to serve by April 30, 2009, all water right holders subject to the Court's jurisdiction within the entire Watershed. Service was completed and the parties commenced settlement negotiations. On April 1, 2009, the Cahuilla and Ramona Bands filed motions to dismiss claims against certain downstream defendants and to file second amended complaints to limit the claims to the Anza-Cahuilla Groundwater Area. On April 29, 2009, the Court issued an Order granting the motions. The parties are progressing with settlement negotiations and Court proceedings for quantification of each Band's federal reserved water rights based on the second amended complaints.

6.5 Federal Reserved Water Rights Claims by Pechanga Band

In 1974, the Pechanga Band of Luiseño Indians filed a Motion to intervene as a Plaintiff-Intervenor in *United States of America v. Fallbrook Public Utility District, et al.*, and in 1975 the Court granted the Motion. Rather than filing a complaint asking the Court to quantify its federal reserved water rights, the Pechanga Band is in the process of resolving its claims to water rights in the Santa Margarita River Watershed through a comprehensive settlement agreement with the United States and principal water districts, including Rancho California WD, Eastern MWD, and Metropolitan Water District. On December 17, 2009, Pechanga and Rancho California WD announced an agreement on a framework, developed with the assistance of Metropolitan Water District and the United States Federal Negotiating Team, to resolve Pechanga's water rights claims. On April 27, 2009, Pechanga and Rancho California WD agreed to a Settlement Conceptual Agreement and on June 11, 2009, the Rancho California WD Board approved the Settlement Conceptual Agreement. On November 16, 2009, the parties announced the Pechanga Water Rights Settlement Agreement was finalized. On December 11, 2009 and January 26, 2010, the Pechanga Indian Water Rights Settlement Act was introduced in the United States House of Representatives and Senate, respectively. The parties are now in the process of reintroducing legislation and finalizing agreements in anticipation of Congressional and Court approvals.

SECTION 7 - WATER PRODUCTION AND USE

7.1 General

Water production and use data were obtained from several types of substantial users including water purveyors, Indian Reservations, mobile home parks and private landowners. Private landowners who qualify as substantial water users are those who irrigate eight or more acres or who produce or use an equivalent quantity of water.

Major water purveyors, who reported production and use data in the 2011-12 Water Year, are listed as follows:

- Anza Mutual Water Company
- Eastern Municipal Water District
- Elsinore Valley Municipal Water District
- Fallbrook Public Utility District
- Lake Riverside Estates
- Metropolitan Water District of Southern California
- Rainbow Municipal Water District
- Rancho California Water District
- U. S. Marine Corps, Camp Pendleton
- U.S. Naval Weapons Station, Fallbrook Annex
- Western Municipal Water District

Lake Riverside Estates is listed with major water purveyors although it does not deliver water to customers. However it does produce make-up water for losses from Lake Riverside.

In addition to the major purveyors, there are a number of smaller water systems in the Watershed. Of these, Quiet Oaks Mobile Home Park, Jojoba Hills SKP Resort, Outdoor Resorts Rancho California, Inc., and Hawthorn Water System are substantial users.

Three Indian Reservations, the Cahuilla, Pechanga and Ramona, are noted in Interlocutory Judgment No. 41, the Judgment that deals with Water Rights on Indian Reservations in the Watershed. Estimates and/or measurements of water production and use are reported for the Cahuilla, Pechanga and Ramona Indian Reservations.

A portion of a fourth Reservation, the Pauma Mission Reserve Tract of the Pauma Yuima Band of Mission Indians, is also located within the Watershed. However, these lands overlie basement complex, which waters have been found by the Court to not add to, support or contribute to the Santa Margarita River stream system.

The final category of water users is private landowners who use water primarily for irrigation.

The water use data collected for the 2011-12 Water Year is summarized on Table 7.1. Total imported supplies plus local production totaled 115,324 acre feet compared to 113,866 acre feet reported in 2010-11. Of that quantity, 44,179 acre feet were used for agriculture; 10,512 acre feet were used for commercial purposes; 48,885 acre feet were used for domestic purposes; 32 acre feet were discharged to Murrieta Creek; 54 acre feet were discharged to Santa Gertrudis Creek; 3,470 acre feet were discharged by Rancho California WD during 2011-12, pursuant to the Cooperative Water Resource Management Agreement (CWRMA); 2,807 acre feet of fresh water were exported by Camp Pendleton; and 702 acre feet were recharged by Rancho California WD to storage. It is noted, the agriculture use for Pechanga includes 329 acre feet of reclaimed wastewater and thus this amount is double counted on Table 7.1 relative to production from the Santa Margarita River Watershed. Actual agriculture use of production from the Watershed is 43,850 acre feet, reflecting the reduction of 329 acre feet of reclaimed wastewater used by Pechanga. In order for the totals to balance on Table 7.1, the 329 acre feet of reclaimed water is subtracted from the indicated loss for Pechanga as reflected in Footnote 13 for Table 7.1.

The overall system loss was 4,818 acre feet. System gain or loss is the result of many factors including errors in measurement, differences between periods of use and periods of production, leakage and unmeasured uses.

Monthly production and use data for major water purveyors are attached to this report as Appendix A. Uses are listed under agricultural, ag/domestic, commercial and domestic categories. The definition of agricultural, ag/domestic, commercial and domestic uses varies for the different purveyors in the Watershed. Accordingly, definitions of these uses for major water purveyors are shown on Table 7.2. It is noted that much of the non-agricultural water use in the Watershed can also be considered municipal use, which includes both the domestic and commercial uses shown in tables in this report. Similar data for Water Years 1966-2012 are summarized in tables presented in Appendix B. Appendix C presents information on substantial users outside purveyor service areas.

7.2 Water Purveyors

Anza Mutual Water Company

Anza Mutual Water Company's service area is in the eastern part of the Watershed in the Anza Valley. Production is from two wells: Well No. 1 drilled in 1951 and perforated from 20 feet to 260 feet; and Well No. 2 drilled later to a depth of 287 feet and perforated in the bottom 130 feet. Production for 2011-12 was 26.22 acre feet from Well No. 1 as shown on Appendix Table A-11. Well No. 2 was not in use for 2011-12. Water levels in Well No. 1 declined 35 feet from last year.

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE 7.1
SANTA MARGARITA RIVER WATERSHED
WATER PRODUCTION AND USE
2011-12
Quantities in Acre Feet

	PRODUCTION				USE				
	WELL/ SURFACE	IMPORT	TOTAL	AG	COMM	DOM	LOSS	TOTAL	WATER RIGHT
WATER PURVEYORS									
Anza Mutual Water Company	26	0	26	0	0	23	3 ^{1/}	26	Appropriative
Eastern MWD	0	15,063	15,063	96	3,137	11,076	754	15,063	Appropriative
Elsinore Valley MWD	0	7,398	7,398 ^{12/}	27	1,723	5,426	222	7,398	-----
Fallbrook PUD	0	7,254	7,254	4,261	337	2,060	596	7,254	Appropriative
Lake Riverside Estates	310	0	310	0	310 ^{2/}	0	0	310	Appropriative
Metropolitan Water District	0	466	466	466	0 ^{3/}	0	0	466	-----
Murrieta Division of Western MW	750	1,371	2,121	250	340	1,418	113	2,121	Appropriative
Rainbow MWD	0	1,892	1,892	1,602	----- ^{8/}	118	172	1,892	-----
Rancho California WD	24,658 ^{4/}	41,900 ^{5/}	66,558	28,656 ^{6/}	4,217	26,604	7,081 ^{7/}	66,558	Various
U.S.M.C. - Camp Pendleton	4,676	0	4,676	0	----- ^{8/}	1,682	2,994 ^{11/9/}	4,676	Appropriative/ Riparian
U.S. Naval Weapons Station	0	48	48	0	----- ^{8/}	44	4 ^{1/}	48	-----
Western MWD Improvement Dist	0	48	48	0	43	0	5 ^{1/}	48	-----
Through Rancho California WD									
INDIAN RESERVATIONS									
Cahuilla	52	0	52	0	-----	52	0	52	Overlying/Reserved
Pechanga	846	0	846	513	405	215	(287) ^{13/}	846	Overlying/Reserved
SMALL WATER SYSTEMS									
Quiet Oaks Mobile Home Park	23	0	23	8	0	13	2 ^{1/}	23	Riparian/Overlying
Outdoor Resorts	506	0	506	429	0	69	8 ^{1/}	506	Overlying
Jojoba Hills SKP Resort	69	0	69	0	0	62	7 ^{1/}	69	Overlying
Hawthorn Water System	26	0	26	0	0	23	3 ^{1/}	26	Appropriative
OTHER SUBSTANTIAL USERS	7,942 ^{10/}	0	7,942	7,871	0	0	71 ^{11/}	7,942	
TOTAL	39,884	75,440	115,324	44,179	10,512	48,885	11,748 ^{14/}	115,324	

1/ Assumes 10% system loss.

2/ Recreational Use.

3/ Construction use at Diamond Valley Lake.

4/ Includes 24,942 AF production from Older Alluvium minus 284 AF exported to the San Mateo Watershed.

5/ Includes 24,282 AF direct use; 14,643 AF direct recharge; 3,470 AF from MWD WR-34; and minus 495 AF export.

6/ Includes 22,871 AF Ag, and 5,785 AF Ag/Domestic.

7/ Includes 32 AF discharged into Murrieta Creek; 54 AF discharged into Santa Gertrudis Creek; 3,470 AF discharged into Santa Margarita River from MWD WR-34; 0 AF from System River Meter; 152 AF from potable connection to WR-34 outlet pipe and 702 AF of import remaining in storage; and a system loss of 2,671 AF.

8/ Listed with Domestic use.

9/ Includes exports of 2,807 acre feet.

10/ Includes 712 AF for surface diversion plus 7,282 AF from groundwater as shown in Appendix C, minus 52 AF on the Cahuilla Reservation.

11/ Loss is equal to 10% of surface diversions.

12/ Sales figures.

13/ Includes a system loss of 42 acre feet, minus 329 acre feet of reclaimed wastewater from EMWD, accounted for on Table A-1.

See Table A-5 for Pechanga production and use.

14/ Includes an overall system loss of 4,818 AF.

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE 7.2

**SANTA MARGARITA RIVER WATERSHED
DEFINITIONS OF WATER USE
BY MUNICIPAL WATER PURVEYORS
2011-12**

DISTRICT	AGRICULTURAL	DOMESTIC	COMMERCIAL
EASTERN MUNICIPAL WATER DISTRICT	Row crops, sod farms, dairies, horse ranches and other miscellaneous agricultural users	Single family and multi-family residential connections	All other usage including commercial, industrial, institutional, golf courses, landscaping, temporary and construction
ELSINORE VALLEY MUNICIPAL WATER DISTRICT	Delivery of water for agricultural purposes in growing or raising for commerce, trade or industry or for use by public educational or correctional institutions	Delivery of water to single family residential customers in single, detached residential units	Delivery of water to multi-family residential units, commercial, industrial establishments, cities, political sub-divisions or quasi-governmental associations
FALLBROOK PUBLIC UTILITY DISTRICT	AG - A commercial enterprise producing a crop/livestock/fowl on at least 1 acre fully used for ag purposes; can include incidental domestic use related to residency AG/DOM - Water used for both ag and domestic purposes	Single family, multi-unit and large domestic residences and the first 20,000 gallons used by an ag/domestic meter	Offices, businesses, schools and hydrants
PECHANGA INDIAN RESERVATION	Irrigation, including water used for golf course, parks, grass areas, and landscaping	Residential	Resort, on-Reservation businesses, tribal facilities
RAINBOW MUNICIPAL WATER DISTRICT	AG- 1 acre or more of plantable, resalable products DOM/AG - Same as Ag with a house on the parcel	DOMESTIC - Homes	Generally no commercial use in district
RANCHO CALIFORNIA WATER DISTRICT	AG - 1 acre or more of plantable, resalable products GOLF - Outside water use at golf courses VINEYARDS - Outside irrigation for vineyards LANDSCAPE - Landscaping around freeways, parking lots, office buildings, median strips, AG/DOM - First 1600 c.f. for each user allotted to domestic, and the balance to agriculture	DOMESTIC - Homes MULTIPLE - Apartments and Condominiums	COMMERCIAL - Office buildings, industrial users other than agri-businesses FLOATING - Fire hydrants used during construction CONSTRUCTION - Other fire hydrants used for grading LAKE SKINNER - Recreational use at Lake Skinner MISCELLANEOUS - Schools, fire departments, parks, government agencies DETECTOR CK. METERS - Only used when there is a fire
MURRIETA DIVISION OF WESTERN MUNICIPAL WATER DISTRICT	Agricultural uses and irrigation for crops	Homes and multiple units	Businesses, public agencies, schools and construction
USMC, CAMP PENDLETON	Irrigation - Water used for ag purposes, not landscaping, golf courses or parks	Camp Supply - Includes landscaping, parks and commercial use	Reported under Camp Supply

Interlocutory Judgment No. 33 divides aquifers in Anza Valley at this location into two categories: the shallow aquifer and the deep aquifer. Based on information available to the Court, the shallow aquifer was determined to include the younger and older alluvial deposits in the Anza Groundwater Basin, and extend to a maximum but variable depth of approximately 100 feet. The deep aquifer underlies the shallow aquifer in an area about one-half mile in width and two miles in length, within portions of Sections 16, 17, 21, 22, 27 and 28 of Township 7 South, Range 3 East, SBM. Anza Mutual Water Company's wells are within the area of the deep aquifer. From the perforated intervals in the wells, it may be concluded that most of the production from Well No. 1 and all of the production from Well No. 2 are from the deep aquifer. Interlocutory Judgment No. 33 concluded that waters contained in the deep aquifer did not add to, support or contribute to the Santa Margarita River stream system and were, therefore, declared to be outside the Court's jurisdiction.

Accordingly, most of the water produced by the Anza Mutual Water Company is outside the Court's jurisdiction. The relatively small portion pumped from the shallow aquifer in Well No. 1 is pumped under a groundwater appropriative right. Data for Water Years 1989 to 2012 are shown on Appendix Table B-12.

Eastern Municipal Water District

Eastern Municipal Water District is a member agency of Metropolitan Water District and its service area includes a portion of the Rancho California Water District and the Murrieta Division of Western Municipal Water District. Within the Watershed, Eastern MWD wholesales water to those districts and also retails water directly to consumers. Water sold to Rancho California WD and the Murrieta Division of Western MWD is not listed in this report as imported water to Eastern MWD.

Eastern MWD's service area outside Rancho California WD and the Murrieta Division of Western MWD is located in the northern part of the Watershed. Water for Eastern MWD's retail service area is all imported with no groundwater production during 2011-12.

Imports, not including water wholesaled to Rancho California WD or the Murrieta Division of Western MWD or delivered to Elsinore Valley MWD, totaled 16,419 acre feet. A portion of that import, amounting to 1,356 acre feet, was exported from the Santa Margarita River Watershed for delivery to Eastern MWD's retail customers located outside the Watershed, resulting in net import to the Watershed of 15,063 acre feet. These data are shown on Appendix Table A-1.

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

In addition to importing fresh water, Eastern MWD also reclaims wastewater at its Temecula Valley Regional Water Reclamation Facility.

Disposition of wastewater from the Temecula Valley Regional Water Reclamation Facility (TVRWRF) service area for Water Years 2010-11 and 2011-12 is shown below:

<u>Use</u>	<u>2010-11</u>		<u>2011-12</u>	
	<u>Quantity</u>	<u>Percent</u>	<u>Quantity</u>	<u>Percent</u>
	AF	%	AF	%
Reuse in Santa Margarita	2,561	17	2,364	16
Reuse outside Santa Margarita	<u>7,241</u>	<u>48</u>	<u>8,025</u>	<u>54</u>
Subtotal	9,802	65	10,389	70
Discharge to Dissipater at Temescal Creek	2,507	17	285	2
Other	<u>2,633</u>	<u>18</u>	<u>4,240</u>	<u>28</u>
TOTAL	14,942	100	14,914	100

It can be noted that the quantities of reclaimed wastewater used within the Santa Margarita River Watershed declined from 2,561 acre feet in 2010-11 to 2,364 acre feet in 2011-12. During the same period, reuse outside the Santa Margarita River Watershed increased from 7,241 acre feet to 8,025 acre feet. From the foregoing, it may be concluded that 16 percent of the wastewater is reused in the Watershed and 54 percent is used outside the Watershed. The quantity of wastewater discharged to the dissipater at Temescal Creek decreased from 2,507 acre feet to 285 acre feet. The Other use increased from 2,633 acre feet to 4,240 acre feet. This Other use includes changes of storage in Winchester and Sun City storage ponds, as well as evaporation and percolation losses.

Due to concerns about the potential export of native Santa Margarita water, the sources of water supply to the TVRWRF service area were determined and are shown on Table 7.3. In 2011-12, 23 percent of the supply to the service area was groundwater. Thus, the percent of groundwater supply was greater than the percentage of wastewater reused within the Santa Margarita Watershed, and on a proportional basis there was some export of native waters.

TABLE 7.3

**SANTA MARGARITA RIVER WATERSHED
WATER DELIVERIES TO TEMECULA VALLEY
REGIONAL WATER RECLAMATION FACILITY SERVICE AREA**

	2008			2009			2010			2011			2012		
	AF	%		AF	%		AF	%		AF	%		AF	%	
Eastern MWD															
TVRWRF Service Area															
1. Groundwater	0			0			0			0			0		
2. Import 1/	14,952			14,472			13,552			14,392			15,063		
3. Total	14,952			14,472			13,552			14,392			15,063		
Rancho California WD															
TVRWRF Service Area															
1. Groundwater 2/	8,310 R			8,579 R			8,641 R			9,774 R			7,902		
2. Import 3/	13,821 R			12,260 R			10,755 R			8,770 R			11,462		
3. Total 4/	22,131 R			20,839 R			19,396 R			18,544 R			19,364		
Total Deliveries to TVRWRF Service Area															
1. Groundwater	8,310 R	22.4%		8,579 R	24.3%		8,641 R	26.2%		9,774 R	29.7%		7,902	23.0%	
2. Import	28,773 R	77.6%		26,732 R	75.7%		24,307 R	73.8%		23,162 R	70.3%		26,525	77.0%	
3. Total	37,083	100.0%		35,311	100.0%		32,948	100.0%		32,936	100.0%		34,427	100.0%	

1/ EMWD imports are based on discharges from EM-17.

2/ Based on the ratio of groundwater to total production in Rancho Division of RCWD. Groundwater includes Vail Lake recovery under Permit 7032.

3/ Based on ratio of import to total production in Rancho Division of RCWD.

4/ Total RCWD deliveries in TVRWRF Service Area.

R - Revised

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

On August 4, 2009, a Judgment was entered in *United States of America and Fallbrook Public Utility District v. Eastern Municipal Water District and Rancho California Water District* (CV 04-8182 CBM (RNBx), United States District Court, Central District of California) pertaining to the contractual obligations of the 1990 Four Party Agreement and the export of treated wastewater from the Santa Margarita River Watershed. On May 17, 2011, the United States Court of Appeals for the Ninth Circuit issued an Order granting the parties' joint motion to dismiss the appeals in this matter and thus the August 4, 2009 Judgment stands. For purposes of this annual report the export of treated wastewater will be reported consistent with prior annual reports with no changes pursuant to the Judgment. The Watermaster will reevaluate the calculations and reporting to be included in future annual reports.

Estimates of water production and use for the period 1966 to 2012 are shown on Appendix Table B-1.

Elsinore Valley Municipal Water District

Elsinore Valley Municipal Water District provides water to its service area around Lake Elsinore, a portion of which is within the Santa Margarita River Watershed. Elsinore Valley MWD obtains its supply from ten wells, all located outside the Santa Margarita River Watershed, and also imports Metropolitan Water District water through Eastern MWD and Western MWD.

As shown on Appendix Table A-2, Elsinore Valley MWD reports that 7,398 acre feet of imported water were delivered in the portion of its service area that is inside the Santa Margarita River Watershed in 2011-12. Also during 2011-12, 1,205 acre feet of wastewater were exported from that same area.

Production and use for the period 1966 to 2012 are shown on Appendix Table B-2.

Fallbrook Public Utility District

In 2011-12, Fallbrook Public Utility District imported 12,579 acre feet as shown on Appendix Table A-3. In 2011-12 Fallbrook PUD there were no diversions from Lake Skinner, under Permit No. 11356, resulting in a total district-wide production of 12,579 acre feet. In addition, Fallbrook PUD has three wells within the Santa Margarita River Watershed; however, in 2011-12, there was no production from these wells. The Fallbrook PUD service area is located in both the San Luis Rey River and Santa Margarita River watersheds. The total production for the Santa Margarita River Watershed as shown on Appendix Table A-3 is 7,254 acre feet, or about 58 percent of the total district-wide production.

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

In 2011-12, Fallbrook PUD treated 958 acre feet of wastewater from areas served within the Watershed, of which 21 acre feet were reused in the Watershed, and the remainder was exported. The wastewater production and distribution for 2011-12 is shown on Appendix Table A-3.

Production during the period 1966 to 2012 included direct diversions from the Santa Margarita River prior to 1972, as well as imported water and well production, as shown in Appendix B. During Water Year 2010-11, Fallbrook PUD revised its reporting methods for both water production and wastewater operations. The historical water production and use for the period 1966 through 2010 are provided on Appendix Table B-3.1 reflecting prior reporting methods, particularly previous estimates associated with the Deluz portion of the service area. It is noted, on Appendix Table B-3.1 that production and use values for 2005, 2006, 2008 and 2010 have been revised to correct double counting of Lake Skinner deliveries as reported in prior annual reports for the indicated years. Appendix Table B-3.2 is provided to show the current water production and use reflecting the revised reporting methods. The revised reporting methods include metered deliveries for the reported uses within the Watershed and application of a district-wide loss factor.

The Fallbrook PUD wastewater production and distribution for the period 1966 to 2012 are shown on Appendix Table B-4.

Lake Riverside Estates

Lake Riverside Estates pumps water from Well No. 7S/2E-32C1, into Lake Riverside to replace evaporation losses. Production for 2011-12 was 310 acre feet as shown on Appendix Table A-11. The production well was drilled in 1962 and is located in an area of younger alluvium in the Cahuilla Groundwater Basin. The well was drilled to a depth of 338 feet.

Interlocutory Judgment No. 33 indicates that the owners of lands in the Cahuilla Groundwater Basin have correlative overlying rights to the use of the groundwater that is the basis for this production. Data for 1989 to 2012 are shown on Appendix Table B-12.

Metropolitan Water District of Southern California

Pursuant to a Court Order, Metropolitan Water District (MWD) imported 466 acre feet of water into the Santa Margarita River Watershed for irrigation of lands in Domenigoni Valley. MWD did not import any water for groundwater recharge and there was no water used for construction purposes. As previously noted, the groundwater in the Domenigoni Valley groundwater basin is outside this Court's jurisdiction when groundwater levels are below elevation 1400 feet. This production is shown on Appendix Table A-4, and production for the period 1966 to 2012 is shown on Appendix Table B-5.

Rainbow Municipal Water District

Rainbow Municipal Water District is located in San Diego County in the south-central part of the Watershed. In 2011-12, the District imported a total of 21,152 acre feet of water as shown on Appendix Table B-7. However, most of the District is in the San Luis Rey River Watershed and only about nine percent of the District's imported supply was delivered to the portion of their service area inside the Santa Margarita River Watershed. As shown on Appendix Table A-6, total deliveries of imported water in the Santa Margarita River Watershed in 2011-12 amounted to 1,892 acre feet.

The import production for years between 1966 and 2012 is shown on Appendix Table B-7.

Rancho California Water District

Rancho California Water District serves water to a 99,600 acre service area in the central portion of the Watershed. The District produced water from 47 wells in 2011-12 and also imported water, as shown on Appendix Table A-7. Use is shown under the categories of agriculture, ag/domestic, commercial and domestic. In Water Year 2011-12, well production of native water included 24,942 acre feet from the Murrieta-Temecula Groundwater Area comprised of pumping from the older alluvium. A portion of the groundwater amounting to 284 acre feet was exported for use in the San Mateo Watershed, resulting in a net well production of 24,658 acre feet.

Import supplies totaled 42,395 acre feet of which 24,282 acre feet were used for direct use; 14,643 acre feet were recharged; and 3,470 acre feet were discharged by the District to the Santa Margarita River from MWD Meter WR-34 during 2011-12, pursuant to the Cooperative Water Resource Management Agreement (CWRMA). A portion of that import amounting to 495 acre feet were exported from the Santa Margarita River Watershed, resulting in net import to the Watershed of 41,900 acre feet.

During 2011-12, use totaled 66,558 acre feet including 22,871 acre feet by agriculture; 5,785 acre feet by ag/domestic; 4,217 acre feet by commercial; 26,604 acre feet by domestic; 3,708 acre feet were released into Murrieta Creek, Santa Gertrudis Creek and the Santa Margarita River; 702 acre feet of import were recharged to storage; and 2,671 acre feet were system loss.

In 2011-12, Rancho California WD did not export wastewater from the Watershed to the dissipater at Temescal Creek in the Santa Ana Watershed.

Rancho California WD produces groundwater under a variety of rights as follows:

1. Recovery of water appropriated at Vail Lake
2. Recovery of import return flows and recharged imported water
3. Groundwater appropriative rights
4. As agent on behalf of overlying landowners

Vail Appropriation

Rancho California WD's Vail Dam appropriative rights are described in Application No. 11518 as amended on June 17, 1947, and in Permit 7032 originally issued on February 18, 1948. Permit 7032 was subsequently amended on July 28, 1971, and April 22, 2009. The water right provides that the District may store up to 40,000 acre feet in Vail Lake each year between November 1 and April 30, subject to applicable limitations. The water so stored may be used for recreational uses at Vail Lake and municipal, domestic, industrial, and irrigation uses within the entire service area of Rancho California WD. Such uses may be by direct diversion from Vail Lake or by recovery of water released from Vail Lake and spread downstream in Pauba Valley. Points of re-diversion for recovery from underground storage are permitted for 12 production wells: Rancho California WD Well Nos. 109, 110, 123, 132, 152, 153, 157, 158, 210, 232, 233, and 234.

As shown on Table 3.3, there were no releases from Vail Lake during 2011-12 for groundwater recharge. Releases from Vail Lake for groundwater recharge for the period 1980 to 2012 are shown on Appendix Table B-8.

Permit 7032 operations for 2011-12 are summarized on Table 7.4. The recovery from groundwater recharge for 2011-12 was zero corresponding to the amount released from Vail Lake for recharge. The negative five acre feet shown as a release to groundwater recharge corresponds to five acre feet of required bypass flows that remained in storage at the end of September 2012. The value of five acre feet was subtracted from the Vail Recharge Account balance as shown on Table 7.4.

It is noted, with the issuance of the amended Permit 7032 in 2009, the place of use, purposes of use, and permitted points of re-diversion were changed. Accordingly, the reporting of Permit 7032 operations needs to be modified to reflect the changed permit conditions. Table 7.4 was modified in 2009 to reflect the changes subject to further refinement as part of the update of the CWRMA groundwater model. The reporting on Table 7.4 reflects the assumption that all water released from Vail Lake for recharge is recovered from the younger alluvium by pumping from the permitted recovery wells. The remainder of the pumping from the younger alluvium is apportioned to direct import recharge. The updated groundwater model will be used to develop a refined accounting methodology for recharge and recovery of Vail Lake releases and imported water. The updated model will also be used to evaluate the status of and accounting for the Vail Recharge Account and the Imported Water Carryover Account.

TABLE 7.4
SANTA MARGARITA RIVER WATERSHED
RANCHO CALIFORNIA WATER DISTRICT
PERMIT 7032 OPERATIONS
2011-12
Quantities in Acre Feet

Diversion to Storage in Vail Lake ^{1/}	2,058
Release to Groundwater Storage ^{1/}	(5)
Recovery from Groundwater Storage ^{2/ 3/ 4/}	
Younger Alluvium	0
Older Alluvium	0
Total	0
Vail Recharge Account Balance from 2010-11	54,297
Release minus Recovery	(5)
Vail Recharge Account Balance for 2011-12	54,292

-
- 1/ See Table 3.3.
2/ Permitted Points of Re-Diversion RCWD Well Nos. 109, 110, 123, 132, 152, 153, 157, 158, 210, 232, 233, and 234.
3/ Total pumping from Vail recovery wells is greater than amount shown as recovered under Permit 7032. Total pumping from the 12 recovery wells shown on Table 7.8.
4/ At end of September 2012 on water year basis, Release to Groundwater Storage balance shows negative 5 acre feet. Thus, Recovery from Groundwater Storage is set equal to zero and all pumping from the 12 recovery wells is allocated to recovered recharge of imported water.

Imported Water Return Flows

Return flows for 2011-12, based on imported water use in the Rancho Division and Santa Rosa Division are shown on Tables 7.5 and Table 7.6, respectively.

In the following tables, imported water is allocated to agricultural, ag/domestic, commercial and domestic uses in each of eight hydrogeologic areas in the Rancho Division service area and three hydrogeologic areas in the Santa Rosa Division service area. This allocation is the proportion of the total deliveries to each use that is made up of imported water. For 2011-12, 58.95 percent of the supply to the Rancho Division was imported and 61.56 percent of the supply to the Santa Rosa Division was imported.

In general the Santa Rosa Division does not overlie the groundwater area. However there are several areas classified as being in the Santa Rosa Division that do overlie the groundwater area and generate return flows from imported supplies. Data from most of these lands have been reported since December 1991.

The percentage of imported water that becomes return flow varies according to the use as follows:

Agricultural Use	25%
Ag/Domestic Use	25%
Commercial Use	10%
Domestic Use	25%

Based on the foregoing factors, the total return flow credit for 2011-12 is computed to be 4,800.22 acre feet for the Rancho Division and 318.27 acre feet for the Santa Rosa Division, as shown on Tables 7.5 and 7.6, respectively.

Some of the hydrogeologic areas overlie older alluvium and some overlie younger alluvium. Comparison of exposures of younger alluvium with maps of the District's hydrogeologic areas indicates that the Santa Gertrudis, Pauba and half of the Murrieta-Wolf areas overlie younger alluvium. The area of the Santa Rosa Division that overlies the groundwater area is one-fourth in the younger alluvium and three-fourths in the older alluvium. Import return flows in these areas can be credited against pumping from the younger alluvium. These credits for 2011-12 are 984.83 acre feet for the Rancho Division and 79.57 acre feet for the Santa Rosa Division, as shown on Tables 7.5 and 7.6, respectively.

Rancho California WD imported an additional 14,643 acre feet of water for groundwater recharge in 2011-12, of which 13,941 acre feet were recovered.

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE 7.5

**SANTA MARGARITA RIVER WATERSHED
RANCHO CALIFORNIA WATER DISTRICT
RETURN FLOW CREDIT
2011-12
RANCHO DIVISION
Quantities in Acre Feet**

HYDROGEOLOGIC AREAS									
	0 NO HYDRO- GEO CODE	1 MURRIETA WOLF 1/2 QYAL 1/2 QTOAL	2 SANTA GERTRUDIS QYAL	3 LOWER MESA QTOAL	4 PAUBA QYAL	5 SOUTH MESA QTOAL	6 UPPER MESA QTOAL	7 PALOMAR QTOAL	TOTAL
AGRICULTURAL *									
Total Use	951.60	858.99	566.23	2,171.86	262.12	636.03	736.12	762.73	6,945.68
% Import	58.95	58.95	58.95	58.95	58.95	58.95	58.95	58.95	
Import Use	560.98	506.38	333.80	1,280.33	154.52	374.95	433.95	449.64	4,094.53
% Credit	25.00	25.00	25.00	25.00	25.00	25.00	25.00	25.00	
Credit	140.24	126.59	83.45	320.08	38.63	93.74	108.49	112.41	1,023.63
AG/DOMESTIC									
Total Use	564.97	33.56	0.00	32.95	428.71	30.36	491.63	180.96	1,763.15
% Import	58.95	58.95	58.95	58.95	58.95	58.95	58.95	58.95	
Import Use	333.06	19.78	0.00	19.42	252.73	17.90	289.82	106.68	1,039.39
% Credit	25.00	25.00	25.00	25.00	25.00	25.00	25.00	25.00	
Credit	83.26	4.95	0.00	4.86	63.18	4.47	72.46	26.67	259.85
COMMERCIAL									
Total Use	320.51	1,302.85	854.60	686.13	215.33	111.06	68.70	14.94	3,574.12
% Import	58.95	58.95	58.95	58.95	58.95	58.95	58.95	58.95	
Import Use	188.95	768.04	503.79	404.48	126.94	65.47	40.50	8.80	2,106.97
% Credit	10.00	10.00	10.00	10.00	10.00	10.00	10.00	10.00	
Credit	18.89	76.80	50.38	40.45	12.69	6.55	4.05	0.88	210.70
DOMESTIC									
Total Use	1,033.78	2,519.16	2,398.97	10,370.85	631.97	3,628.85	1,420.13	428.85	22,432.56
% Import	58.95	58.95	58.95	58.95	58.95	58.95	58.95	58.95	
Import Use	609.42	1,485.06	1,414.21	6,113.69	372.55	2,139.23	837.18	252.81	13,224.17
% Credit	25.00	25.00	25.00	25.00	25.00	25.00	25.00	25.00	
Credit	152.36	371.27	353.55	1,528.42	93.14	534.81	209.29	63.20	3,306.04
TOTAL USE	2,870.87	4,714.55	3,819.80	13,261.78	1,538.14	4,406.30	2,716.58	1,387.49	34,715.51
TOTAL									
Total Import Use	1,692.40	2,779.26	2,251.80	7,817.92	906.74	2,597.55	1,601.44	817.93	20,465.06
Total Credit	394.76	579.61	487.38	1,893.81	207.64	639.57	394.29	203.16	4,800.22
Total Credit Qyal		289.81	487.38		207.64				984.83
Total Credit Qtoal		289.81		1,893.81		639.57	394.29	203.16	3,420.63

* Includes golf course and landscape irrigation

** This credit not applied to either Qyal or Qtoal

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE 7.6

SANTA MARGARITA RIVER WATERSHED
RANCHO CALIFORNIA WATER DISTRICT
RETURN FLOW CREDIT
2011-12
SANTA ROSA DIVISION
Quantities in Acre Feet

	HYDROGEOLOGIC AREAS			
	1 MURRIETA WOLF 1/2 QYAL 1/2 QTOAL	3 LOWER MESA QTOAL	8 RTS 279, 280 & 285 1/4 QYAL 3/4 QTOAL	TOTAL
AGRICULTURAL *				
Total Use	0.00	0.00	523.95	523.95
% Import	61.56	61.56	61.56	
Import Use	0.00	0.00	322.53	322.53
% Credit	25.00	25.00	25.00	
Credit	0.00	0.00	80.63	80.63
AG/DOMESTIC				
Total Use	0.00	0.00	0.00	0.00
% Import	61.56	61.56	61.56	
Import Use	0.00	0.00	0.00	0.00
% Credit	25.00	25.00	25.00	
Credit	0.00	0.00	0.00	0.00
COMMERCIAL				
Total Use	0.00	0.00	547.98	547.98
% Import	61.56	61.56	61.56	
Import Use	0.00	0.00	337.33	337.33
% Credit	10.00	10.00	10.00	
Credit	0.00	0.00	33.73	33.73
DOMESTIC				
Total Use	0.00	0.00	1,324.93	1,324.93
% Import	61.56	61.56	61.56	
Import Use	0.00	0.00	815.60	815.60
% Credit	25.00	25.00	25.00	
Credit	0.00	0.00	203.90	203.90
TOTAL USE	0.00	0.00	2,396.86	2,396.86
TOTAL				
Total Import Use	0.00	0.00	1,475.46	1,475.46
Total Credit	0.00	0.00	318.27	318.27
Total Credit Qyal	0.00		79.57	79.57
Total Credit Qtoal	0.00	0.00	238.70	238.70

* Includes golf course and landscape irrigation

Division of Local Water

During 2011-12, Rancho California WD pumped 39,060 acre feet of groundwater, comprised of 25,119 acre feet of local water and 13,941 acre feet of recovered imported water. Some of this water was pumped from the younger alluvium and some from the older alluvium. The Court determined that water in both the younger alluvium and older alluvium adds to, contributes to and supports the Santa Margarita River stream system. The primary reason for differentiating between younger alluvium and older alluvium production is that, in California, production from the younger alluvium is generally considered to be governed by water rights that apply to the regulation of surface waters. Production from the older alluvium is generally considered to be governed by regulations that apply to groundwater. Of the 25,119 acre feet of local water, 177 acre feet were delivered to the Pechanga Indian Reservation under the terms of the Wolf Valley Groundwater Management Agreement. This production is shown on Appendix Table A-5.

During joint development of a groundwater model of the area it was necessary to develop estimates of the transmissivity for each aquifer. These estimates were based on pumping tests. The resulting transmissivity values were then used to estimate the relative groundwater production from each aquifer. For Rancho California WD wells, the percent production estimated to originate in the younger alluvium is shown on Table 7.7.

Production from the younger alluvium and older alluvium for 2011-12, using the percentages noted on Table 7.7 is presented on Table 7.8. It may be noted that 13,941 acre feet were pumped from the younger alluvium and 25,119 acre feet were pumped from the older alluvium in 2011-12.

The production of 13,941 acre feet from the younger alluvium, as shown on Table 7.8 is the recovery of 13,941 acre feet of direct import recharge. Rancho California WD imported 14,643 acre feet of water in 2011-12 for direct recharge, of which 13,941 acre feet were recovered leaving 702 acre feet as unrecovered direct recharge.

Imported water carryover to 2011-12 includes the following:

	AF
1. Carryover from 2010-11	59,523
2. Unrecovered direct recharge in 2011-12	702
3. Import Return Flow Credit for 2011-12	<u>1,065</u>
4. Total Carryover to 2012-13	61,290

Thus, the Imported Water Carryover Account balance of 61,290 acre feet remains available to offset younger alluvium production in future years.

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE 7.7

**SANTA MARGARITA RIVER WATERSHED
PERCENT PRODUCTION FROM YOUNGER ALLUVIUM IN
RANCHO CALIFORNIA WATER DISTRICT WELLS**

RCWD WELL NO.	LOCATION TOWNSHIP/ RANGE/ SECTION	SEAL DEPTH FEET	PERFORATED INTERVAL FEET	DEPTH YOUNGER ALLUVIUM FEET	PERCENT YOUNGER ALLUVIUM %		REMARKS
106	7S/3W-26R1	55	130-210; 250-310; 340-440; 700-740; 780-980	0	0.0%	Murrieta	No. 108 Winchester, clay 0'-40'
107	7S/3W-26J1	55	60-120; 190-260; 280-300; 390-590	58	0.0%	Murrieta	No. 105 - gravel & clay 58'-84'
108	7S/3W-25E1		60-110; 190-280; 350-410; 430-450; 470-490;	55	0.0%	Murrieta	Formerly No. 109 gravel/sandy clay 55'-70'
109	8S/2W-17J1	52	70-150; 170-210	75	84.0%		Brown clay and gravel 75' to 105'
110	8S/1W-6K1	54	75-155	165	97.0%		Clay 165'-190'. Prior to 10/23/97 perf int. 70-150; 200-240; 320-380; 420-
113	7S/2W-25H1	52	96-136; 275-462; 482-	Shallow	0.0%		
116	8S/1W-6J	Unknown	60-120; 140-200; 220-260; 270-330; 370-390	150	94.0%		Clay 150'-170'
119	8S/2W-19J	55	170-260; 300-470		0.0%	Wolf Valley	Perforated below 170'
123	8S/1W-7B	55	100-260; 300-380; 420-	135	65.0%		Brown Sand Clay 135'-210'
129	7S/2W-20L	Unknown	180-290; 416-480; 520-600	Shallow	0.0%	Santa Gertrudis Creek	Qyal very shallow along Santa Gertrudis Creek
132	8S/1W-7D	55	70-390; 430-500	135	82.0%		Brown Clay Streaks 135'-175'
135	7S/3W-27M10	55	70-170	50	0.0%	Murrieta Valley	Silty clay 50'-69'
141	8S/2W-11P	55	120-190; 215-235; 270-380; 430-510	104	0.0%		Silt & sand 104'-185'; Well 11L1 is 112'
144	7S/3W-27D	55	983-1123; 1143-1283; 1343-1483; 1503-1743	25	0.0%	Murrieta Valley	Sand with silty clay 25'-45'
146	7S/3W-28	50	50-190	42	0.0%	Murrieta	
152	8S/1W-5K	50	70-470; 490-540	130	90.8%		Forebay
153	8S/1W-5K3	50	50-220	170	99.0%		Forebay
157	8S/1W-5L	50	50-210	128	96.8%		Forebay
158	8S/1W-5K	50	50-210	100	96.5%		Forebay
205	7S/3W-35A	50	150-1000	10	0.0%	Santa Gertrudis/ Murrieta Valley	Sandy clay 10'-20'
210	8S/2W-12K	None	48-228	140	94.0%		Clay cobblestones 160'-167', 175'-
218	8S/2W-20B5	27	48-289	40	0.0%		Old 28; clay with sand layer 40'-60'; now monitoring wells 427, 428 and
466	8S/3W-1P2	Unknown	106-822	49	0.0%	Long Canyon	Old 219, Cantarini, hard clay 49'-60'
220	7S/3W-26Q1	34	114-450	58	0.0%		Clay 58' - 73'
467	8S/2W-12K1	Unknown	50-100; 100-140	140	100.0%		Old 221, JK, Exh. 16, Monitoring well since 1983
223	8S/2W-20C1	Unknown	48-250	60	94.0%	Wolf Valley	CAT Well; east of Wildomar Fault; nearby Exh 16 wells 17Q @62' & 17M @55' are also east of Wildomar
224	8S/2W-15D	Unknown	48-250	106	68.0%		Old Well 50, clay 106'-138'
230	8S/2W-11J1	Unknown	24-31; 32.5-34; 35-40; 61-65; 70-76; 80-85; 86.5-91; 92.5-98.5	>119	100.0%		Old Well 30, depth of well is 119'
231	8S/2W-20B6	55	80-120; 150-270	35	0.0%		Old 104, P-34, Clay 20'-23'; 35'-41'; East of Wildomar Fault
232	8S/2W-11J3	51	95-135; 175-215; 235-295	135	92.0%		Old 111, 105, P-31; coarse sand & clay 135' - 155'
233	8S/2W-12K2	51	95-135; 175-215; 235-	145	88.0%		Old 112, P32; sand and clay at 145'-
234	8S/2W-11P1	52	80-100; 120-140; 200-240; 280-320; 340-400	125	74.0%		Brown Clay at 125'; sand and clay at 125'-140'
235	8S/3W-1Q1	55	Unknown	Shallow	0.0%	Long Canyon	
240	8S/2W-11L1	Unknown	48-298	112	86.0%		Old Well No. 40; clay 112'-136'
301	7S/3W-18Q1	93	140-280; 280-520; 540-	26	0.0%	Murrieta	Old JR1; blue clay 26'-32'

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE 7.8

SANTA MARGARITA RIVER WATERSHED
RANCHO CALIFORNIA CALIFORNIA WATER DISTRICT
WELL PRODUCTION FROM YOUNGER AND OLDER ALLUVIUM
2011-12

Quantities in Acre Feet

WELL NO.	QYAL	QTOAL	TOTAL
101	0.00	743.00	743.00
102	0.00	68.00	68.00
106	0.00	253.00	253.00
108	0.00	529.00	529.00
109	498.96	95.04	594.00
110	1,163.03	35.97	1,199.00
113	0.00	512.00	512.00
118	0.00	527.00	527.00
119 *	0.00	510.00	510.00
120	0.00	1,675.00	1,675.00
121	0.00	0.00	0.00
122 *	0.00	346.00	346.00
123	63.05	33.95	97.00
124	0.00	355.00	355.00
125	0.00	0.00	0.00
126	0.00	814.00	814.00
128	0.00	0.00	0.00
129	0.00	0.00	0.00
130	0.00	1,155.00	1,155.00
131	0.00	1,099.00	1,099.00
132	1,088.14	238.86	1,327.00
133	0.00	278.00	278.00
135	0.00	21.00	21.00
138	0.00	1,922.00	1,922.00
139	0.00	955.00	955.00
140	0.00	846.00	846.00
141	0.00	455.00	455.00
143	0.00	546.00	546.00
144	0.00	469.00	469.00
145	0.00	254.00	254.00
146	0.00	40.00	40.00
149	0.00	351.00	351.00
151	0.00	658.00	658.00
152	1,719.75	174.25	1,894.00
153	1,831.50	18.50	1,850.00
155	0.00	8.00	8.00
156	0.00	642.00	642.00
157	2,240.92	74.08	2,315.00
158	2,070.89	75.11	2,146.00
201	0.00	0.00	0.00
203	0.00	556.00	556.00
205	0.00	1,795.00	1,795.00
207	0.00	0.00	0.00
208	0.00	0.00	0.00
209	0.00	0.00	0.00
210	670.22	42.78	713.00
211*	0.00	346.00	346.00
215	0.00	111.00	111.00
216	0.00	116.00	116.00
217	0.00	878.00	878.00
231	0.00	0.00	0.00
232	1,006.48	87.52	1,094.00
233	1,391.28	189.72	1,581.00
234	196.84	69.16	266.00
235	0.00	1,459.00	1,459.00
301	0.00	0.00	0.00
302	0.00	0.00	0.00
309	0.00	2,692.00	2,692.00
TOTAL	13,941.06	25,118.94	39,060.00

* A portion of 1,202 AF of water from Wells 119, 122 and 211 was delivered to Pechanga Indian Reservation for their use.

Western Municipal Water District

Western Municipal Water District operations within the Watershed are comprised of three categories. First, Western MWD wholesales imported water to Rancho California WD. Deliveries to Rancho California WD are included under Rancho California WD. Second, Western MWD serves water to its Murrieta Division in the vicinity of the City of Murrieta. Third, Western MWD serves imported water to its Improvement District A near the southern boundary of Riverside County along the I-15 freeway. Improvement District A is operated by Rancho California WD under an operations and maintenance contract on behalf of Western MWD.

Murrieta Division

In November 2005, Western MWD merged with the Murrieta County Water District assuming their operations in an area in the vicinity of the City of Murrieta. Prior Watermaster Reports present information under Murrieta County Water District.

All of the Murrieta Division of Western MWD wells are located in the Murrieta-Temecula Groundwater Area. Interlocutory Judgment No. 30 indicates the younger alluvium deposits in Murrieta Valley extend in various depths to a maximum of approximately 30 feet from the ground surface.

The Court noted that it was impossible, based on evidence available in 1962, to determine with exactness the depth of the younger alluvial deposits throughout the Valley. However, the Court did retain continuing jurisdiction so that subsequent findings could be made, if needed. Older alluvial deposits are found below the younger alluvium.

Six of the seven Murrieta Division wells are perforated at depths of 106 feet or more. The Holiday Well has perforations beginning at a depth of 60 feet, which is well below the maximum depth of younger alluvium found by the Court in 1962. In addition, water depths in the Holiday Well rose to around 65 feet in 2011-12, and there has been no production from the Holiday Well since March 2006. Accordingly, all of Murrieta Division well production is from the older alluvium under a groundwater appropriative right.

In Water Year 2011-12, the Murrieta Division of Western MWD produced 719 acre feet of water from the North Well and 10 acre feet from the South Well. In addition, in September 2012, Western MWD brought the New Clay Well back online and produced 21 acre feet from the newly renovated well. Western MWD imported 1,371 acre feet as shown on Appendix Table A-10.

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

The following table itemizes the production from the Murrieta Division wells:

<u>Well Designation</u>	<u>Well Name</u>	<u>2011-12 Production Acre Feet</u>	<u>Casing Depth Feet</u>	<u>Water Depth Feet</u>	<u>Well Depth Feet</u>	<u>Perforated Interval Feet</u>
7S/3W-20	New Clay	21	101	220 – 252	940	330 – 350 370 – 470 680 – 790 830 – 900
7S/3W-20C9	Holiday	0	25	59 – 71	307	60 – 307
7S/3W-20G5	House	0	50	*	298	120 – 252
7S/3W-17R2	Lynch	0	26	70 – 80	212	172 – 212
7S/3W-18J2	North	719	50	270 – 280	650	240 – 260 500 – 640
7S/3W-20D	South	10	50	175 – 223	446	120 – 446
7S/3W-7M	Alson	0	50	*	416	106 – 416
TOTAL		750				

* Water levels not measured during Water Year 2011-12

Western MWD's Murrieta Division production for the period 1966 to 2012 is shown on Appendix Table B-11.

Improvement District A

In Water Year 2011-12, imports to Improvement District A amounted to approximately 48 acre feet as shown on Appendix Table A-11. Deliveries to Improvement District A through turnout WR-13 for the period 1966 to 2012 are shown on Appendix Table B-12.

U. S. Marine Corps - Camp Pendleton

Camp Pendleton is located on the coastal side of the Santa Margarita River Watershed. Water was provided by 10 wells that produced 4,676 acre feet in Water Year 2011-12. This production is from the younger alluvium and is based on riparian and appropriative rights. In 2011-12, there was no agricultural use and 4,676 acre feet were used for Camp Supply. Camp Supply includes domestic and commercial uses as well as irrigation for landscaping and park areas. Camp Pendleton water use is located both inside and outside the Watershed. A total of 1,869 acre feet were used inside the Watershed and 2,807 acre feet were exported to areas of the Base outside the Watershed. The production and use of water for Camp Pendleton are shown on Appendix Table A-8.

Beginning in December 2008, all wastewater for Camp Pendleton is treated at the Southern Region Tertiary Treatment Plant replacing the regional treatment Plant Nos. 1, 2, 3, and 13. On March 11, 2009, the Regional Water Quality Control Board issued Order No. R9-2009-0021 for a Master Reclamation Permit for the Camp Pendleton Southern Region Tertiary Treatment Plant. Wastewater effluent is discharged to either: (1) approved areas for use of reclaimed water for irrigation purposes; or (2) the Oceanside Outfall under NPDES Permit No. CA0109347, Order No. R9-2003-0155, and Order No. R9-2008-0096. The approved areas for use of reclaimed water are located both within and outside the Watershed. In Water Year 2011-12, the total amount of reclaimed wastewater for Camp Pendleton was 2,788 acre feet as shown on Appendix Table A-8. A total of 393 acre feet were reclaimed for irrigation purposes entirely for use outside the Watershed. An additional 2,395 acre feet of reclaimed wastewater were exported by Camp Pendleton to the Oceanside Outfall.

Production and estimated use inside and outside the Watershed, as well as wastewater reclamation and use, are shown in Appendix B for the period 1966 to 2012. It is noted, the format and reporting shown on Appendix Table B-9 were changed for the Annual Watermaster Report for Water Year 2008-09. Prior reports show for the period 1966 through 2003 reclaimed use inside the Watershed reported as recharged wastewater from ponds and recharge areas. In addition, the prior reports distinguished the source of the recharged wastewater between wastewater treated within or outside the Watershed at the various regional treatment plants. The format and reporting for Water Year 2011-12, on Appendix Tables A-8 and B-9, reflect current and anticipated operations for the foreseeable future. Accordingly, the prior format is obsolete and the reader is directed to prior reports from 2008, and earlier, for additional information regarding historical wastewater operations.

U. S. Naval Weapons Station, Fallbrook Annex

The U. S. Naval Weapons Station (NWS) occupies about 9,148 acres northeast of Camp Pendleton. Since 1969, the NWS has relied on imported water delivered via Fallbrook PUD for its supply. Wastewater is exported from the NWS, Fallbrook Public Utility District and the Watershed via an outfall line maintained by Fallbrook PUD with an easement across Camp Pendleton. In 2011-12, 48 acre feet were imported of which nine acre feet of wastewater were exported, as shown on Appendix Table A-9. Imports and use for the period 1966 to 2012 are shown on Appendix Table B-10.

7.3 Indian Reservations

Water use information about the Cahuilla, Pechanga and Ramona Indian Reservations in the Watershed is described in the following sections:

Cahuilla Indian Reservation

In general, domestic water use on the Cahuilla Indian Reservation is not measured; however reports indicate that 330 people reside on the Reservation. These residents use water primarily for domestic purposes. Annual domestic water use, based on 125 gallons per capita per day, amounts to a total annual use of about 46 acre feet from wells listed in Appendix C. In addition, reports indicate Reservation non-irrigated lands are used for the grazing of 500 cattle. Based on a daily requirement of 10 gallons per head per day, the annual use is estimated to be about six acre feet.

The foregoing estimate is for total domestic water use on the Reservation. A portion of this use may not be under Court jurisdiction, but the estimate will be used until individual well production quantities are available to allow determination of the portion under Court jurisdiction. The estimated domestic use and stock watering is included on Table 4.1 under water purveyor production.

An additional five acre feet pumped from well 7S/2E-26B3 were put to commercial use at a casino. This well is located on lands overlying basement complex, which are outside Court jurisdiction.

Under federal law, production from groundwaters within the lands of the Cahuilla Indian Reservation in either the younger or older alluvial deposits, which are a part of the shallow aquifer of the Anza Ground Water Basin, or which are part of the Cahuilla Groundwater Basin, can be considered to be under a federal reserved right, in accordance with Interlocutory Judgment No. 41, which provides as follows in Order No. 3:

IT IS FURTHER ORDERED, ADJUDGED AND DECREED that the United States of America intended to reserve, and did reserve, rights to the use of the waters of the Santa Margarita River which under natural conditions would be physically available on the Cahuilla Indian Reservation, including rights to the use of ground waters, sufficient for the present and future needs of the Indians residing thereon with priority dates of December 27, 1875, for lands transferred by the Executive Order of that date; March 14, 1887, for lands transferred by the Executive Order of that date; December 29, 1891, for lands transferred by the Executive Order of that date.

Pechanga Indian Reservation

On December 21, 2006, the Pechanga Band of Luiseño Mission Indians and Rancho California WD entered into a Groundwater Management Agreement for the Wolf Valley Groundwater Basin. The Pechanga Band and Rancho California WD agreed to jointly manage groundwater pumping from the basin and to manage the basin to protect groundwater resources. Among other things, the agreement provides for Rancho California WD to deliver pumped groundwater from its wells to Pechanga.

During 2011-12, Pechanga received 177 acre feet of delivered groundwater from Rancho California WD. In addition, the Pechanga Water System produced 669 acre feet from wells, and received 329 acre feet of reclaimed wastewater from Eastern MWD, resulting in a total production for Pechanga of 1,175 acre feet. The monthly production and uses for the Pechanga Indian Reservation are shown on Appendix Table A-5. Information about Pechanga Water System wells is shown below:

Well Designation <u>8S/2W</u>	<u>Name</u>	2011 Water Depth <u>Feet</u>	2012 Water Depth <u>Feet</u>	Well Depth <u>Feet</u>	Perforated Interval <u>Feet</u>
29A2	Kelsey	155	130	425	105 - 415
29B10	Eduardo	198	156	697	437 - 687
29B11	Eagle III	162	153	645	275 - 635
29J3	South Boundary	125	144	350	150 - 340
28M5	Cell Tower	113	109	518	372 - 432
					468 - 508
28R1	Ballpark Well	109	104	1,000	126 - 996
19Q1	Zone V Rock 1	58	49	451	210 - 430

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

The total groundwater pumping for the Pechanga Water System wells increased from 632 acre feet in 2010-11 to 669 acre feet in 2011-12. The total pumping in Wolf Valley by Rancho California WD Well Nos. 119, 122 and 211, for both the District's use and for delivery to Pechanga, decreased from 1,731 acre feet in 2010-11 to 1,202 acre feet in 2011-12. Therefore, the total pumping in Wolf Valley, for 2011-12, decreased by 492 acre feet.

The wells listed above are in areas of younger alluvium at ground surface. The depth of the younger alluvium in Wolf Valley was estimated by representatives of Rancho California WD and the United States for Rancho California WD Wells No. 495 (8S/2W-20E) and No. 119 (8S/2W-19J) to be in the range of 120 to 170 feet in depth. Thus, based on available well construction data, some of the production is from the younger alluvium and some from the older alluvium. Under state law, production from the wells that originate in the older alluvium can be considered to be under a groundwater appropriative right or an overlying right, depending on the circumstances at each well.

Under federal law, production from groundwaters that originate in either the younger or older alluvium within the Murrieta-Temecula Groundwater Area can be considered to be under a federal reserved right, in accordance with Interlocutory Judgment No. 41 which provides as follows in Order No. 7:

IT IS FURTHER ORDERED, ADJUDGED AND DECREED that the United States of America intended to reserve, and did reserve, rights to the use of the waters of the Santa Margarita River stream system which under natural conditions would be physically available on the Pechanga Indian Reservation, including rights to the use of ground waters sufficient for the present and future needs of the Indians residing thereon with priority dates of June 27, 1882, for those lands established by the Executive Order of that date; January 9, 1907, for those lands transferred by the Executive Order of that date; August 29, 1893, for those lands added to the Reservation by Patent on that date; and May 25, 1931, for those lands added to the Reservation by Patent of that date.

Production and uses for the Pechanga Indian Reservation for Water Years 1991 to 2012 are shown on Appendix Table B-6.

Ramona Indian Reservation

The Ramona Indian Reservation occupies 560 acres of land of which 321 acres are inside the Watershed. The water supply is provided for domestic use by two individual wells. Total production for 2011-12 is reported as 2.65 acre feet. It has not been determined whether the groundwater production is under Court jurisdiction and thus the estimated water use is not included in the various water use tabulations provided throughout the report.

Under federal law, production from groundwaters contained in shallow aquifer of the Anza Groundwater Basin overlain by lands of the Ramona Indian Reservation within the watershed of the Santa Margarita River can be considered to be under a federal reserved right, in accordance with Interlocutory Judgment No. 41 that provides as follows in Order No. 1:

IT IS ORDERED, ADJUDGED AND DECREED that the United States of America when it established the Ramona Indian Reservation intended to reserve and did reserve rights to the use of the waters of the Santa Margarita River stream system which under natural conditions would be physically available on the Ramona Reservation, including rights to the use of ground waters, sufficient for the present and future needs of the Indians residing thereon with a priority date of December 29, 1891.

7.4 Small Water Systems

There are a number of small water systems for mobile home parks in the Watershed. These range from relatively permanent structures, to those catering to recreational vehicles and campgrounds. Water production from wells is shown on Appendix Table A-11 for Quiet Oaks Mobile Home Park, Hawthorn Water System, Outdoor Resorts Rancho California, Inc., and Jojoba Hills SKP Resort. Data for previous Water Years are shown on Appendix Table B-12.

7.5 Irrigation Water Use

Estimated water production reported by substantial users for irrigation in the Santa Margarita River Watershed is shown on Table 7.1 to be 7,942 acre feet. This quantity includes 7,236 acre feet of well production and 706 acre feet of surface diversion as shown in Appendix C.

**WATERMASTER
SANTA MARGARITA RIVER WATERSHED**

Page Intentionally Blank

SECTION 8 - UNAUTHORIZED WATER USE

8.1 General

From time to time, there are complaints of unauthorized water uses of various types in the Watershed. Such complaints are investigated in accordance with the powers and duties of the Watermaster. The status of the current list of unauthorized uses is described as follows:

8.2 Unauthorized Small Storage Ponds

Many small dams and reservoirs have been constructed on streams in the Watershed. The legal basis for these ponds is described in the 1988-89 Watermaster Report. Basically, the Court has held that storage of water in ponds less than 10 acre feet in capacity and used for stock watering is a valid use of riparian water. The Court has also held that:

The temporary or non-seasonal impoundment by riparian owners for the purpose of providing a head for irrigation or for the purpose of temporarily accumulating sufficient water to make possible efficient irrigation is a proper riparian use of water.

Criteria for determining non-seasonal storage of irrigation water have yet to be developed.

8.3 Rancho California Water District Water Use

A number of unauthorized water use issues raised by the United States are settled so long as the Cooperative Water Resource Management Agreement (CWRMA) between the United States on behalf of Camp Pendleton and Rancho California Water District is in effect.

As further explained in Section 11, many of these issues are described in Appendix F. One area of past concern pertains to Rancho California WD's petition to the State Water Resources Control Board (SWRCB) to change the place of use, type of use and re-diversion facilities in Permit 7032. On April 22, 2009, the SWRCB issued an order and amended Permit 7032 with the desired changes and conditions to resolve concerns by Camp Pendleton and the U. S. Fish and Wildlife Service. The reporting of Vail Lake operations in accordance with Amended Permit 7032 is provided on Table 3.3 and in Section 7.

8.4 Exportation of Treated Wastewater Derived from Native Waters

Camp Pendleton continues to assert that the exportation of treated wastewater, the source of which is the native waters of the Santa Margarita River System, without a legal basis for such exportation is an unauthorized water use. On May 17, 2012, the United States Court of Appeals for the Ninth Circuit issued an Order granting the parties' joint motion to dismiss the appeals in *United States of America and Fallbrook Public Utility District v. Eastern Municipal Water District and Rancho California Water District* (CV 04-8182 CBM (RNBx), United States District Court, Central District of California) and thus the August 4, 2009 Judgment in this case stands. The Watermaster is reviewing the calculations and reporting of exportation of treated wastewater for possible changes in future annual reports.

SECTION 9 - THREATS TO WATER SUPPLY

9.1 General

General threats to the long-term water supply in the Santa Margarita River Watershed, which have been described in previous Watermaster reports, are as follows:

1. High nitrate concentrations in Rainbow Creek, Anza Valley and the Murrieta-Temecula areas.
2. Potential overdraft conditions at various locations in the Watershed.
3. Potentially adverse salt balance conditions in the upper Santa Margarita River area.
4. High concentrations of arsenic, fluoride, and manganese in the Murrieta-Temecula area.
5. Quagga mussel infestation in imported supplies from the Colorado River system.

9.2 High Nitrate Concentrations

In past years, high concentrations of nitrate have been measured in Anza Valley and in Rainbow Creek. Conditions in Anza Valley were generally described in the 1993-94 report. Additional water quality data for Anza Valley have been collected periodically by the Riverside County Department of Health Services and the USGS.

As described in prior Watermaster reports, in 1999 the Regional Water Quality Control Board, San Diego Region (Regional Board) began preparation of a plan for Total Maximum Daily Loads (TMDLs) for Total Nitrogen and Total Phosphorus on Rainbow Creek. On February 9, 2005, the Regional Board adopted an amendment to the Basin Plan to include the Total Nitrogen and Total Phosphorus TMDLs and implementation plan. The State Water Resources Control Board, on November 16, 2005, and Office of Administrative Law, on February 1, 2006, subsequently approved the Basin Plan amendment. The U.S. Environmental Protection Agency granted final approval of the TMDLs on March 22, 2006.

The full plan and implementation programs are presented on the Regional Board's website:

http://www.waterboards.ca.gov/sandiego/water_issues/programs/tmdls/rainbowcreek.shtml.

Recent data show high concentrations of nitrate pose a risk to water supplies from the Murrieta-Temecula Groundwater Area. In January 2006, Western MWD ceased production from the Holiday Well because nitrate concentrations exceeded the Maximum Contaminant Level (MCL) of 45 mg/l. The depth to the top of the perforated interval for the Holiday Well is only 60 feet and the high nitrate concentrations appear to be a result of nearby septic systems and agricultural practices. Concentrations of nitrate for some of the other Western MWD and Rancho California WD wells in the Murrieta-Temecula Groundwater Area have been detected in the range of 20 to 25 mg/l, which is below the MCL. The other Western MWD and Rancho California WD wells have deeper perforated intervals than the Holiday Well.

9.3 Potential Overdraft Conditions

Previous Watermaster reports have noted concerns about overdraft conditions in Anza Valley and in the Murrieta-Temecula Groundwater Area. Previous studies for Anza Valley include 1976 and 1988 reports by the U. S. Geological Survey and a 1990 report by a consultant to Riverside County. No further studies relative to groundwater use in Anza Valley are available. Historical measurements of groundwater levels for Anza Mutual Water Company's Well No. 1 (7S/3E-21G1) located in Anza Valley are plotted in this report on Figure 4.4.

No recent published studies of safe yield are available for the Murrieta-Temecula Groundwater Area. Groundwater resources in the area are managed by Rancho California WD, Western MWD, and the Pechanga Band. Annual groundwater production programs are prepared with the goal of maximizing production within the apparent safe yield of the basin. Each year, groundwater levels and well production combined with other information including water quality, natural and artificial recharge, pump settings, and well construction factors, are used to develop the recommended production programs for several hydrogeologic sub-areas. Production rates are commonly decreased in sub-areas where water levels have declined over several years, and production rates are increased in sub-areas where decline has not occurred. As a final check, the recommended production rates are checked using the groundwater model for the Murrieta-Temecula Groundwater Area.

In addition, Rancho California WD in cooperation with Camp Pendleton is in the process of developing a multi-level groundwater monitoring network, pursuant to the Cooperative Water Resource Management Agreement. The purpose of the network is to collect data for use in assessing safe yield operations. In September 2006, the USGS began drilling and constructing the Pala Park Groundwater Monitoring Well as part of this network. The monitoring well was completed with six piezometers and continuous water level recording devices. In 2009, the groundwater monitoring network was expanded to include the Wolf Valley Monitoring Well previously constructed by the USGS under a cooperative program with the Pechanga Band. Groundwater levels and water quality data for the two monitoring wells are reported in the annual report for the Cooperative Water Resource Management Agreement.

Groundwater level data for three additional wells in the Murrieta-Temecula Groundwater Area are included in this report as Figures 4.1, 4.3 and 4.5. Water levels in the Windmill Well (8S/2W-12H1) located at the eastern part of Pauba Valley declined by 5.3 feet in 2011-12. Water levels in Well 7S/3W-20C9 in the Murrieta Division of Western MWD area rose by 5.0 feet in 2011-12.

Well 8S/2W-29G1 on the Pechanga Indian Reservation in Wolf Valley became dry at the end of 2003-04. The declining water levels in Well 8S/2W-29G1 appear to be attributed to recent relatively dry hydrologic conditions and pumping of the nearby New Kelsey Well. To allow continued monitoring of water levels on the Reservation, Well No. 29G1 has been replaced with Well No. 8S/2W-29B9 which showed water levels rose 1.0 feet in 2011-12.

9.4 Salt Balance

A key issue in management of a groundwater basin is potential build up of salts from imported water supplies and use of reclaimed wastewater. Such a build-up could decrease the usability of waters in a basin. Consideration must be given to measures that allow desalination of water supplies and export of salts from a basin to offset the salt load in water entering the groundwater basin.

The Total Dissolved Solids (TDS) concentration for imported supplies into the watershed is shown on Table 5.3. During 2011-12, the reported TDS concentration ranged from 261 to 459 mg/l as compared to concentrations for 2010-11 ranging from 317 to 496 mg/l. The reduced levels for TDS in 2011-12 are attributed to a greater percentage of the imported supplies derived from the State Water Project compared to supplies from the Colorado River.

The salt balance for the Murrieta-Temecula Groundwater Area is increasingly of interest due to increased imported supplies to meet existing and future demands, and also increased use of reclaimed wastewater for irrigation. The potential salt loading can be illustrated by estimating the total salts imported into the basin by the major purveyors overlying the groundwater area. The net imported supplies for the major purveyors are provided on Table 5.2 and the individual production and use tables are included in Appendix A. Assuming the groundwater area is subject to salt loading from net imports for Eastern MWD, Elsinore Valley MWD, Western MWD (Murrieta Division), and Rancho California WD (Rancho Division); the total net imports for 2011-12 were 51,584 acre feet. It is noted, imports for a portion of the Rancho California WD, Santa Rosa Division, potentially contribute to salt loading for the groundwater area but such contribution is ignored for this illustration. Applying the monthly TDS concentrations from Table 5.3 to the monthly net imports for these major purveyors results in an estimated total annual salt import for 2011-12 of 26,400 tons compared to the estimated salt import of 26,950 tons for 2010-11.

The salt balance for the Murrieta-Temecula Groundwater Area is affected by the export of wastewater from the Watershed. In 2011-12, Elsinore Valley MWD exported 1,205 acre feet of wastewater for treatment outside the Watershed. During 2011-12, Eastern MWD exported 8,025 acre feet of treated wastewater for reuse outside the

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

Watershed and 285 acre feet were exported for operational reasons for discharge to Temescal Creek. Additional treated wastewater may have been exported from the Watershed through recirculation in the system, but such additional amounts have not been determined. At an average TDS concentration of 650 mg/l, there are approximately 1,768 pounds of salt in every acre foot of wastewater. Thus in 2011-12, approximately 8,400 tons of salt were exported by Elsinore Valley MWD and Eastern MWD through the export of 9,515 acre feet of wastewater. For comparison in 2010-11, approximately 9,600 tons of salt were exported with the export of 10,878 acre feet of wastewater.

The use of reclaimed wastewater for irrigation is also a consideration in evaluating the salt balance for the Murrieta-Temecula Groundwater Area. The reuse within the groundwater area does not import additional salts into the Watershed; rather the source of water supply further concentrates the salts in contrast to relatively lower TDS levels for other sources of water supplies. The total use of reclaimed wastewater by Eastern MWD, Rancho California WD, and the Pechanga Band within the Santa Margarita River Watershed for 2011-12 was 5,601 acre feet compared to 6,049 acre feet in 2010-11, and compared to 690 acre feet in 1986-87. Assuming an average TDS concentration of wastewater of 650 mg/l, the salt loading for 5,601 acre feet of reclaimed wastewater is approximately 5,000 tons. It is expected that the use of reclaimed wastewater within the Watershed will increase in the future.

The salt balances of the Murrieta-Temecula Groundwater Area, the Santa Margarita River, and the groundwater basins on Camp Pendleton are affected by operational and maintenance discharges by Rancho California WD from wells into Murrieta Creek, Temecula Creek and Santa Gertrudis Creek. In 2011-12, wells discharged 86 acre feet, as shown below, together with estimated total dissolved solids for each well. Additional water quality data for the wells are provided in Appendix D.

Well No.	Release Acre Feet	TDS mg/l	Sample Date
101	11	650	9/13/12
106	1	430	4/09/12
108	53	380	5/02/12
118	<u>21</u>	640	6/12/12
Total	86		

The salt balances for the Santa Margarita River, and the groundwater basins on Camp Pendleton, are also influenced by discharges by Rancho California WD of imported supplies into Santa Margarita River as part of make-up flows under the Cooperative Water Resource Management Agreement. During 2011-12, the discharge of imported supplies to the Santa Margarita River as make-up flows and testing for the proposed WR-34 Hydroelectric Power Generation Facility was 3,622 acre feet.

Trend analyses of TDS levels from groundwater samples throughout the Murrieta-Temecula Groundwater Area show a mix of increasing and decreasing trends depending upon location and aquifer. A more detailed study should be conducted to analyze available data and develop a comprehensive regional salinity management plan. Rancho California WD and Eastern MWD are preparing the Temecula Valley Groundwater Basin Salt and Nutrient Management Plan with an anticipated completion in 2014. The plan is being prepared pursuant to the State Water Resources Control Board Recycled Water Policy adopted by Resolution No. 2009-0011 on February 3, 2009, as amended by Resolution No. 2013-0003 on January 22, 2013.

The TDS levels from groundwater samples throughout the groundwater basin on Camp Pendleton also show varied increasing and decreasing trends depending on location and sub-basin. Figure 10.2 shows the historical concentration for Camp Pendleton Well 7A2, located in the Upper Sub-basin. In November 2012, Camp Pendleton completed the Salt and Nutrient Management Plan, Southern MCB Camp Pendleton, also prepared pursuant to the State Water Resources Control Board Recycled Water Policy cited above.

9.5 High Arsenic Concentrations

The maximum contaminant level (MCL) for arsenic is 10 ug/l. High concentrations of arsenic have been detected in groundwater wells for both the Murrieta Division of Western MWD and Rancho California WD, posing a risk to water supplies in the Murrieta-Temecula Groundwater Area. In November 2007, Western MWD ceased pumping from the New Clay Well due to arsenic levels exceeding the MCL. Pumping from the New Clay Well resumed in September 2012, under an approved monitoring plan after Western MWD completed well renovation measures.

The elevated arsenic levels have significantly impacted groundwater pumping and distribution system operations for Rancho California WD. Two wells have been taken out of production due to arsenic levels exceeding the MCL. In 2011-12, three other wells showed levels exceeding the MCL with the wells still in operation under approved blending plans. Two additional wells showed levels approaching the MCL and may be included in a blending plan in the future.

9.6 High Fluoride Concentrations

The MCL for fluoride is 2 mg/l, and samples exhibiting high concentrations of arsenic often show high concentrations of fluoride in the Murrieta-Temecula Groundwater Area. High levels of fluoride are impacting operations for Rancho California WD. In 2011-12, two wells showed fluoride levels exceeding the MCL with the wells in operation under approved blending plans.

9.7 High Manganese Concentrations

The MCL for manganese is 50 ug/l, and high concentrations of manganese have been detected in wells for both the Murrieta Division of Western MWD and Rancho California WD. In 2011-12, two Rancho California WD wells showed manganese levels exceeding the MCL with the wells in operation under approved sequestering plans.

9.8 Quagga Mussel

In early January 2007, the invasive, non-native Quagga mussel was discovered in Lake Mead. Subsequently, upon thorough inspection, MWD discovered the mussel throughout the Colorado River Aqueduct system including in August 2007, finding the mussels in Lake Skinner. To date, no mussels have been found in Diamond Valley Lake.

The Quagga mussel is indigenous to the Ukraine and was discovered in the United States in September 1989 with the first sighting in the Great Lakes. The Quagga mussel is a small freshwater mollusk ranging in size from microscopic in the embryonic state to about two inches in length at the adult stage. The mussels can be transported during the larval stage with currents or running water, and at the adult stage by attaching to hard surfaces such as boats.

The Quagga mussel is a filter feeder removing food and nutrients from the water column, decreasing the food source for zooplankton and therefore, altering the food web. The filtration of the water also alters water clarity impacting aquatic plants and water chemistry. The economic impact is also significant because these species can rapidly colonize on hard surfaces, clogging water intake structures, pipes, and screens and reducing pumping and distribution capacities. Costs are also associated with maintenance of facilities and control of the species.

Since the discovery of Quagga mussels in the Colorado River Aqueduct and Lake Skinner, MWD has implemented various control activities. In July 2007, the aqueduct was shut down for ten days for inspection, chlorination, and removal of adult populations. Also in July 2007, MWD initiated continuous chlorination in the Colorado River Aqueduct to control the spread of Quagga mussels. Additionally, as part of ongoing maintenance activities for the Colorado River Aqueduct, MWD subsequently shut down the aqueduct in October, January and March 2008, October 2009, and April and May 2010, for approximately three weeks each shutdown, resulting in desiccation of Quagga mussels present at those times. Releases from Lake Skinner are chlorinated at the outlet tower prior to distribution through the raw water delivery system.

Effective October 10, 2007, Assembly Bill 1683 added Section 2301(a)(1) to the California Fish and Game Code prohibiting the release of Quagga mussels into the waters of the State. Assembly Bill 1683 also requires development of a Quagga mussel control plan. On December 8, 2007, MWD temporarily suspended required releases of water to Tualota Creek from Lake Skinner and Warm Springs Creek from the San Diego Canal near Diamond Valley Lake. These required releases would have been made in accordance with Memoranda of Agreement for releasing native inflows from the reservoirs. On March 6, 2008, MWD provided notice to the parties in *United States of America v. Fallbrook Public Utility District, et al.*, regarding the temporary suspension of required releases of native water inflows from Lake Skinner and Diamond Valley Lake. On June 23, 2008, MWD provided notice to the parties in *United States of America v. Fallbrook Public Utility District, et al.*, regarding the resumption of required releases of native water inflows from Lake Skinner and Diamond Valley Lake, according to MWD's Action Plan submitted to California Department of Fish and Game on May 30, 2008. On April 5, 2010, the California Department of Fish and Game approved the Quagga Mussel Control Plan for Lake Skinner. MWD is still operating under the May 30, 2008 Action Plan and June 23, 2008 Notice describing provisions for releases to Warm Springs Creek from the State Water Project Eastside Pipeline to meet release requirements at Diamond Valley Lake.

Infestation by the Quagga mussel has also altered Rancho California WD operations in accordance with the Cooperative Water Resource Management Agreement. Beginning on April 10, 2008, Rancho California WD periodically ceased making releases of raw water from Turnout WR-34 on the MWD Pipeline No. 5 to meet make-up flow requirements for the Santa Margarita River. Alternatively, Rancho California WD releases make-up flows from its treated water distribution system at the System River Meter located just upstream of the Murrieta Creek at Temecula gaging station, or from the potable connection to the WR-34 discharge location. The treated water is de-chlorinated prior to release into Murrieta Creek.

On July 17, 2009, Rancho California WD submitted its Quagga mussel response and control action plan to the California Department of Fish and Game. Key components of the plan include:

- Raw MWD water is released into the Santa Margarita Watershed only when chlorination is being performed at Lake Skinner.
- All watercraft vessels, trailers, and equipment are being inspected before launching in Vail Lake.

In addition, Rancho California WD is developing a Quagga mussel response and control plan for the Vail Lake Conveyance System to deliver imported supplies for storage in Vail Lake.

**WATERMASTER
SANTA MARGARITA RIVER WATERSHED**

Page Intentionally Blank

SECTION 10 - WATER QUALITY

10.1 Surface Water Quality

The USGS collected continuous water quality measurements for dissolved oxygen, pH, specific conductance, and temperature at the Santa Margarita River near Temecula gaging station during 2011-12. Data collected at the station are published by the USGS. The highest average daily high and the lowest average daily low for each parameter for each month are shown on Table 10.1 for months in Water Year 2012.

Surface water quality data collected by the USGS in 2004-05 for Cahuilla Creek are shown on Appendix Table D-12. No surface water quality data for Cahuilla Creek was collected in 2011-12.

Surface water quality data collected in prior years by Camp Pendleton, Eastern MWD, and Rancho California WD are listed in earlier Watermaster reports.

10.2 Groundwater Quality

During 2011-12, water quality data was collected from wells at Western MWD – Murrieta Division, Rancho California WD, Pechanga Indian Reservation, and Camp Pendleton.

Western MWD – Murrieta Division sampled three wells in 2011-12 as shown in Appendix D-3. Two of the wells were each subjected to standard chemical analysis in addition to samplings for nitrates only. The third well was sampled for nitrates only. The North Well was sampled 27 times and included 13 samples subjected to standard chemical analysis. Concentrations of nitrates were below the Maximum Contaminant Level (MCL) of 45 mg/l as nitrate for samples in the three wells was generally reported to be below or near the laboratory detection limit with the highest reported value as 1.6 mg/l.

Water quality data for Rancho California WD wells are shown on Appendix Table D-4. Samples were collected from 43 wells during 2011-12. Of the 43 wells, 25 wells were analyzed for nitrates and TDS only. Nitrate concentrations ranged up to 21 mg/l as nitrate, with the MCL being 45 mg/l as nitrate. Fifteen of the remaining wells were subjected to standard chemical analysis, 38 wells were sampled for TDS only, and 13 wells were sampled for nitrates only. Samples from one well (Well 109) showed TDS concentrations exceeding 750 mg/l, the Basin Plan objective. Well 158, which showed TDS concentrations exceeding 750 mg/l in prior years, showed reduced TDS concentrations for 2011-12, ranging from 460 to 570 mg/l. During 2011-12, 16 wells showed TDS concentrations ranging from 500 to 750 mg/l.

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE 10.1

SANTA MARGARITA RIVER WATERSHED

RANGES IN AVERAGE DAILY CONCENTRATION
OF DISSOLVED OXYGEN, PH, SPECIFIC CONDUCTANCE AND TEMPERATURE
AT SANTA MARGARITA RIVER NEAR TEMECULA


Water Year 2011-12

COLLECTION MONTH/YEAR	DISSOLVED OXYGEN mg/l		pH		SPECIFIC CONDUCTANCE microsiemens/cm		TEMPERATURE Deg C	
	High	Low	High	Low	High	Low	High	Low
2011								
October	8.7 *	4.1 *	7.8 *	7.2 *	1,180 *	461 *	23.1 *	16.0 *
November	9.9 *	4.1 *	7.7 *	7.2 *	1,500 *	271 *	19.0 *	10.1 *
December	11.0	8.3	8.2	7.4	1,380	274	21.7	7.8
2012								
January	11.5	9.0	8.1	7.5	948	501	13.2	10.4
February	11.2	8.7	8.2	7.5	1,220	286	13.8	8.6
March	10.5	7.5	8.1	7.3	1,230	142	20.8	8.7
April	10.7	6.8	8.2	7.2	1,030	157	22.2	11.2
May	10.1	7.3	8.4	7.7	837	703	23.2	17.9
June	8.7	7.0	8.1	7.6	815	671	23.9	21.5
July	8.7 *	7.1 *	8.1 *	7.7 *	840 *	727 *	24.9 *	22.4 *
August	8.9 *	6.6 *	8.2 *	7.6 *	790 *	636 *	24.6 *	23.0 *
September	8.6	7.0	8.1	7.5	728	632	24.4	21.4

* - Partial Record: Indicates months with interruptions in record at times due to malfunction of recording equipment. High and low values indicated for days with reported data. Daily data and number of days with no record can be viewed at the following website: http://web10capp.er.usgs.gov/adr06_lookup/search.jsp searching by site number 11044000

Total dissolved solids concentrations for Rancho California WD Well 210 are shown on Figure 10.1 for samples collected since 1957, when the well was constructed. The figure shows a decline in TDS from approximately 900 mg/l for the samples collected during the 1960's to the 500-600 mg/l range in recent years. Trend analyses for other wells throughout the Murrieta-Temecula area show a mix of increasing and decreasing trends in TDS levels depending upon location and aquifer.

FIGURE 10.1

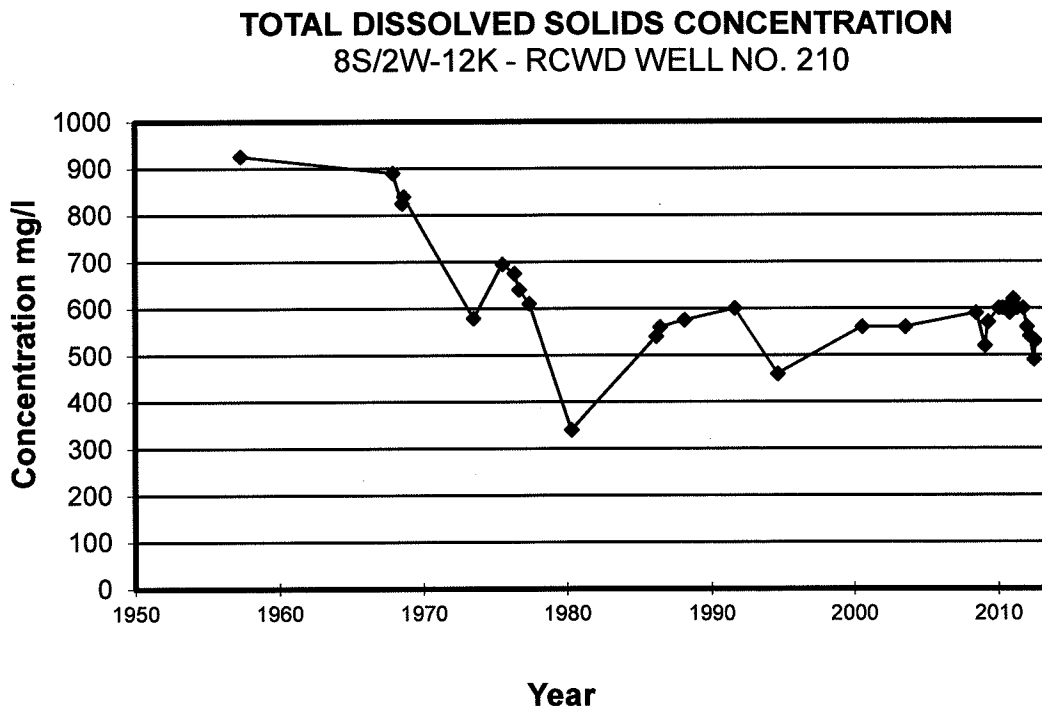

Appendix Table D-5 shows water quality data collected by the USGS from wells on Indian Reservations. In 2011-12, samples were collected from four wells on the Pechanga Indian Reservation. For the Pechanga wells, TDS concentrations ranged from 245 to 300 mg/l, showing a decrease from the prior years.


In 2011-12, no samples were collected from wells on the Cahuilla Indian Reservation.

During 2011-12, groundwater samples were collected from 12 wells at Camp Pendleton as shown on Appendix Table D-6. All 12 wells were subjected to standard chemical analysis. During 2011-12, samples show 11 wells with TDS concentrations exceeding the Basin Plan Objective of 750 mg/l. Seven of the 12 wells showed TDS concentrations that exceeded those in the prior year, and two wells showed a decline of TDS concentrations compared to the previous year. Three wells showed the same concentration as the previous year.

Historical TDS concentrations for Camp Pendleton Well 7A2 are shown on Figure 10.2 for samples collected since mid-1950. The figure shows a decline between mid-1950 and 1970, then a period of increasing concentrations to levels in the 550-950 mg/l range. Analysis of the sample collected in 2011-12 indicated TDS concentrations of 790 mg/l, an increase of 10 mg/l compared to the sample taken last year.

FIGURE 10.2


TOTAL DISSOLVED SOLIDS CONCENTRATION
10S/4W-7A2 - CAMP PENDLETON

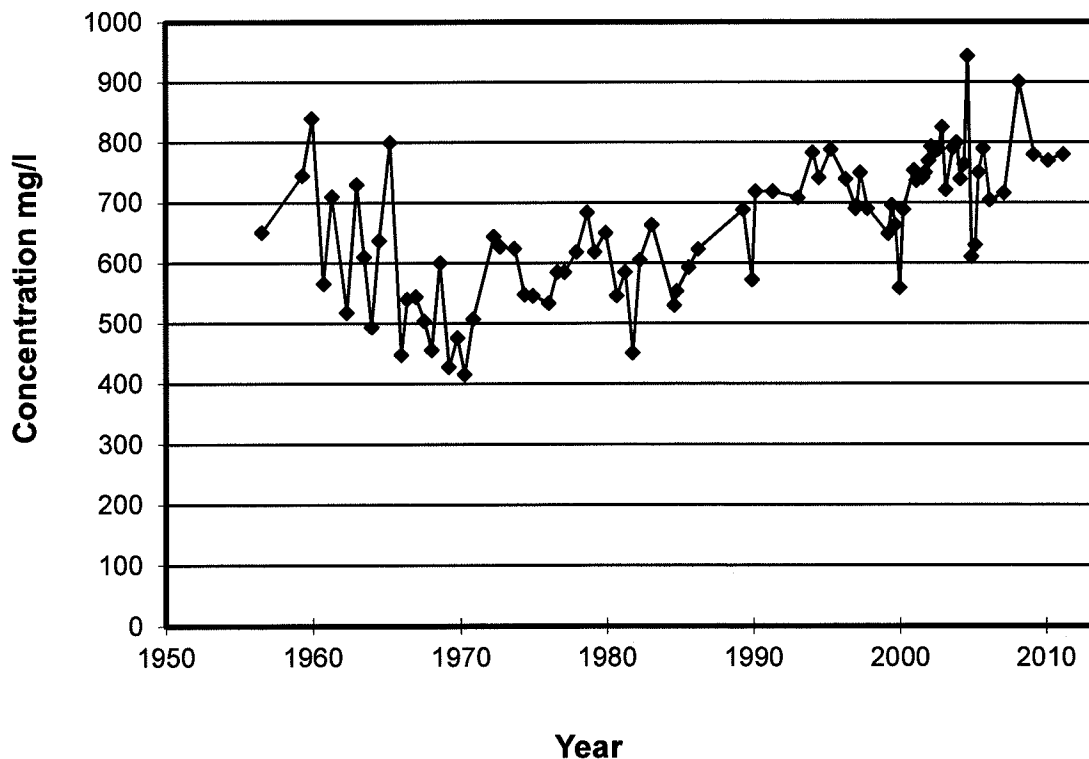

Historical nitrate concentrations for the same well (7A2) are shown on Figure 10.3. The one sample collected in 2011-12 showed a nitrate concentration of 6.2 mg/l, an increase from the prior year.

FIGURE 10.3

NITRATE CONCENTRATION
10S/4W-7A2 - CAMP PENDLETON

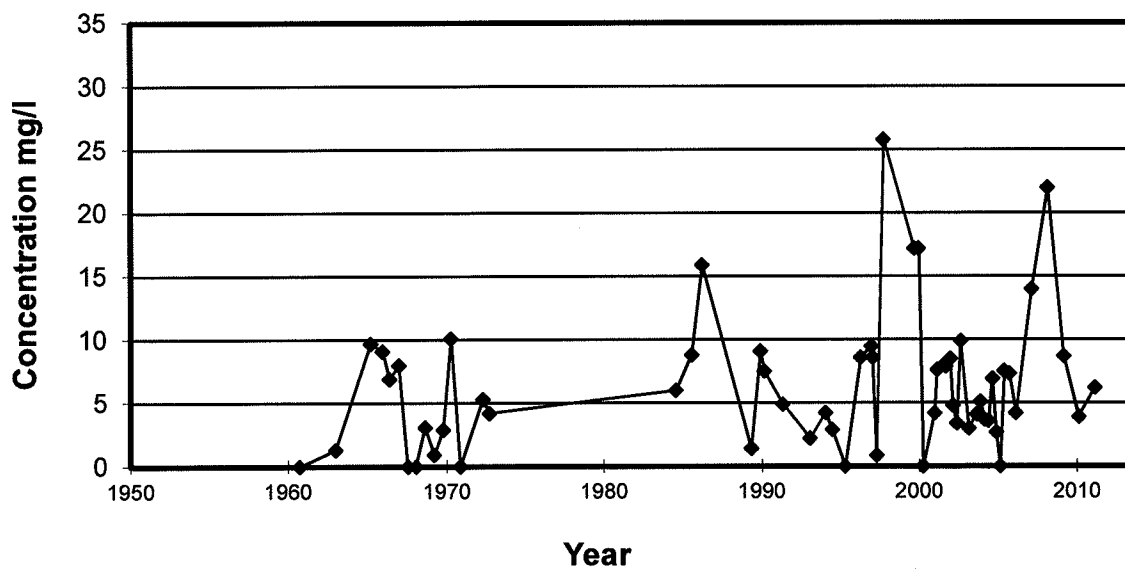

**WATERMASTER
SANTA MARGARITA RIVER WATERSHED**

Page Intentionally Blank

SECTION 11 – COOPERATIVE WATER RESOURCE MANAGEMENT AGREEMENT

11.1 General

On August 20, 2002, the Cooperative Water Resource Management Agreement (CWRMA) between Camp Pendleton and Rancho California WD was approved by the District Court. The CWRMA provisions specify required accounting will be reported on a calendar year basis and, accordingly, Section 11 and Appendix E present data reported on a calendar year basis. However, the remainder of the Annual Watermaster Report is prepared on a water year basis requiring the CWRMA calendar year reporting to be converted to a water year basis to be incorporated into other sections of the report. The water year period begins on October 1 and concludes on September 30 of the following year.

It is noted that prior Annual Watermaster Reports served as the annual report required under CWRMA. Beginning in calendar year 2011, a separate annual report has been prepared and submitted to the Court to meet the requirements of CWRMA. Section 11 continues to be included in the Annual Watermaster Report focusing on the accounting and operations related to make-up water releases and flow requirements for the Santa Margarita River at the Gorge. Section 11 also includes an overview of other topics included in the stand-alone Annual CWRMA Report.

The CWRMA provides that on May 1 of each year, the Technical Advisory Committee is to compute a hydrologic index for the year based on streamflow and precipitation between October and April. In May 2012, the hydrologic index was determined and the year classified as a “Critically Dry” hydrologic year. The hydrologic year establishes the required flows at the Santa Margarita River near Temecula gaging station for the calendar year. Required flows for 2011-12, a “Critically Dry” year, are listed in Section 5 of the CWRMA and are shown on Table 11.1.

As indicated above, CWRMA calendar year accounting must be converted to a water year basis for other sections of the annual report. The data for October through December 2011 for the various accounts are needed to convert the amounts shown on Table 11.1 to water year values. These data for October through December 2011 were reported in the prior year Annual Watermaster Report. To assist the reader in calculating water year amounts for various CWRMA operations, Table 11.2 in the current report is a repeat of Table 11.1 from the prior year’s report. Additional information concerning the operations underlying the values reported on Table 11.2 can be found in the prior year’s report.

TABLE 11.1

SANTA MARGARITA RIVER WATERSHED
MONTHLY SUMMARY OF REQUIRED FLOWS,
DISCHARGES, CREDITS AND ACCOUNTS
COOPERATIVE WATER RESOURCE MANAGEMENT AGREEMENT
2012 CALENDAR YEAR - CRITICALLY DRY YEAR

Month	USGS Official Discharge AF	USGS Website Daily Discharge AF	Minimum Flow Maintenance Requirement cfs /1, 2	Section 5 Flows cfs /3	No. of Days 10- Day Running Average is Less Than Required Flow	Discharge from WR-34 AF /4, 5, 6	Climatic Credits Earned AF /7	Camp Pendleton Groundwater Account /8 Input AF	Cumulative Balance AF
Jan	686.3	686.3	10.9	4.5	0	608.6	372.3	37.9	5,000.0
Feb	900.1	900.1	10.9	4.5	0	477.7	285.1	35.4	5,000.0
Mar	1,672.1	1,672.1	10.9	4.5	0	448.2	255.5	37.9	5,000.0
Apr	728.9	731.3	10.9/5.0/3.8	4.5	0	313.5	334.9	36.6	5,000.0
May	314.0	314.8	3.8/7.8	3.8	0	285.2	0.0	0.0	5,000.0
June	331.6	331.6	7.3/3.3	3.3	0	314.4	0.0	0.0	5,000.0
July	190.2	190.2	3.0	3.0	0	178.0	0.0	0.0	5,000.0
Aug	185.5	185.5	3.0	3.0	0	179.1	0.0	0.0	5,000.0
Sept	178.5	178.5	3.0	3.0	0	180.6	0.0	0.0	5,000.0
Oct	189.6	189.6	3.0	3.0	0	178.1	0.0	0.0	5,000.0
Nov	179.1	179.1	3.0	3.0	0	163.6	0.0	0.0	5,000.0
Dec	860.0	860.0	3.3	3.3	0	107.3	0.0	0.0	5,000.0
CALENDAR YEAR TOTAL	6,415.9	6,419.1			0	3,434.3	1,247.8	147.8	FULL

Monthly totals are rounded to the nearest tenth of an acre foot.

- 1 - Required flows for January-April are equal to 11.5 cfs, less 0.6 cfs CAP Credit from 2011.
- 2 - In April, Camp Pendleton requested that the District reduce remaining winter-time releases and postpone that portion of the winter-time releases until May and June. For April 12-23, 2012, the Flow Requirement was reduced from 10.9 cfs to 5.0 cfs; for April 24-30, 2012, the requirement was further reduced to 3.8 cfs. For April, the District has been credited with Climatic Credit as if they had released according to the original schedule.
- 3 - The Table in Section 5 of the CWRMA sets forth guaranteed monthly flows at the Gorge once the Hydrologic Condition for the calendar year is established. 4 - CAP Credits equals WR-34 discharge in excess of 4,000 AF. No CAP Credits earned in 2012.
- 5 - From March 16-23, 2012, and from October 19-27, 2012, a portion or all of the daily releases were provided from the District's potable connection at the WR-34 pipeline. March potable releases were 65.8 AF, and October potable releases were 45.0 AF, for a total 2012 potable release of 110.8 AF.
- 6 - From August 6-19, 2012, and from November 19-December 12, 2012, the District conducted flow tests in which the instantaneous release rate at WR-34 varied from 0 to 13 cfs throughout the day. However, the average daily release rate remained at 3.0 cfs.
- 7 - Climatic Credits equal the WR-34 discharges less actual Flow Requirements, which is the flow indicated in Section 5 of the CRWMA less applicable credits but not less than 3.0 cfs.
- 8 - Camp Pendleton's rights to groundwater equals the Flow indicated in Section 5 of the CWRMA less the Actual Flow Maintenance Requirement, which cannot be less than 3.0 cfs. Input to groundwater account shown but cumulative balance did not increase due to account balance maximum of 5,000 AF.

TABLE 11.2

SANTA MARGARITA RIVER WATERSHED

MONTHLY SUMMARY OF REQUIRED FLOWS,
DISCHARGES, CREDITS AND ACCOUNTS
COOPERATIVE WATER RESOURCE MANAGEMENT AGREEMENT

2011 CALENDAR YEAR - VERY WET YEAR

Month	USGS				No. of Days 10-		Climatic Credits Earned AF /7	Camp Pendleton Groundwater Account /8	
	USGS Official Discharge AF	Website Daily Discharge AF	Minimum Flow Maintenance Requirement cfs /1, 2	Section 5 Flows cfs /3	Day Running Average is Less Than Required Flow/4	Discharge from WR-34 AF /5, 6		Input AF	Cumulative Balance AF
Jan	1,107.0	1,112.1	9.8	24.1	0	266.6	0.0	774.7	5,000.0
Feb	4,849.8	4,859.9	9.8	24.1	0	286.1	0.0	699.8	5,000.0
Mar	2,673.3	2,673.3	9.8	24.1	0	159.3	0.0	774.7	5,000.0
Apr	593.3	593.5	9.8	24.1	0	403.9	0.0	749.8	5,000.0
May	700.2	708.1	11.5	15.7	0	652.1	0.0	258.2	5,000.0
June	682.3	684.3	11.5	12.2	0	688.4	0.0	41.7	5,000.0
July	557.8	554.6	9.7/4.3	9.7	0	607.5	0.0	64.3	5,000.0
Aug	266.4	266.4	4.4	9.2	0	277.9	0.0	295.1	5,000.0
Sept	362.4	331.8	4.1	9.4	0	318.7	0.0	315.4	5,000.0
Oct	282.0	282.0	3.9	10.1	0	243.6	0.0	381.2	5,000.0
Nov	678.7	678.7	4.5	11.5	0	142.3	0.0	416.5	5,000.0
Dec	591.5	591.5	5.3	13.5	0	249.1	0.0	504.2	5,000.0
CALENDAR									
YEAR									
TOTAL	13,444.7	13,336.2			0	4,295.5	0.0	5,275.6	FULL

Monthly totals are rounded to the nearest tenth of an acre foot.

1 - Required flows for January-April are equal to 11.5 cfs, less 1.7 cfs CAP Credits from 2009.
 2 - On July 25, 2011, Camp Pendleton requested to forego the makeup by reducing the minimum Flow Requirements from Very Wet to Below Normal for the remainder of the year, effective July 26, 2011. Additionally, a 14-day Flow Test was conducted by RCWD from August 24 - September 6, 2011, in which releases were varied from zero to 13 cfs during the test period. RCWD actually released an additional 60.4 AF during that period that is not shown.

This quantity has been excluded from the accounting of flows and credits.

3 - The Table in Section 5 of the CWRMA sets forth guaranteed monthly flows at the Gorge once the Hydrologic Condition for the calendar year is established.

4 - During 8 days in August, the 10-day running average dropped below 4.4 cfs due to RCWD's Flow Test.

5 - CAP Credits equal WR-34 discharge in excess of 4,000 AF. CAP Credits earned in 2011 equal 296 AF.

6 - An additional 60.4 AF were discharged from WR-34 during the RCWD Flow Test in excess of CWRMA Flow Requirements.

7 - Climatic Credits equal the WR-34 discharge less actual Flow Requirements, which is the flow indicated in Section 5 of the CRWMA less applicable credits but not less than 3.0 cfs. No Climatic Credits can be earned during a Very Wet Year.

8 - Camp Pendleton's rights to groundwater equals the Flow indicated in Section 5 of the CWRMA less the Actual Flow Maintenance Requirement, which cannot be less than 3.0 cfs. Input to groundwater account shown but cumulative balance did not increase due to account balance maximum of 5,000 AF.

Prior to implementation of the CWRMA, each year there were contentions raised by Camp Pendleton with respect to various aspects of the Annual Watermaster Report. These contentions are settled so long as that agreement is in effect. Accordingly, there is no need to raise those particular issues or publish them in the main text of the annual report or in related correspondence. Rather, the issues are provided in Appendix F.

11.2 Required Flows

Under the CWRMA, Rancho California WD guarantees that the ten-day running average of the measured flows at the Santa Margarita River near Temecula gaging station shall meet the Required Flows for each month during the year. In order to meet the Required Flows, Rancho California WD discharges Make-Up Water from two primary sources, both discharging into the river at the same location immediately upstream from the USGS gaging station for Santa Margarita River near Temecula. The first primary source of Make-Up Water is raw water from MWD Aqueduct No. 5 discharged at Outlet WR-34. The second primary source of Make-Up Water is from the Rancho California WD treated water distribution system through a potable connection to the WR-34 outlet pipe. In prior years, Make-Up Water was also discharged from the treated water distribution system to Murrieta Creek from two system discharge meters collectively referred to as the System River Meter. The two discharge meters are located on opposite sides of Murrieta Creek, immediately downstream of the USGS gaging station for Murrieta Creek at Temecula, which is located approximately 2,000 feet upstream of the confluence of Temecula Creek and Murrieta Creek. The System River Meter is operable as a secondary source of Make-Up Water if needed.

Flow requirements are based on two-thirds of the median natural flow of the Santa Margarita River at the Gorge for a given hydrologic year type. During the winter period (January through April), Rancho California WD shall maintain a ten-day running average equal to 11.5 cfs, less carry-over credits, less requested Foregone Make-Up Water, but not less than 3.0 cfs. Rancho California WD may earn Climatic Credits in Below Normal and Critically Dry years if it has provided Make-Up Water in excess of the Actual Requirement. The Climatic Credit is equal to the Make-Up Water released less the Actual Requirement less credits. The Actual Requirement is determined on May 1 of each year and applied retroactively to the flows during the winter period. During the non-winter period (May through December), Rancho California WD shall maintain a ten-day running average equal to the flow requirements specified in the Agreement as determined on May 1st, less requested Foregone Make-Up Water. When Rancho California WD is required to provide Make-Up Water in any calendar year in excess of 4,000 acre feet, it may apply CAP Credits for such excess during the following two winter periods. At no time is Rancho California WD required to make up more than 11.5 cfs.

The measured daily flows, the ten-day running average, and the differences between the running average and the Required Flows are shown in Appendix E. Two listings of daily discharges are shown in the tables in Appendix E: the USGS official discharge and the USGS website discharge. The discharges shown on the website are those that dictate daily decisions regarding the quantities of Make-Up Water required and those discharges are used to compute the ten-day running average. The official discharge is a more refined estimate developed later by the USGS for publication.

During calendar year 2012, Rancho California WD conducted flow tests for the proposed WR-34 Hydroelectric Power Generation Facility. The proposed facility involves installation of power generation equipment at the existing WR-34 Outlet and modification of the hourly Make-Up Water releases. The ten-day running average and volumetric flow requirements under CWRMA would not be changed. The flow tests were conducted from August 6 through 19, 2012, and from November 19 through December 12, 2012, in which the instantaneous release rate at WR-34 varied from zero to 13 cfs throughout the day. However, the average daily release rate remained at 3.0 cfs. The operations during the flow tests are reflected on Table 11.1 and the monthly tables included in Appendix E.

The number of days each month when the ten-day running average was less than the Required Flow is summarized on Table 11.1. For calendar year 2012, there were no days when the running average was less than the required flow under normal CWRMA operations.

During calendar year 2012, the total releases by Rancho California WD to meet CWRMA flow requirements were 3,434 acre feet as shown on Table 11.1. The releases were comprised of 3,323 acre feet of raw water from WR-34 and 111 acre feet from the potable connection at WR-34. The releases of potable supplies during the periods March 16 through March 23, and October 19 through October 27, and were due to the MWD operational shutdowns of the raw water line at WR-34.

No Climatic Credits were used in calendar year 2012 and Climatic Credits of 1,248 acre feet were earned in calendar year 2012 in accordance with CWRMA provisions. CAP Credits of 148 acre feet were used in calendar year 2012 and no CAP Credits were accumulated in calendar year 2012 for use in subsequent years to meet required releases by Rancho California WD. The remaining CAP Credits balance of 148 acre feet may be applied in 2013.

The CWRMA also provides that Camp Pendleton may acquire rights to groundwater above the gorge by foregoing its right to Make-Up Water from the District, or to the extent that the District's Actual Flow Maintenance requirements are less than the flows in the table in Section 5 of the CWRMA. The maximum cumulative balance for the Camp Pendleton groundwater account is 5,000 acre feet. During calendar year 2012, 148 acre feet were calculated as input to the groundwater account but the balance was already at the maximum balance of 5,000 acre feet and no additional water was credited to the account.

11.3 Water Quality

The U. S. Geological Survey continuously monitors four parameters of water quality at the Santa Margarita River near Temecula gaging station, including dissolved oxygen, pH, specific conductance, and temperature. The daily averages for each of these parameters are reported annually. Monthly highs and lows for each parameter are listed in Table 10.1 for the water year ending September 30, 2012.

11.4 Monitoring Programs

The CWRMA provides for the establishment of two monitoring programs: (1) Section 5(g) provides for a program to assess the impacts of operations on water supply, water quality and riparian habitat within Camp Pendleton, and; (2) Section 7(d) provides for a program to assess safe yield operations of Rancho California WD through the use of a multi-level groundwater monitoring network and periodic updates of the CWRMA Groundwater Model.

During 2007-08, Camp Pendleton initiated the Section 5(g) program named as the Lower Santa Margarita River Watershed Monitoring Program (Program) to evaluate whether the increased flows under CWRMA influence threatened and endangered species, riparian and wetland habitats, or water quality downstream. The Program will also support other water quality monitoring and watershed management activities in the Santa Margarita River Watershed. A copy of the Statement of Work for the Lower Santa Margarita River Watershed Monitoring Program was provided in the 2007 and 2008 Annual Watermaster Reports. The monitoring was funded for a two-year period and the final report, *Hydrological and Biological Support to Lower Santa Margarita River Watershed Monitoring Program Water Years 2008-2009* was published on February 21, 2010 under a cooperative program between Camp Pendleton and the United States Bureau of Reclamation.

In September 2006, the USGS under contract with Camp Pendleton and Rancho California WD constructed a multi-level monitoring well for the Murrieta-Temecula Groundwater Basin in accordance with Section 7(d) of CWRMA. The Pala Park Groundwater Monitoring Well is located near the confluence of Pechanga and Temecula creeks and was completed to a total depth of 1,499 feet. Six piezometers were installed for continuous water level recording in the saturated zone for the lower five screened intervals and for the upper-most screened interval to detect moisture in the unsaturated zone. The USGS monitoring program for the Pala Park Groundwater Monitoring Well is included in the ongoing Watermaster budget beginning in Water Year 2007-08.

In 2009, the groundwater monitoring program was expanded to include the Wolf Valley Monitoring Well that was previously constructed under a cooperative agreement between the USGS and the Pechanga Band. Two piezometers are installed at the Wolf Valley Well. Approved Watermaster funding of the water quality monitoring for Pala Park

Well is used for water quality sampling at the Pala Park and Wolf Valley monitoring wells. The groundwater level monitoring for the Wolf Valley Monitoring Well was previously funded by the Pechanga Band, but is now included in the ongoing Watermaster budget beginning in Water Year 2009-10.

Information concerning the construction of the Pala Park and Wolf Valley monitoring wells, groundwater levels, and water quality data can be found at the following website: <http://ca.water.usgs.gov/temecula/>. Information obtained from the website as well as supplemental information for the Pala Park Groundwater Monitoring Well, and the Wolf Valley Groundwater Monitoring Well is provided in the Annual CWRMA Report.

In 2010, 2011, and 2012, the water quality monitoring program also included collecting data for the two sources of supply for recharge at the head of Pauba Valley: (1) imported supplies for recharge at Rancho California WD VDC Recharge Facilities, and; (2) native supplies from Temecula Creek as sampled at Vail Lake. Funding from the Watermaster budget was used to collect and analyze the data which are provided in the Annual CWRMA Report.

In 2012, the water quality monitoring program also included collecting data from selected groundwater production wells operated by Rancho California WD within Pauba Valley. These wells were selected to compliment the water quality data for the monitoring wells and the two sources of supply for recharge at the head of Pauba Valley. Previously, groundwater production wells operated by Rancho California WD were included in the 2004 and 2007 sampling programs for the Groundwater Ambient Monitoring and Assessment (GAMA) program implemented by the California State Water Resources Control Board. Data reported for 2012 were collected with funding from the Watermaster budget.

In 2007, Camp Pendleton and Rancho California WD initiated an effort to update the CWRMA Groundwater Model in accordance with Section 7(d). Work on updating the groundwater model continued during 2012. The update will incorporate data collected from the Pala Park Groundwater Monitoring Well, and other wells in the Murrieta-Temecula Groundwater Basin as well as take advantage of recent software and computing advancements.

**WATERMASTER
SANTA MARGARITA RIVER WATERSHED**

Page Intentionally Blank

SECTION 12 - FIVE YEAR PROJECTION OF WATERMASTER OFFICE TASKS, EXPENDITURES AND REQUIREMENTS

12.1 General

Projected tasks over the next five years are listed below in two categories: normal tasks, which are part of the usual Watermaster office operation; and additional tasks, which are foreseen but are not part of the normal office operations.

12.2 Normal Tasks

Tasks that are normally part of the Watermaster Office operation are as follows:

1. Update List of Substantial Users
2. Collect Water Production, Use, Import and Availability Data
3. Collect Well Location, Construction and Water Level Data
4. Administer Water Rights
5. Collect Water Quality Data
6. Monitor Water Quality and Water Right Activities
7. Administer Lake Skinner and Diamond Valley Lake MOU's
8. Administer Steering Committee Matters
9. Prepare Court Reports/Budgets
10. Monitor Streamflow and Water Quality Measuring
11. Data Management
12. Administer Cooperative Water Resource Management Agreement

12.3 Additional Tasks

Tasks that have been identified but which are not part of normal operations are as follows:

1. Prepare List of All Water Users under Court Jurisdiction
2. Prepare Inventory of Ponds and Reservoirs
3. Determine Salt Balance

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

12.4 Projected Expenditures

Projected expenditures for the current year and over the next five years are listed as follows:

Year		Watermaster Office	USGS Groundwater Monitoring	USGS Gaging Stations	Total
Current Year	2012-13	\$417,375	\$31,300	\$200,925	\$649,600
Projected Years	2013-14	\$419,715	\$65,300	\$173,825	\$658,840
	2014-15	\$432,300	\$84,500	\$179,000	\$695,800
	2015-16	\$445,300	\$104,200	\$184,400	\$733,900
	2016-17	\$458,700	\$124,500	\$189,900	\$773,100
	2017-18	\$472,500	\$145,400	\$195,600	\$813,500

SECTION 13 - WATERMASTER OFFICE BUDGET 2013-2014

A total Watermaster Budget of \$658,840 for the Water Year ending September 30, 2014 is shown below.

This budget includes \$419,715 for the Watermaster Office and \$239,125 for USGS gaging station operations and groundwater monitoring. The budgeted cost for services provided by the U. S. Geological Survey is based on the annual renewal of a cooperative agreement with the Watermaster.

	APPROVED BUDGET CURRENT YEAR 2012-13	PROPOSED BUDGET 2013-14
Watermaster Office		
Rent	\$ 18,000	\$ 18,000
Accounting Services	7,000	8,800
Supplies	1,600	1,800
General Liability & Professional Insurance	500	600
Printing	9,800	10,800
Audit	6,300	6,300
Publications	4,200	4,200
Clerical/Data Management	104,400	99,700
Telephone/Internet	4,700	4,200
Miscellaneous Operating/Maintenance	5,575	5,915
Mileage/Travel	800	900
Office Equipment and Software	2,000	2,000
IT System/Website	10,000	10,000
Watermaster		
Consulting Services	215,000	219,000
Travel Reimbursement	27,500	27,500
SUBTOTAL WATERMASTER OFFICE	\$ 417,375	\$ 419,715
USGS		
Gaging Station Operation and Maintenance	\$ 177,325	\$ 150,225
Water Quality Operation and Maintenance	23,600	23,600
Groundwater Monitoring Wells Water Levels	20,300	43,300
Groundwater Monitoring Wells Water Quality	11,000	22,000
SUBTOTAL USGS	\$ 232,225	\$ 239,125
TOTAL	\$ 649,600	\$ 658,840

SANTA MARGARITA RIVER WATERSHED
ANNUAL WATERMASTER REPORT
WATER YEAR 2011-12

APPENDIX A
WATER PRODUCTION AND USE
WATER YEAR 2011-12

July 2013

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE A-1

SANTA MARGARITA RIVER WATERSHED
MONTHLY WATER PRODUCTION AND USE

EASTERN MUNICIPAL WATER DISTRICT
2011-12
Quantities in Acre Feet

PRODUCTION						USE						RECLAIMED WASTEWATER			
MONTH YEAR	WELLS	IMPORT 1/	EXPORT FROM SMRW 2/	NET IMPORT	TOTAL	AG	COMM	DOM	TOTAL	LOSS 3/	TOTAL USE	REUSE IN SMRW 4/	REUSE OUTSIDE SMRW	OTHER REUSE 5/	TOTAL
2011															
OCT	0	1,514	225	1,289	1,289	10	268	947	1,225	64	1,289	221	690	295	1,206
NOV	0	1,099	0	1,099	1,099	1	198	845	1,044	55	1,099	176	389	658	1,223
DEC	0	788	0	788	788	11	116	622	749	39	788	131	405	732	1,268
2012															
JAN	0	873	0	873	873	14	138	677	829	44	873	146	469	636	1,251
FEB	0	853	0	853	853	1	146	663	810	43	853	85	443	657	1,185
MAR	0	813	0	813	813	12	136	624	772	41	813	104	579	581	1,264
APR	0	911	43	868	868	6	156	663	825	43	868	84	678	444	1,206
MAY	0	1,864	670	1,194	1,194	7	249	878	1,134	60	1,194	161	662	479	1,302
JUNE	0	2,222	418	1,804	1,804	2	410	1,302	1,714	90	1,804	287	876	50	1,213
JULY	0	1,694	0	1,694	1,694	10	404	1,195	1,609	85	1,694	298	937	28	1,263
AUG	0	1,834	0	1,834	1,834	16	440	1,286	1,742	92	1,834	319	990	(52)	1,257
SEPT	0	1,954	0	1,954	1,954	6	476	1,374	1,856	98	1,954	352	907	17	1,276
TOTAL	0	16,419	1,356	15,063	15,063	96	3,137	11,076	14,309	754	15,063	2,364	8,025	4,525	14,914

1/ Does not include deliveries to Rancho California WD, Elsinore Valley MWD or Western MWD.

2/ Portion of imported supplies exported for delivery to Eastern MWD's retail customers located outside the Watershed.

3/ Loss = 5%

4/ No sewage diverted to RCWD for 2012 Water Year for treatment at Santa Rosa Water Reclamation Facility.

Reuse within Watershed includes 549 AF sold to RCWD and 329 sold to Pechanga Band.

5/ Other Reuse includes changes of storage in Winchester and Sun City storage ponds, evaporation and percolation losses, and discharges to Temescal Creek in the Santa Ana Watershed of 285 AF.

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE A-2

**SANTA MARGARITA RIVER WATERSHED
MONTHLY WATER PRODUCTION AND USE**

ELSINORE VALLEY MUNICIPAL WATER DISTRICT

2011-12
Quantities in Acre Feet

MONTH YEAR	PRODUCTION			USE						WASTEWATER EXPORTED
	WELLS	IMPORT	TOTAL	AG	COMM	DOM	TOTAL DELIVERED	LOSS *	TOTAL USE	
2011										
OCT	0	419	419	6	90	311	407	12	419	94
NOV	0	764	764	3	168	570	741	23	764	100
DEC	0	351	351	6	56	279	341	10	351	101
2012										
JAN	0	347	347	1	53	283	337	10	347	98
FEB	0	501	501	1	84	401	486	15	501	100
MAR	0	391	391	1	72	306	379	12	391	100
APR	0	257	257	1	42	206	249	8	257	98
MAY	0	854	854	1	196	631	828	26	854	105
JUNE	0	755	755	1	195	536	732	23	755	99
JULY	0	774	774	2	180	569	751	23	774	109
AUG	0	1,156	1,156	2	353	766	1,121	35	1,156	106
SEPT	0	829	829	2	234	568	804	25	829	95
TOTAL	0	7,398	7,398	27	1,723	5,426	7,176	222	7,398	1,205

* Loss percentage within the Santa Margarita River Watershed is determined using the calculation to determine District-wide unaccounted for water by comparing District-wide annual supply and customer deliveries, and is assumed to be constant for all months.

TABLE A-3
SANTA MARGARITA RIVER WATERSHED
MONTHLY WATER PRODUCTION AND USE
FALLBROOK PUBLIC UTILITY DISTRICT
2011-12
Quantities in Acre Feet

DISTRICT WIDE PRODUCTION										SMRW PRODUCTION				SMRW USE				WASTEWATER			
MONTH YEAR	TOTAL LAKE SKINNER DIVERSIONS		LAKE SKINNER DIVERSIONS DELIVERED	TOTAL DISTRICT IMPORT		TOTAL DISTRICT SUPPLY	SMRW LAKE SKINNER		SMRW IMPORT	TOTAL SMRW PRODUCTION	AG	COMM	DOM	TOTAL DELIVERED IN SMRW	LOSS 4/	TOTAL USE IN SMRW	FROM SMRW	REUSE IN SMRW	FROM U.S. NWS 5/	EXPORT FROM SMRW	
	1/	2/		3/	4/		5/														
2011																					
OCT	0	0	0	1,098	1,098		0	734	734		446	30	198	674	60	734	76	2	0	74	
NOV	0	0	0	554	554		0	544	544		305	27	167	499	45	544	78	1	0	77	
DEC	0	0	0	750	750		0	320	320		151	19	124	294	26	320	84	1	0	83	
2012																					
JAN	0	0	0	821	821		0	508	508		280	44	142	466	42	508	63	1	1	61	
FEB	0	0	0	713	713		0	435	435		228	35	136	399	36	435	76	1	1	74	
MAR	0	0	0	623	623		0	351	351		181	17	124	322	29	351	88	1	1	86	
APR	0	0	0	658	658		0	321	321		147	19	129	295	26	321	80	1	1	78	
MAY	0	0	0	1,117	1,117		0	415	415		226	20	135	381	34	415	82	2	1	79	
JUNE	0	0	0	1,381	1,381		0	769	769		474	24	208	706	63	769	71	2	1	68	
JULY	0	0	0	1,504	1,504		0	909	909		585	34	215	834	75	909	84	3	1	80	
AUG	0	0	0	1,715	1,715		0	879	879		547	31	229	807	72	879	91	3	0	88	
SEPT	0	0	0	1,645	1,645		0	1,069	1,069		691	37	253	981	88	1,069	85	3	2	80	
TOTAL	0	0	0	12,579	12,579		0	7,254	7,254		4,261	337	2,060	6,658	596	7,254	958	21	9	928	

- 1/ Diverted under Permit No. 11356.
2/ Includes 143 acre feet from Capra Well located in San Luis Rey Watershed and remaining supply from San Diego County Water Authority.
3/ A portion of the District is outside the Santa Margarita River Watershed.
4/ Loss percentage within the Santa Margarita River Watershed is determined using the calculation to determine District-wide unaccounted for water by comparing District-wide annual supply and customer deliveries, and is assumed to be constant for all months.
5/ United States Naval Weapons Station.

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE A-4

SANTA MARGARITA RIVER WATERSHED
MONTHLY WATER PRODUCTION AND USE

**METROPOLITAN WATER DISTRICT
DELIVERIES IN DOMENIGONI VALLEY**

2011-12

Quantities in Acre Feet

MONTH YEAR	PRODUCTION				USE					
	WELLS	IMPORT TO SMRW	TOTAL IN SMRW		AG	COMM/ DOM*	GW RECHARGE	TOTAL DELIVERED	LOSS **	TOTAL USE
2011										
OCT	0	44	44		44	0	0	44	0	44
NOV	0	18	18		18	0	0	18	0	18
DEC	0	24	24		24	0	0	24	0	24
2012										
JAN	0	21	21		21	0	0	21	0	21
FEB	0	14	14		14	0	0	14	0	14
MAR	0	20	20		20	0	0	20	0	20
APR	0	54	54		54	0	0	54	0	54
MAY	0	64	64		64	0	0	64	0	64
JUNE	0	58	58		58	0	0	58	0	58
JULY	0	44	44		44	0	0	44	0	44
AUG	0	41	41		41	0	0	41	0	41
SEPT	0	64	64		64	0	0	64	0	64
TOTAL	0	466	466		466	0	0	466	0	466

* Construction water

** Points of delivery located at metered pumps on San Diego Canal
and thus the losses in the MWD system are zero.

TABLE A-5

**SANTA MARGARITA RIVER WATERSHED
MONTHLY WATER PRODUCTION AND USE**

PECHANGA INDIAN RESERVATION

2011-12

Quantities in Acre Feet

PRODUCTION				USE						
MONTH YEAR	WELLS ON RESERVATION 1/	DELIVERED GROUNDWATER FROM RCWD 2/	RECLAIMED WASTEWATER FROM EMWD 3/	TOTAL	AG	COMM	DOM	TOTAL DELIVERED	LOSS 4/	TOTAL USE
2011										
OCT	47	21	37	105	54	31	16	101	4	105
NOV	38	13	6	57	14	31	9	54	3	57
DEC	28	12	2	42	6	25	9	40	2	42
2012										
JAN	36	19	3	58	10	28	10	48	10	58
FEB	37	12	12	61	19	30	12	61	0	61
MAR	30	19	11	60	18	26	12	56	4	60
APR	32	21	21	74	31	24	12	67	7	74
MAY	67	20	49	136	69	39	23	131	5	136
JUNE	67	21	51	139	76	35	24	135	4	139
JULY	97	10	53	160	81	45	28	154	6	160
AUG	93	7	41	141	70	47	27	144	(3)	141
SEPT	97	2	43	142	65	44	33	142	0	142
TOTAL	669	177	329	1,175	513	405	215	1,133	42	1,175

1/ Total production attributed to Eduardo, Eagle III, Kelsey, Ballpark and Zone V Rock 1 wells.

2/ Water provided from Rancho California WD Well Nos. 119, 122, and 211.

3/ Reclaimed wastewater provided by Eastern MWD via Wheeling Agreement with Rancho California WD shown as a component of production for Table A-5 only to illustrate water budget for Reservation. Actual production for Watershed accounted for on Table A-1 and Table 7.1 for Eastern MWD.

4/ Loss determined as Total Production less Total Delivered.

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE A-6

SANTA MARGARITA RIVER WATERSHED
MONTHLY WATER PRODUCTION AND USE

RAINBOW MUNICIPAL WATER DISTRICT

2011-12

Quantities in Acre Feet

MONTH YEAR	PRODUCTION				USE				
	LOCAL	IMPORT TO WATERSHED	TOTAL IN WATERSHED		AG	COMMERCIAL/ DOMESTIC	TOTAL DELIVERIES	LOSS*	TOTAL USE
2011									
OCT	0	243	243		207	14	221	22	243
NOV	0	178	178		153	9	162	16	178
DEC	0	107	107		91	6	97	10	107
2012									
JAN	0	100	100		84	7	91	9	100
FEB	0	96	96		79	8	87	9	96
MAR	0	90	90		76	6	82	8	90
APR	0	120	120		103	6	109	11	120
MAY	0	113	113		97	6	103	10	113
JUNE	0	206	206		174	13	187	19	206
JULY	0	178	178		150	12	162	16	178
AUG	0	210	210		177	14	191	19	210
SEPT	0	251	251		211	17	228	23	251
TOTAL	0	1,892	1,892		1,602	118	1,720	172	1,892

* Loss = 10% of use

TABLE A-7

**SANTA MARGARITA RIVER WATERSHED
MONTHLY WATER PRODUCTION AND USE
RANCHO CALIFORNIA WATER DISTRICT**

2011-12

Quantities in Acre Feet

MONTH YEAR	PRODUCTION					USE							VAIL RELEASE AND RECHARGE 8/	RECLAIMED WASTEWATER REUSED IN SMRW 9/		
	WELLS 1/	EXPORT 2/	NET WELLS	IMPORT 3/	EXPORT 4/	NET IMPORT	TOTAL	AG	AG/ DOM	COMM	DOM	SMR RELEASE 5/			IMPORT RECHARGE TO STORAGE 6/	TOTAL USE 7/
2011																
OCT	1,929	23	1,906	3,669	44	3,625	5,531	2,238	580	419	2,625	252	153	6,267	(736)	5,531
NOV	1,438	23	1,415	1,859	27	1,832	3,247	1,628	406	330	2,057	145	191	4,757	(1,510)	3,247
DEC	2,088	18	2,070	1,750	14	1,736	3,806	961	251	304	1,694	252	110	3,572	234	3,806
2012																
JAN	1,972	24	1,948	2,231	15	2,216	4,164	1,283	333	235	1,369	614	300	4,134	30	4,164
FEB	1,832	17	1,815	2,031	13	2,018	3,833	968	263	260	1,387	479	132	3,489	344	3,833
MAR	1,695	21	1,674	1,849	19	1,830	3,504	1,285	326	297	1,700	448	(51)	4,005	(501)	3,504
APR	1,976	16	1,960	2,084	13	2,071	4,031	718	185	237	1,353	315	56	2,864	1,167	4,031
MAY	2,250	17	2,233	4,211	31	4,180	6,413	1,335	335	296	1,665	285	53	3,969	2,444	6,413
JUNE	2,322	29	2,293	5,365	70	5,295	7,588	2,822	731	392	2,894	326	(59)	7,106	482	7,588
JULY	2,264	25	2,239	5,852	72	5,780	8,019	2,804	692	452	3,014	201	(58)	7,105	914	8,019
AUG	2,828	31	2,797	6,168	77	6,091	8,888	2,991	722	445	3,099	207	(195)	7,269	1,619	8,888
SEPT	2,348	40	2,308	5,326	100	5,226	7,534	3,838	961	550	3,747	184	70	9,350	(1,816)	7,534
TOTAL	24,942	284	24,658	42,395	495	41,900	66,558	22,871	5,785	4,217	26,604	3,708	702	63,887	2,671	66,558
																3,237

1/ Wells recovered 24,942 AF from older alluvium. An additional 177 AF was delivered to Pechanga Indian Reservation and is shown on Table A-5.

2/ Groundwater used in San Mateo Watershed.

3/ Includes 24,282 AF direct use (13,109 AF to Rancho Division and 11,173 AF to Santa Rosa Division); 14,643 AF direct recharge; and 3,470 AF from MWD WR-34.

4/ Import used in San Mateo Watershed.

5/ 32 AF into Murrieta Creek from Wells 101, 102, and 118; 54 AF into Santa Gertrudis Creek from Wells 106 and 108;

6/ 14,643 AF of direct recharge less 13,941 AF of import recovery.

7/ Loss = Total production less total use and includes 137 acre feet pumped from wells 102, 121, 135, 146 and 155 directly into reclaimed water system.

8/ Vail releases and the related Vail recharge are computed as Total Release less Inflow to be bypassed. See Tables 3.3 and 7.4 for explanation of minus 5 AF in 2011-12.

9/ Does not include 549 AF reclaimed wastewater purchased from EMWD.

TABLE A-8

**SANTA MARGARITA RIVER WATERSHED
MONTHLY WATER PRODUCTION AND USE**

U.S.M.C. - CAMP PENDLETON

2011-12

Quantities in Acre Feet

PRODUCTION			USE						RECLAIMED WASTEWATER				EXPORTS			
MONTH YEAR	AG LOCAL	CAMP SUPPLY	TOTAL	AGRICULTURE		CAMP SUPPLY		TOTAL	RECLAIMED USE		EXPORTED TO		TOTAL	TOTAL	WASTE WATER RETURNS	NET EXPORT
				1/ SMRW	OUT SMRW	IN SMRW	OUT SMRW	EXPORT	3/ SMRW	IN SMRW	OUT SMRW	4/ SMRW	TO OCEANSIDE	5/ TOTAL	6/ TOTAL	7/ TOTAL
2011																
OCT	0	428	428	0	0	171	257	257	171	0	26	222	248		505	153
NOV	0	270	270	0	0	108	162	162	108	0	9	260	269		431	97
DEC	0	311	311	0	0	124	187	187	124	0	10	242	252		439	111
2012																
JAN	0	366	366	0	0	146	220	220	146	0	10	229	239		459	131
FEB	0	238	238	0	0	95	143	143	95	0	12	240	252		395	85
MAR	0	238	238	0	0	95	143	143	95	0	21	232	253		396	85
APR	0	260	260	0	0	104	156	156	104	0	21	210	231		387	93
MAY	0	370	370	0	0	148	222	222	148	0	50	192	242		464	132
JUNE	0	531	531	0	0	212	319	319	212	0	60	134	194		513	190
JULY	0	565	565	0	0	226	339	339	226	0	61	147	208		547	202
AUG	0	567	567	0	0	227	340	340	227	0	61	144	205		545	203
SEPT	0	532	532	0	0	213	319	319	213	0	52	143	195		514	190
TOTAL	0	4,676	4,676	0	0	1,869	2,807	2,807	1,869	0	393	2,395	2,788		5,595	1,672
																3,923

1/ There was no Agricultural Irrigation in Water Year 2012.

2/ Camp Supply water use is divided with 40% used inside the SMRW and 60% used outside the SMRW.

3/ Assumes no losses.

4/ Reclaimed use for irrigation of golf course, landscaping and park areas.

5/ All wastewater treated at Southern Regional Tertiary Treatment Plant (SRTTP) beginning December 2008.

6/ Agriculture and Camp Supply use outside the SMRW, reclaimed use outside the SMRW, plus Outfall to Oceanside.

7/ Percent Camp Supply reclaimed estimated as 2,788 AF divided by 4,676 AF equals 59.60%. Wastewater returns estimated at 59.60% of Camp Supply use outside of SMRW.

TABLE A-9

**SANTA MARGARITA RIVER WATERSHED
MONTHLY WATER PRODUCTION AND USE**

U. S. NAVAL WEAPONS STATION, FALLBROOK ANNEX

2011-12

Quantities in Acre Feet

PRODUCTION				USE				WASTEWATER
MONTH YEAR	LOCAL	IMPORT TO WATERSHED 1/	TOTAL	AG	COMM/ DOM	LOSS 2/	TOTAL USE	EXPORTED
2011								
OCT	0.0	3.2	3.2	0.0	2.9	0.3	3.2	0.0
NOV	0.0	4.8	4.8	0.0	4.4	0.4	4.8	0.0
DEC	0.0	10.7	10.7	0.0	9.7	1.0	10.7	0.0
2012								
JAN	0.0	2.7	2.7	0.0	2.5	0.2	2.7	1.0
FEB	0.0	2.0	2.0	0.0	1.8	0.2	2.0	1.0
MAR	0.0	6.7	6.7	0.0	6.1	0.6	6.7	1.0
APR	0.0	2.7	2.7	0.0	2.5	0.2	2.7	1.0
MAY	0.0	2.0	2.0	0.0	1.8	0.2	2.0	1.0
JUNE	0.0	4.3	4.3	0.0	3.9	0.4	4.3	1.0
JULY	0.0	3.1	3.1	0.0	2.8	0.3	3.1	1.0
AUG	0.0	3.1	3.1	0.0	2.8	0.3	3.1	0.0
SEPT	0.0	3.1	3.1	0.0	2.8	0.3	3.1	2.0
TOTAL	0.0	48.4	48.4	0.0	44.0	4.4	48.4	9.0

1/ Import via Fallbrook Public Utility District

2/ Loss = 10% of Use

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE A-10

SANTA MARGARITA RIVER WATERSHED
MONTHLY WATER PRODUCTION AND USE

**WESTERN MUNICIPAL WATER DISTRICT
MURRIETA DIVISION**

2011-12

Quantities in Acre Feet

MONTH YEAR	PRODUCTION			USE					
	WELLS	IMPORT	TOTAL	AG	COMM	DOM	TOTAL DELIVERED	LOSS *	TOTAL USE
2011									
OCT	81	144	225	29	18	122	169	56	225
NOV	50	67	117	17	15	105	137	(20)	117
DEC	8	52	60	10	14	67	91	(31)	60
2012									
JAN	59	41	100	12	12	74	98	2	100
FEB	56	78	134	13	15	81	109	25	134
MAR	48	65	113	14	15	69	98	15	113
APR	45	76	121	15	34	75	124	(3)	121
MAY	48	148	196	8	27	139	174	22	196
JUNE	80	172	252	39	43	148	230	22	252
JULY	81	181	262	19	49	161	229	33	262
AUG	83	194	277	27	50	211	288	(11)	277
SEPT	111	153	264	47	48	166	261	3	264
TOTAL	750	1,371	2,121	250	340	1,418	2,008	113	2,121

* Loss = Total production less total delivered

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE A-11

**SANTA MARGARITA RIVER WATERSHED
MISCELLANEOUS WATER PRODUCTION AND IMPORTS**

2011-12

Quantities in Acre Feet

MONTH YEAR	IMPORT		PRODUCTION				
	WESTERN MWD IMPORTS TO IMPROVEMENT DISTRICT A	ANZA MUTUAL WATER COMPANY	RANCHO CALIFORNIA OUTDOOR RESORTS	QUIET OAKS MOBILE HOME PARK	LAKE RIVERSIDE ESTATES	HAWTHORN WATER SYSTEM	JOJOBA HILLS SKP RESORT
2011							
OCT	3.70	2.19	7.70	1.50	18.87	2.97	6.39
NOV	3.10	0.95	6.50	1.30	1.75	2.37	4.13
DEC	3.40	1.74	5.10	1.00	18.03	1.63	4.17
2012							
JAN	4.20	1.28	4.90	0.90	2.80	1.63	5.19
FEB	3.30	1.61	4.50	0.90	10.71	1.47	4.88
MAR	3.50	1.30	5.20	1.00	2.84	1.63	4.28
APR	3.10	1.74	5.70	1.10	31.56	2.42	6.85
MAY	5.70	2.30	6.60	1.30	32.12	2.93	6.47
JUNE	4.30	3.17	7.20	1.40	56.05	2.84	6.64
JULY	4.40	3.77	7.90	1.50	59.54	2.29	7.39
AUG	5.40	3.32	8.10	1.60	42.79	2.13	6.65
SEPT	4.40	2.85	7.60	1.50	33.25	2.06	6.08
SUBTOTAL			77.00	*	15.00	*	
			429.40	**	8.30	**	
TOTAL	48.50	26.22	506.40	23.30	310.31	26.37	69.12

* Annual production estimated due to meter malfunction, monthly quantities calculated assuming typical monthly distribution.

** Estimated non-metered use.

SANTA MARGARITA RIVER WATERSHED

ANNUAL WATERMASTER REPORT

WATER YEAR 2011-12

APPENDIX B

WATER PRODUCTION AND USE

WATER YEAR 1965-66 TO WATER YEAR 2011-12

July 2013

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE B-1

SANTA MARGARITA RIVER WATERSHED
ANNUAL WATER PRODUCTION AND USE

EASTERN MUNICIPAL WATER DISTRICT
Quantities in Acre Feet

PRODUCTION					USE 2/					RECLAIMED WASTEWATER							
WATER YEAR	WELLS	IMPORT	EXPORT	NET	TOTAL	AG	COMM	DOM	TOTAL	LOSS	TOTAL USE	REUSE IN SMRW 3/	REUSE OUTSIDE SMRW	OTHER REUSE 4/	RELEASE TO RIVER	RECHARGE	TOTAL
		1/	FROM	IMPORT													
			SMRW														
1966	0	1,604	0	1,604	1,604	1,520	0	4	1,524	80	1,604	0	0		0	100	100
1967	0	1,630	0	1,630	1,630	1,544	0	4	1,548	82	1,630	0	0		0	100	100
1968	0	1,464	0	1,464	1,464	1,386	0	5	1,391	73	1,464	0	0		0	100	100
1969	0	1,741	0	1,741	1,741	1,648	0	6	1,654	87	1,741	0	0		0	100	100
1970	0	1,417	0	1,417	1,417	1,340	0	7	1,346	71	1,417	0	0		0	101	101
1971	0	1,383	0	1,383	1,383	1,306	0	8	1,314	69	1,383	0	0		0	119	119
1972	0	1,470	0	1,470	1,470	1,388	0	8	1,396	74	1,470	0	0		0	242	242
1973	0	1,533	0	1,533	1,533	1,447	0	10	1,456	77	1,533	0	0		0	217	217
1974	0	1,601	0	1,601	1,601	1,511	0	10	1,521	80	1,601	0	0		0	193	193
1975	0	1,969	0	1,969	1,969	1,859	0	11	1,871	98	1,969	0	0		0	253	253
1976	145	2,493	0	2,493	2,638	2,356	0	150	2,506	132	2,638	134	0		0	155	289
1977	431	2,947	0	2,947	3,378	2,723	64	423	3,209	169	3,378	244	0		0	70	314
1978	375	2,551	0	2,551	2,926	2,409	0	371	2,780	146	2,926	300	0		0	75	375
1979	289	1,894	0	1,894	2,183	1,784	0	290	2,074	109	2,183	350	0		0	147	497
1980	281	1,192	0	1,192	1,473	1,116	0	283	1,399	74	1,473	375	0		0	220	595
1981	282	716	0	716	998	663	0	285	948	50	998	375	0		0	304	679
1982	321	1,112	0	1,112	1,433	1,038	0	323	1,361	72	1,433	375	0		0	386	761
1983	106	1,211	0	1,211	1,317	1,131	0	120	1,251	66	1,317	375	0		0	466	841
1984	236	699	0	699	935	644	0	244	888	47	935	400	0		0	525	925
1985	314	679	0	679	993	624	0	319	943	50	993	450	0		0	565	1,015
1986	229	760	0	760	989	700	0	239	940	49	989	600	0		0	509	1,109
1987	89	1,155	0	1,155	1,244	638	0	543	1,182	62	1,244	650	0		0	554	1,204
1988	4	2,047	0	2,047	2,051	524	0	1,424	1,948	103	2,051	650	0		0	650	1,300
1989	685	3,746	0	3,746	4,431	1,146	0	3,064	4,209	222	4,431	1,058	0		0	1,636	2,694
1990	492	8,578	2,977	5,601	6,093	978	0	4,810	5,788	305	6,093	1,567	0		0	2,160	3,727
1991	456	16,621	7,142	9,479	9,935	851	0	8,587	9,438	497	9,935	1,282	0		0	2,272	3,554
1992	527	13,486	4,893	8,593	9,120	29	0	8,635	8,664	456	9,120	1,323	0		245	2,385	3,953
1993	524	7,287	1,894	5,393	5,917	36	0	5,585	5,621	296	5,917	1,709	990	(285)	192	2,020	4,626
1994	232	10,082	2,932	7,150	7,382	0	0	7,013	7,013	369	7,382	2,687	2,465	694	0	0	5,846
1995	182	11,539	6,914	4,625	4,807	16	0	4,551	4,567	240	4,807	2,154	1,357	2,551	0	0	6,062
1996	299	11,730	6,770	4,960	5,259	0	0	4,996	4,996	263	5,259	2,979	2,473	520	0	0	5,972
1997	408	5,093	1,809	3,284	3,692	0	0	5,226	5,226	(1,534)	3,692	3,126	2,319	882	0	0	6,327
1998	240	6,609	1,492	5,117	5,357	0	0	5,090	5,090	267	5,357	2,949	5/	2,139	2,374	0	7,462
1999	669	7,118	2,719	4,327	4,996	0	0	4,746	4,746	250	4,996	3,741	6/	3,070	1,063	0	7,874
2000	630	9,179	1,923	7,256	7,886	0	0	7,493	7,493	393	7,886	4,669	7/	3,664	(15)	0	8,318
2001	355	9,219	3,271	5,948	6,303	0	0	5,989	5,989	314	6,303	4,571	8/	3,249	1,208	0	9,028
2002	13	12,777	4,954	8,117	8,130	0	0	7,724	7,724	406	8,130	4,843	9/	4,863	462	0	10,168
2003	0	14,175	5,113	9,062	9,062	0	0	8,610	8,610	452	9,062	3,542	10/	2,955	4,681	0	11,178
2004	0	17,381	8,243	9,138	9,138	0	0	8,960	8,960	178	9,138	3,221	3,688	5,427	0	0	12,336
2005	0	16,336	5,478	10,858	10,858	0	0	10,749	10,749	109	10,858	2,664	11/	2,690	8,986	0	14,340
2006	0	21,034	6,873	14,161	14,161	0	0	13,453	13,453	708	14,161	3,108	12/	3,510	7,396	0	14,014
2007	0	21,161	5,763	15,398	15,398	0	0	14,628	14,628	770	15,398	3,550	13/	5,960	4,593	0	14,103
2008	0	18,714	3,762	14,952	14,952	0	0	14,204	14,204	748	14,952	1,450	5,925	6,864	0	0	14,239
2009	0	16,919	2,447	14,472	14,472	0	0	13,748	13,748	724	14,472	2,615	6,786	5,241	0	0	14,642
2010	0	15,024	1,472	13,552	13,552	0	0	12,874	12,874	678	13,552	2,882	7,026	4,803	0	0	14,711
2011	0	14,675	283	14,392	14,392	131	2,879	10,662	13,672	720	14,392	2,561	7,241	5,140	0	0	14,942
2012	0	16,419	1,356	15,063	15,063	96	3,137	11,076	14,309	754	15,063	2,364	8,025	4,525	0	0	14,914

1/ Does not include deliveries to RCWD, Elsinore Valley MWD and Western MWD.

2/ Beginning in 2011, Use reported based on metered customer demands.

Prior years reporting based on supply meter data and is not complete for all categories.

3/ Reuse within Watershed includes noted amount of sewage distributed to RCWD for treatment by RCWD, reclaimed wastewater sold to RCWD for delivery to RCWD customers, and beginning in 2009, reclaimed wastewater sold to the Pechanga Band.

4/ Other Reuse includes changes in storage in Winchester and Sun City storage ponds, evaporation and percolation losses, and discharges to the Santa Ana Watershed.

5/ Includes 905 AF of sewage diverted to RCWD.

6/ Includes 1,159 AF of sewage diverted to RCWD.

7/ Includes 1,162 AF of sewage diverted to RCWD.

8/ Includes 1,201 AF of sewage diverted to RCWD.

9/ Includes 1,219 AF of sewage diverted to RCWD.

10/ Includes 1,056 AF of sewage diverted to RCWD.

11/ Includes 574 AF of sewage diverted to RCWD.

12/ Includes 910 AF of sewage diverted to RCWD.

13/ Includes 797 AF of sewage diverted to RCWD.

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE B-2

SANTA MARGARITA RIVER WATERSHED
MONTHLY WATER PRODUCTION AND USE

ELSINORE VALLEY MUNICIPAL WATER DISTRICT

Quantities in Acre Feet

WATER YEAR	PRODUCTION			USE						WASTEWATER EXPORTED
	WELLS	IMPORT	TOTAL	AG	COMM	DOM	TOTAL DELIVERED	LOSS *	TOTAL USE	
1966										
1967										
1968										
1969										
1970										
1971										
1972										
1973										
1974										
1975										
1976										
1977										
1978										
1979										
1980										
1981										
1982										
1983										
1984										
1985										
1986										
1987										
1988										
1989	0	1,341	1,341				1,341	0	1,341	74
1990	0	2,255	2,255				2,255	0	2,255	114
1991	0	2,421	2,421				2,421	0	2,421	134
1992	0	2,190	2,190				2,190	0	2,190	140
1993	0	2,964	2,964	539	84	2,341	2,964	0	2,964	150
1994	0	3,232	3,232	687	93	2,452	3,232	0	3,232	170
1995	0	3,127	3,127	520	100	2,507	3,127	0	3,127	185
1996	0	4,197	4,197	871	109	3,217	4,197	0	4,197	213
1997	0	4,296	4,296	848	118	3,330	4,296	0	4,296	226
1998	0	5,100	5,100	667	1,396	3,037	5,100	0	5,100	247
1999	0	6,133	6,133	921	1,626	3,586	6,133	0	6,133	254
2000	0	7,174	7,174	1,089	1,971	4,114	7,174	0	7,174	279
2001	0	6,215	6,215	925	1,815	3,475	6,215	0	6,215	310
2002	0	7,596	7,596	1,173	1,902	4,521	7,596	0	7,596	412
2003	0	7,091	7,091	63	2,665	4,363	7,091	0	7,091	483
2004	0	8,438	8,438	96	3,238	5,104	8,438	0	8,438	600
2005	0	8,215	8,215	104	3,044	5,067	8,215	0	8,215	927
2006	0	9,819	9,819	127	4,118	5,574	9,819	0	9,819	938
2007	0	10,811	10,811	150	4,509	6,152	10,811	0	10,811	837
2008	0	9,951	9,951	115	4,149	5,687	9,951	0	9,951	901
2009	0	9,075	9,075	147	2,015	6,913	9,075	0	9,075	1,069
2010	0	7,926	7,926	133	1,718	6,075	7,926	0	7,926	1,120
2011	0	7,425	7,425	94	1,517	5,539	7,150	275	7,425	1,130
2012	0	7,398	7,398	27	1,723	5,426	7,176	222	7,398	1,205

* For period prior to 2011, assumes no loss. Beginning in 2011, loss percentage within the Santa Margarita River Watershed is determined using the calculation to determine District-wide unaccounted for water by comparing District-wide annual supply and customer deliveries, and is assumed to be constant for all months.

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE B-3.1

SANTA MARGARITA RIVER WATERSHED
ANNUAL WATER PRODUCTION AND USE
FALLBROOK PUBLIC UTILITY DISTRICT
Quantities in Acre Feet

WATER YEAR	PRODUCTION									USE				
	TOTAL LAKE SKINNER DIVERSIONS	LAKE SKINNER DIVERSIONS DELIVERED	WELLS	TOTAL DISTRICT IMPORT	DELUZ AREA IMPORT	FALLBROOK AREA IMPORT	SMRW IMPORT 1/	TOTAL SMRW IMPORT	TOTAL SMRW PRODUCTION	AG	COMM/ DOM	TOTAL IN SMRW	LOSS 2/	TOTAL USE IN SMRW
1966			176	11,169	0	11,169	3,351	3,351	3,404	2,735	328	3,063	341	3,404
1967			16	9,508	0	9,508	2,852	2,852	2,857	2,253	319	2,572	285	2,857
1968			13	11,411	0	11,411	3,423	3,423	3,427	2,554	531	3,085	342	3,427
1969			178	9,458	0	9,458	2,837	2,837	2,891	1,787	814	2,601	290	2,891
1970			305	11,794	0	11,794	3,538	3,538	3,630	2,649	617	3,266	364	3,630
1971			7	11,350	0	11,350	3,405	3,405	3,407	2,386	681	3,067	340	3,407
1972			0	13,054	0	13,054	3,916	3,916	3,916	2,749	775	3,524	392	3,916
1973			0	10,610	38	10,572	3,172	3,210	3,210	2,156	732	2,888	322	3,210
1974			0	12,911	134	12,777	3,833	3,967	3,967	2,703	868	3,571	396	3,967
1975			0	11,492	213	11,279	3,384	3,597	3,597	2,420	816	3,236	361	3,597
1976			0	13,147	431	12,716	4,196	4,627	4,627	3,200	965	4,165	462	4,627
1977			20	13,435	587	12,848	4,625	5,212	5,232	3,536	1,174	4,710	522	5,232
1978			97	12,626	651	11,975	4,551	5,202	5,299	3,504	1,265	4,769	530	5,299
1979			187	12,865	961	11,904	4,762	5,723	5,910	3,820	1,498	5,318	592	5,910
1980			192	13,602	1,191	12,411	5,213	6,404	6,596	4,258	1,678	5,936	660	6,596
1981			87	16,878	1,994	14,884	6,549	8,543	8,630	5,688	2,144	7,832	798	8,630
1982			0	13,270	1,805	11,465	5,274	7,079	7,079	4,614	1,862	6,476	603	7,079
1983			0	12,298	1,969	10,329	4,751	6,720	6,720	4,320	1,871	6,191	529	6,720
1984			0	15,429	2,609	12,820	5,897	8,506	8,506	5,814	2,077	7,891	615	8,506
1985			0	14,256	2,358	11,898	5,473	7,831	7,831	5,187	2,135	7,322	509	7,831
1986			0	15,383	2,794	12,589	5,791	8,585	8,585	5,698	2,319	8,017	568	8,585
1987			0	15,313	2,986	12,327	5,670	8,656	8,656	5,793	2,281	8,074	582	8,656
1988			28	14,460	2,559	11,901	5,474	8,033	8,061	5,181	2,348	7,529	532	8,061
1989			94	16,179	3,007	13,172	6,059	9,066	9,160	5,620	2,706	8,326	834	9,160
1990			15	17,568	3,745	13,823	6,358	10,103	10,118	6,275	2,878	9,153	965	10,118
1991			46	13,939	2,871	11,068	5,091	7,962	8,008	5,146	2,314	7,460	548	8,008
1992			45	13,698	2,950	10,748	4,943	7,893	7,938	5,285	2,201	7,486	452	7,938
1993			86	12,695	2,010	10,685	4,915	6,925	7,011	4,329	2,349	6,678	333	7,011
1994			83	13,124	2,246	10,878	5,004	7,250	7,333	4,282	2,666	6,948	385	7,333
1995			3	11,620	2,208	9,412	4,330	6,538	6,541	3,818	2,798	6,316	225	6,541
1996			0	14,168	2,733	11,435	5,260	7,993	7,993	4,411	3,247	7,658	335	7,993
1997			0	14,005	2,688	11,317	5,206	7,894	7,894	4,351	3,249	7,600	294	7,894
1998			0	11,757	1,803	9,954	4,579	6,382	6,382	3,245	2,798	6,043	339	6,382
1999			0	14,307	1,572	12,735	5,858	7,430	7,430	3,748	3,271	7,019	411	7,430
2000			0	15,983	2,705	14,478	6,660	9,365	9,365	5,138	3,903	9,041	324	9,365
2001			0	15,249	2,562	12,687	5,836	8,398	8,398	4,413	3,537	7,950	448	8,398
2002			0	17,422	2,900	14,522	6,680	9,580	9,580	5,185	4,036	9,221	359	9,580
2003			0	15,864	3,393	12,471	5,737	9,130	9,130	6,041	3,737	9,778	(648)	9,130
2004			0	19,640	5,027	14,613	6,722	11,749	11,749	7,018	4,222	11,240	509	11,749
2005 R	1,261	1,261	0	13,986	3,101	10,885	5,007	8,108	9,369	4,654	3,581	8,235	1,134	9,369
2006 R	106	106	0	18,297	3,994	14,303	6,579	10,573	10,679	5,958	4,019	9,977	702	10,679
2007	0	0	0	20,750	5,087	15,664	7,205	12,292	12,292	7,271	4,500	11,771	521	12,292
2008 R	31	31	0	15,508	3,307	12,202	5,613	8,920	8,951	4,492	3,962	8,454	497	8,951
2009	0	0	0	15,355	2,767	12,588	5,790	8,557	8,557	4,151	3,896	8,047	510	8,557
2010 R	20	20	0	12,752	2,438	10,314	4,754	7,183	7,203	3,576	3,195	6,771	432	7,203

1/ Total SMRW production equals SMRW Import plus 30% local (1966-1971).

2/ Loss = Total production less total use.

R - Revised

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE B-3.2

SANTA MARGARITA RIVER WATERSHED
ANNUAL WATER PRODUCTION AND USE

FALLBROOK PUBLIC UTILITY DISTRICT

Quantities in Acre Feet

DISTRICT WIDE PRODUCTION					SMRW PRODUCTION			SMRW USE							
WATER YEAR	TOTAL LAKE SKINNER DIVERSIONS 1/	LAKE SKINNER DIVERSIONS DELIVERED	TOTAL DISTRICT IMPORT 2/	TOTAL DISTRICT SUPPLY 3/		SMRW LAKE SKINNER	SMRW IMPORT	TOTAL SMRW PRODUCTION		AG	COMM	DOM	TOTAL DELIVERED IN SMRW	LOSS 4/	TOTAL USE IN SMRW
2011	284	284	11,264	11,548		284	6,234	6,518		3,742	327	1,990	6,059	459	6,518
2012	0	0	12,579	12,579		0	7,254	7,254		4,261	337	2,060	6,658	596	7,254

1/ Diverted under Permit No. 11356.

2/ Includes production from Capra Well located in San Luis Rey Watershed and supply from San Diego County Water Authority.

3/ A portion of the District is outside the Santa Margarita River Watershed.

4/ Loss percentage within the Santa Margarita River Watershed is determined using the calculation to determine District-wide unaccounted for water by comparing District-wide annual supply and customer deliveries, and is assumed to be constant for all months.

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE B-4
SANTA MARGARITA RIVER WATERSHED
ANNUAL WASTEWATER PRODUCTION AND DISTRIBUTION
FALLBROOK PUBLIC UTILITY DISTRICT
Quantities in Acre Feet

WATER YEAR	TOTAL WASTEWATER PRODUCTION	PERCENT WASTEWATER FROM SMRW	WASTEWATER FROM SMRW	WASTEWATER REUSED IN SMRW	WASTEWATER FROM U.S. NWS 1/	WASTEWATER EXPORTED FROM SMRW	PERCENT WASTEWATER FROM SLR WATERSHED 2/	WASTEWATER IMPORTED FROM SLR WATERSHED
1966	395	81	320		0	0	19	75
1967	460	80	368		0	0	20	92
1968	524	80	419		0	0	20	105
1969	588	79	465		0	0	21	123
1970	652	78	509		0	0	22	143
1971	717	78	559		0	0	22	158
1972	782	77	602		0	0	23	180
1973	847	76	644		0	0	24	203
1974	912	75	684		0	0	25	228
1975	976	75	732		0	0	25	244
1976	1,040	74	770		0	0	26	270
1977	1,105	73	807		0	0	27	298
1978	1,170	72	842		0	0	28	328
1979	1,234	72	888		0	0	28	346
1980	1,298	71	922		0	0	29	376
1981	1,363	70	954		0	0	30	409
1982	1,428	69	985		0	0	31	443
1983	1,492	69	1,029		26 E	1,003	0	0
1984	1,556	68	1,058		26 E	1,032	0	0
1985	1,621	67	1,086		26 E	1,060	0	0
1986	1,685	66	1,112		18 P	1,094	0	0
1987	1,750	66	1,155		27	1,128	0	0
1988	1,815	65	1,180		25	1,155	0	0
1989	1,881	64	1,204		22	1,182	0	0
1990	1,952	66	1,298		27	1,271	0	0
1991	1,622	60	973		11	962	0	0
1992	1,730	63	1,090		7	1,083	0	0
1993	2,051	62	1,271		16	1,255	0	0
1994	1,834	58	1,073		5	1,068	0	0
1995	1,941	60	1,165		12	1,153	0	0
1996	1,799	58	1,040		5	1,035	0	0
1997	1,780	58	1,027		6	1,021	0	0
1998	2,297	65	1,490		8	1,482	0	0
1999	2,175	64	1,382		5	1,377	0	0
2000	2,164	66	1,426		7	1,419	0	0
2001	2,191	65	1,424	24	8	1,392	0	0
2002	2,061	61	1,262	28	9	1,225	0	0
2003	2,276	61	1,390	21	10	1,359	0	0
2004	2,199	62	1,363	26	8	1,329	0	0
2005	2,505	58	1,457	24	16	1,417	0	0
2006	2,479	58	1,429	26	8	1,395	0	0
2007	1,951	48	932	29	12	891	0	0
2008	1,940	43	838	28	11	799	0	0
2009	1,900	46	872	31	12	829	0	0
2010	1,972	49	960	27	7	926	0	0
2011	2,006	46	930	21	8	901	0	0
2012	1,955	49	958	21	9	928	0	0

NOTE: Measured quantities available for Total Wastewater in Water Year 1969 and July 1989. All other quantities are estimated (1966-1989).
Prior to 1983, Wastewater was discharged into Fallbrook Creek. After 1983, Wastewater was discharged into an ocean outfall.

1/ United States Naval Weapons Station

2/ San Luis Rey Watershed

E - Estimated

P - Partial Year Data

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE B-5

SANTA MARGARITA RIVER WATERSHED
ANNUAL WATER PRODUCTION AND USE

METROPOLITAN WATER DISTRICT
DELIVERIES IN DOMENIGONI VALLEY

Quantities in Acre Feet

WATER YEAR	PRODUCTION				USE					
	WELLS	IMPORT TO SMRW	TOTAL IN SMRW		AG	COMM/ DOM*	GW RECHARGE	TOTAL DELIVERED	LOSS **	TOTAL USE
1966	0	0	0		0	0	0	0	0	0
1967	0	0	0		0	0	0	0	0	0
1968	0	0	0		0	0	0	0	0	0
1969	0	0	0		0	0	0	0	0	0
1970	0	0	0		0	0	0	0	0	0
1971	0	0	0		0	0	0	0	0	0
1972	0	0	0		0	0	0	0	0	0
1973	0	0	0		0	0	0	0	0	0
1974	0	0	0		0	0	0	0	0	0
1975	0	0	0		0	0	0	0	0	0
1976	0	0	0		0	0	0	0	0	0
1977	0	0	0		0	0	0	0	0	0
1978	0	0	0		0	0	0	0	0	0
1979	0	0	0		0	0	0	0	0	0
1980	0	0	0		0	0	0	0	0	0
1981	0	0	0		0	0	0	0	0	0
1982	0	0	0		0	0	0	0	0	0
1983	0	0	0		0	0	0	0	0	0
1984	0	0	0		0	0	0	0	0	0
1985	0	0	0		0	0	0	0	0	0
1986	0	0	0		0	0	0	0	0	0
1987	0	0	0		0	0	0	0	0	0
1988	0	0	0		0	0	0	0	0	0
1989	0	0	0		0	0	0	0	0	0
1990	0	0	0		0	0	0	0	0	0
1991	0	0	0		0	0	0	0	0	0
1992	0	0	0		0	0	0	0	0	0
1993	0	0	0		0	0	0	0	0	0
1994	0	0	0		0	0	0	0	0	0
1995	0	547	547		354	193	0	547	0 R	547
1996	0	1,005	1,005		763	242	0	1,005	0 R	1,005
1997	0	3,521	3,521		591	2,891	39	3,521	0 R	3,521
1998	0	5,023	5,023		193	4,403	427	5,023	0 R	5,023
1999	0	3,781	3,781		404	2,978	399	3,781	0 R	3,781
2000	0	712	712		92	356	264	712	0 R	712
2001	0	689	689		505	0	184	689	0 R	689
2002	0	595	595		569	26	0	595	0 R	595
2003	0	496	495		495	0	0	495	0 R	495
2004	0	766	766		766	0	0	766	0 R	766
2005	0	556	556		556	0	0	556	0 R	556
2006	0	506	506		506	0	0	506	0 R	506
2007	0	660	660		660	0	0	660	0 R	660
2008	0	493	493		493	0	0	493	0 R	493
2009	0	465	465		465	0	0	465	0 R	465
2010	0	372	372		372	0	0	372	0 R	372
2011	0	336	336		336	0	0	336	0 R	336
2012	0	466	466		466	0	0	466	0	466

* Construction Water

** Points of delivery located at metered pumps on San Diego Canal and thus the losses in the MWD system are zero.

R - Revised

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE B-6
SANTA MARGARITA RIVER WATERSHED
ANNUAL WATER PRODUCTION AND USE
PECHANGA INDIAN RESERVATION

Quantities in Acre Feet

WATER YEAR	PRODUCTION 1/					USE 2/					
	SURFACE DIVERSION	WELLS ON RESERVATION	DELIVERED GROUNDWATER FROM RCWD	RECLAIMED WASTEWATER FROM EMWD	TOTAL	AG	COMM	DOM	TOTAL DELIVERED	LOSS 3/	TOTAL USE
1966											
1967											
1968											
1969											
1970											
1971											
1972											
1973											
1974											
1975											
1976											
1977											
1978											
1979											
1980											
1981											
1982											
1983											
1984											
1985											
1986											
1987											
1988											
1989											
1990											
1991	0	58	0	0	58	0	0	58	N/R	N/R	58
1992	0	66	0	0	66	0	0	66	N/R	N/R	66
1993	0	91	0	0	91	0	0	91	N/R	N/R	91
1994	0	70	0	0	70	0	0	70	N/R	N/R	70
1995	0	63	0	0	63	0	4	59	N/R	N/R	63
1996	0	145	0	0	145	0	45	100	N/R	N/R	145
1997	4	167	0	0	171	0	25	146	N/R	N/R	171
1998	4	175	0	0	179	0	62	117	N/R	N/R	179
1999	4	241	0	0	245	33	84	128	N/R	N/R	245
2000	4	370	0	0	374	51	182	141	N/R	N/R	374
2001	4	291	0	0	295	56	85	154	N/R	N/R	295
2002	4	460	0	0	464	73	194	174	441	23	464
2003	4	600	0	0	604	78	354	148	580	24	604
2004	4	721	0	0	725	81	537	71	689	36	725
2005	0	608	0	0	608	140	401	61	602	6	608
2006	0	754	0	0	754	159	401	194	N/R	N/R	754
2007	0	919	154	0	1,073	275	517	229	1,021	52	1,073
2008	0	865	412	0	1,277	599	370	282	1,251	26	1,277
2009	0	702	250	268	1,220	548	441	195	1,184	36	1,220
2010	0	561	230	394	1,185	531	364	235	1,130	55	1,185
2011	0	632	201	326	1,159	468	418	257	1,143	16	1,159
2012	0	669	177	329	1,175	513	405	215	1,133	42	1,175

1/ Records prior to 1991 not available.

2/ For period 1991 through 2006, use shown as reported to Watermaster and published in prior Watermaster reports.

3/ For 2007, loss assumed to be 5% for all use types; for prior years any losses shown as reported to Watermaster.

For 2008 to present, loss determined as Total Production less Total Delivered.

N/R--Not reported.

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE B-7

**SANTA MARGARITA RIVER WATERSHED
ANNUAL WATER PRODUCTION AND USE**

RAINBOW MUNICIPAL WATER DISTRICT

Quantities in Acre Feet

WATER YEAR	PRODUCTION			USE				
	LOCAL	IMPORT TO DISTRICT	TOTAL IN WATERSHED 1/	AG 2/	COMMERCIAL/ DOMESTIC 3/	TOTAL DELIVERIES	LOSS 4/	TOTAL USE
1966	0	14,538	1,308	1,049	140	1,189	119	1,308
1967	0	12,167	1,095	878	117	995	100	1,095
1968	0	15,301	1,377	1,104	147	1,252	125	1,377
1969	0	13,917	1,253	1,005	134	1,139	114	1,252
1970	0	18,764	1,689	1,354	181	1,535	154	1,689
1971	0	18,338	1,650	1,324	177	1,500	150	1,650
1972	0	22,633	2,037	1,634	218	1,852	185	2,037
1973	0	17,955	1,616	1,296	173	1,469	147	1,616
1974	0	22,768	2,049	1,643	219	1,863	186	2,049
1975	0	13,856	1,247	1,000	133	1,134	113	1,247
1976	0	24,878	2,239	1,796	240	2,035	204	2,239
1977	0	26,038	2,343	1,879	251	2,130	213	2,343
1978	0	24,312	2,188	1,755	234	1,989	199	2,188
1979	0	26,084	2,348	1,883	251	2,134	213	2,347
1980	0	27,660	2,489	1,997	266	2,263	226	2,489
1981	0	35,036	3,153	2,529	337	2,866	287	3,153
1982	0	27,334	2,460	1,973	263	2,236	224	2,460
1983	0	24,957	2,190	1,735	256	1,991	199	2,190
1984	0	32,526	3,068	2,483	306	2,789	279	3,068
1985	0	28,612	3,410	2,798	302	3,100	310	3,410
1986	0	29,023	2,945	2,353	324	2,677	268	2,945
1987	0	29,449	3,390	2,765	317	3,082	308	3,390
1988	0	29,070	2,985	2,372	342	2,714	271	2,985
1989	0	32,034	3,003	2,385	345	2,730	273	3,003
1990	0	34,612	3,818	3,003	468	3,471	347	3,818
1991	0	27,754	2,904	2,276	364	2,640	264	2,904
1992	0	26,056	2,277	1,877	193	2,070	207	2,277
1993	0	23,766	1,965	1,655	132	1,787	178	1,965
1994	0	22,173	1,651	1,368	133	1,501	150	1,651
1995	0	20,935	1,661	1,398	112	1,510	151	1,661
1996	0	24,835	1,815	1,487	163	1,650	165	1,815
1997	0	24,638	1,429	1,139	160	1,299	130	1,429
1998	0	19,693	1,601	1,315	141	1,456	145	1,601
1999	0	24,961	1,727	1,411	159	1,570	157	1,727
2000	0	30,446	2,217	1,861	154	2,015	202	2,217
2001	0	27,214	1,804	1,439	202	1,641	163	1,804
2002	0	32,854	1,676	1,368	156	1,524	152	1,676
2003	0	29,156	1,510	1,237	136	1,373	137	1,510
2004	0	33,686	1,888	1,567	149	1,716	172	1,888
2005	0	25,135	1,610	1,331	133	1,464	146	1,610
2006	0	29,797	1,851	1,529	154	1,683	168	1,851
2007	0	32,939	2,262	1,871	185	2,056	206	2,262
2008	0	24,390	1,790	1,461	167	1,628	162	1,790
2009	0	27,075	1,852	1,463	220	1,683	169	1,852
2010	0	20,769	1,453	1,147	174	1,321	132	1,453
2011	0	18,599	1,492	1,251	105	1,356	136	1,492
2012	0	21,152	1,892	1,602	118	1,720	172	1,892

1/ 1966 through 1982 estimated to be 9% of total district imports

2/ 1966 through 1982 estimated to be 80.2% of total deliveries to watershed

3/ 1966 through 1982 estimated to be 10.7% of total deliveries to watershed

4/ Loss = 10% of use

TABLE B-8

**SANTA MARGARITA RIVER WATERSHED
ANNUAL WATER PRODUCTION AND USE
RANCHO CALIFORNIA WATER DISTRICT**

Quantities in Acre Feet

YEAR	PRODUCTION					USE					VAIL LAKE		RECLAIMED WASTEWATER						
	WELLS	EXPORT 1/	NET WELLS	IMPORT	EXPORT 2/	NET IMPORT	TOTAL	AG	AG/ DOM	COMM DOM	SMR RELEASE	IMPORT TO STORAGE	TOTAL USE	LOSS 3/	TOTAL	RELEASE AND RECHARGE 4/	IRRIGATION	REUSE IN SMRW	MURRIETA CREEK DISCHARGE 5/
1966							0												
1967	4,288						0										185	0	0
1968	5,100						4,288										1,136	0	0
1969	3,617						5,100										398	0	0
1970	6,721						3,617										697	0	0
1971	7,960						6,721										540	0	0
1972	8,369						7,960										1,541	0	0
1973	7,726						8,369										203	0	0
1974	10,163						7,726										524	0	0
1975	10,357						10,163										1,066	0	0
1976	11,809						10,357										369	0	0
1977	10,522					119	11,809										50	0	0
1978	8,930						10,522										0	0	0
1979	11,371						8,930										0	0	0
1980	12,621						11,371										0	0	0
1981	15,612						12,621										0	0	0
1982	12,631						15,612										0	0	0
1983	16,675 6/						12,631										0	0	0
1984	25,660						16,675										0	0	0
1985	24,373						25,660										0	0	0
1986	26,997						24,373										0	0	0
1987	33,735						26,997										0	0	0
1988	21,367						33,735										0	0	0
1989	26,131						21,367										0	0	0
1990	33,241						26,131										0	0	0
1991	25,503						33,241										0	0	0
1992	29,968						25,503										0	0	0
1993	31,029						29,968										0	0	0
1994	32,725						31,029										0	0	0
1995	35,111						32,725										0	0	0
1996	36,086						35,111										0	0	0
1997	33,960						36,086										0	0	0
1998	26,851						33,960										0	0	0
1999	30,598						26,851										0	0	0
2000	27,938						30,598										0	0	0
2001	26,421						27,938										0	0	0
2002	24,895						26,421										0	0	0
2003	25,238						24,895										0	0	0
2004	25,353						25,238										0	0	0
2005	27,606						25,353										0	0	0
2006	27,559						27,606										0	0	0
2007	27,645						27,559										0	0	0
2008	26,239						27,645										0	0	0
2009	27,820						26,239										0	0	0
2010	25,685						27,820										0	0	0
2011	27,725						25,685										0	0	0
2012	24,942						27,725										0	0	0

1/ Groundwater used in San Mateo Watershed.

2/ Import used in San Mateo Watershed.

3/ Loss = Total production less total use.

4/ Irrigation 1966 to 1976 by pumping from Vail Lake.

5/ Discharge from ZMGD Demonstration project.

6/ Includes 98 acre feet from wells out of groundwater area.

7/ Import recharge was 2,294 AF but portion remaining in storage was not computed due to lack of data.

8/ Import recharge was 701 AF but portion remaining in storage was not computed due to lack of data.

9/ Does not include EIMWD reclaimed wastewater production.

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE B-9

SANTA MARGARITA RIVER WATERSHED
ANNUAL WATER PRODUCTION AND USE

U.S.M.C. - CAMP PENDLETON
EXCLUDING NAVAL WEAPONS STATION SHOWN ON B-10
Quantities in Acre Feet

PRODUCTION				USE						RECLAIMED WASTEWATER				
WATER YEAR	AG LOCAL	CAMP SUPPLY	TOTAL	AGRICULTURE IN SMRW 1/	OUT SMRW	CAMP SUPPLY IN SMRW 2/	OUT SMRW	TOTAL EXPORT	TOTAL IN SMRW 3/	RECLAIMED USE IN SMRW 4/	OUT SMRW 5/	EXPORTED TO OCEANSIDE OUTFALL	TOTAL 6/	NET EXPORT 7/
1966	1,101	4,605	5,706	429	672	2,026	2,579	3,251	2,455	1,893			1,893	
1967	796	4,811	5,607	310	486	2,117	2,694	3,180	2,427	2,156			2,156	
1968	986	4,939	5,925	385	601	2,172	2,767	3,368	2,557	2,080			2,080	
1969	940	4,821	5,761	367	573	2,058	2,763	3,276	2,485	2,189			2,189	
1970	1,106	5,481	6,587	431	675	2,347	3,134	3,809	2,778	2,145			2,145	
1971	819	5,291	6,110	319	500	2,264	3,028	3,527	2,583	2,011			2,011	
1972	817	5,323	6,140	319	498	2,278	3,045	3,543	2,597	2,068			2,068	
1973	1,003	5,121	6,124	391	612	2,189	2,932	3,544	2,580	2,137			2,137	
1974	909	5,202	6,111	355	554	2,224	2,978	3,532	2,579	2,055			2,055	
1975	757	4,593	5,350	295	462	1,957	2,636	3,098	2,252	2,519			2,519	
1976	885	5,384	6,269	345	540	2,305	3,079	3,619	2,650	2,447			2,447	
1977	994	4,506	5,500	388	606	1,918	2,588	3,194	2,306	2,358			2,358	
1978	176	5,177	5,353	69	107	2,213	2,964	3,071	2,282	2,446			2,446	
1979	1,070	7,213	8,283	417	653	3,109	4,104	4,756	3,527	2,493			2,493	
1980	835	5,495	6,330	326	509	2,353	3,142	3,651	2,679	2,506			2,506	
1981	1,464	5,240	6,704	571	893	2,241	2,999	3,892	2,812	2,368			2,368	
1982	1,447	5,024	6,471	564	883	2,146	2,878	3,761	2,710	2,254			2,254	
1983	942	4,215	5,157	367	575	1,790	2,425	3,000	2,157	2,494			2,494	
1984	1,078	4,501	5,579	420	658	1,916	2,585	3,243	2,336	2,443			2,443	
1985	1,069	4,764	5,833	417	652	2,039	2,725	3,377	2,456	2,619			2,619	
1986	953	4,807	5,760	372	581	2,062	2,745	3,326	2,434	2,240			2,240	
1987	1,098	4,838	5,936	428	670	2,064	2,774	3,444	2,492	3,166			3,166	
1988	1,223	4,721	5,944	477	746	2,010	2,711	3,457	2,487	3,396			3,396	
1989	856	5,044	5,900	334	522	2,148	2,896	3,418	2,482	2,747			2,747	
1990	855	4,228	5,083	333	522	1,779	2,449	2,971	2,112	2,728			2,728	
1991	554	3,159	3,713	216	338	1,329	1,830	2,168	1,545	2,289	362		2,651	
1992	898	3,254	4,152	350	548	1,376	1,878	2,426	1,726	2,481	279		2,760	
1993	1,067	2,879	3,946	416	651	1,201	1,678	2,329	1,617	2,975	205		3,180	
1994	1,471	3,150	4,621	574	897	1,345	1,805	2,702	1,919	2,535	279		2,814	
1995	985	3,768	4,753	384	601	1,588	2,180	2,781	1,972	2,453	280		2,733	
1996	1,000	5,199	6,199	390	610	2,232	2,967	3,577	2,622	2,444	330		2,774	
1997	1,066	5,238	6,304	416	650	2,244	2,994	3,644	2,660	2,920	509		3,429	
1998	1,026	5,468	6,494	400	626	2,352	3,116	3,742	2,752	3,008	222		3,230	
1999	1,064	5,054	6,118	415	649	2,145	2,909	3,558	2,560	3,023	205		3,228	
2000	1,296	5,765	7,061	506	790	2,483	3,282	4,072	2,989	3,152	411		3,563	
2001	1,025	5,341	6,366	399	626	2,314	3,027	3,653	2,713	3,140	454		3,594	
2002	1,184	5,269	6,453	462	722	2,290	2,979	3,701	2,752	2,900	469		3,369	
2003	1,270	5,210	6,480	495	775	2,218	2,992	3,767	2,713	2,687	415		3,102	
2004	1,227	5,538	6,765	479	748	2,396	3,142	3,890	2,875	0	444	2,544	2,988	
2005	1,317	4,902	6,219	514	803	2,134	2,768	3,571	2,648	0	489	2,526	3,015	
2006	1,530	5,311	6,841	597	933	2,301	3,010	3,943	2,898	0	449	2,298	2,747	
2007	1,385	5,850	7,235	540	845	2,535	3,315	4,160	3,075	0	416	2,309	2,725	
2008	1,606	5,315	6,921	579	1,027	2,603	2,712	3,739	3,182	0	357	2,430	2,787	
2009	882	5,516	6,398	273	609	2,593	2,923	3,532	2,866	49	488	1,966	2,503	4,243
2010	645	5,137	5,782	202	443	2,672	2,465	2,908	2,874	6	396	1,839	2,241	4,068
2011	76	5,165	5,241	24	52	2,583	2,582	2,634	2,607	0	320	2,562	2,882	4,075
2012	0	4,676	4,676	0	0	1,869	2,807	2,807	1,869	0	393	2,395	2,788	3,923

1/ For years 1966 - 2007, agricultural water use is divided with 39% used inside SMRW and 61% used outside SMRW, thereafter proportions are provided by Camp Pendleton.

2/ Prior to 1969, 44% used inside the SMRW and 56% used outside the SMRW. For years 1969 - 2007, Camp Supply water use inside SMRW equals 44% of sum of Camp Supply production plus Naval Weapons Station Import, less the NWS Import. Annual proportions provided by Camp Pendleton beginning 2008.

3/ Assumes no losses.

4/ For years 1966 - 2003, reclaimed use inside SMRW reported as recharged wastewater from ponds and recharge areas. See prior reports from 2008 and earlier for additional information.

5/ Reclaimed use for irrigation of golf course, landscaping and park areas.

6/ All wastewater treated at Southern Regional Tertiary Treatment Plant (SRTTP) beginning December 2008.

7/ Net Export equals the sum of Agriculture Out, Camp Supply Out, Reclaimed Out and Export to Oceanside Outfall, minus Wastewater Return, as shown on Table A-8.

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE B-10

SANTA MARGARITA RIVER WATERSHED
ANNUAL WATER PRODUCTION AND USE

U. S. NAVAL WEAPONS STATION, FALLBROOK ANNEX

Quantities in Acre Feet

WATER YEAR	PRODUCTION			USE				WASTEWATER	
	LOCAL	IMPORT TO WATERSHED 1/	TOTAL	AG	COMM/ DOM	LOSS 2/	TOTAL USE	EXPORTED	
1966	87	0	87	0	79	9	87	0	0
1967	92	0	92	0	83	9	92	0	0
1968	108	0	108	0	97	11	108	0	0
1969	138	0	138	0	113	25	138	0	0
1970	152	0	152	0	125	27	152	0	0
1971	39	76	115	0	100	15	115	0	0
1972	0	115	115	0	105	10	115	0	0
1973	0	115	115	0	105	10	115	0	0
1974	0	115	115	0	105	10	115	0	0
1975	0	115	115	0	105	10	115	0	0
1976	0	115	115	0	105	10	115	0	0
1977	0	115	115	0	105	10	115	0	0
1978	0	115	115	0	105	10	115	0	0
1979	0	115	115	0	105	10	115	0	0
1980	0	115	115	0	105	10	115	0	0
1981	0	115	115	0	105	10	115	0	0
1982	0	115	115	0	105	10	115	0	0
1983	0	115	115	0	105	10	115	26	26
1984	0	115	115	0	105	10	115	26	26
1985	0	102	102	0	93	9	102	26	26
1986	0	94	94	0	85	9	94	18	18
1987	0	116	116	0	105	11	116	27	27
1988	0	120	120	0	109	11	120	25	25
1989	0	128	128	0	116	12	128	22	22
1990	0	145	145	0	132	13	145	27	27
1991	0	109	109	0	99	10	109	11	11
1992	0	99	99	0	90	9	99	7	7
1993	0	117	117	0	106	11	117	16	16
1994	0	73	73	0	66	7	73	5	5
1995	0	125	125	0	114	11	125	12	12
1996	0	100	100	0	91	9	100	5	5
1997	0	109	109	0	99	10	109	6	6
1998	0	97	97	0	88	9	97	8	8
1999	0	111	111	0	101	10	111	5	5
2000	0	104	104	0	95	9	104	7	7
2001	0	73	73	0	66	7	73	8	8
2002	0	97	97	0	88	9	97	9	9
2003	0	88	88	0	80	8	88	10	10
2004	0	73	73	0	66	7	73	8	8
2005	0	40	40	0	36	4	40	16	16
2006	0	64	64	0	58	6	64	8	8
2007	0	70	70	0	64	6	70	12	12
2008	0	82	82	0	75	7	82	11	11
2009	0	74	74	0	67	7	74	12	12
2010	0	69	69	0	63	6	69	7	7
2011	0	45	45	0	41	4	45	8	8
2012	0	48	48	0	44	4	48	9	9

1/ Estimate 1969-1984 - Records not available

2/ Loss = 10% of Use

E - Estimate

P - Partial year data

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE B-11

**SANTA MARGARITA RIVER WATERSHED
ANNUAL WATER PRODUCTION AND USE**

**WESTERN MUNICIPAL WATER DISTRICT
MURRIETA DIVISION**

Quantities in Acre Feet

WATER YEAR	PRODUCTION			USE					
	WELLS	IMPORT	TOTAL	AG	COMM	DOM	TOTAL DELIVERED	LOSS *	TOTAL USE
1966	41	0	41	0	0	37	37	4	41
1967	45	0	45	0	0	41	41	4	45
1968	54	0	54	0	0	49	49	5	54
1969	54	0	54	0	0	49	49	5	54
1970	73	0	73	0	0	66	66	7	73
1971	83	0	83	3	0	72	75	8	83
1972	111	0	111	10	0	91	101	10	111
1973	92	0	92	11	0	72	84	8	92
1974	132	0	132	14	0	107	120	12	132
1975	153	0	153	18	0	121	139	14	153
1976	117	0	117	22	0	84	106	11	117
1977	170	0	170	21	0	134	155	15	170
1978	169	0	169	19	0	135	154	15	169
1979	197	0	197	19	0	160	179	18	197
1980	218	0	218	20	0	178	198	20	218
1981	265	0	265	30	0	211	241	24	265
1982	230	0	230	21	0	188	209	21	230
1983	216	0	216	14	0	182	196	20	216
1984	304	0	304	26	0	250	276	28	304
1985	308	0	308	19	0	261	280	28	308
1986	305	0	305	22	0	255	277	28	305
1987	326	0	326	23	0	273	296	30	326
1988	303	0	303	13	35	262	275	28	303
1989	286	0	286	11	72	262	344	(4)	286
1990	465	0	465	13	76	266	355	110	465
1991	459	0	459	15	88	250	353	106	459
1992	492	0	492	6	122	302	430	62	492
1993	508	0	508	4	105	323	432	76	508
1994	512	0	512	10	103	324	437	75	512
1995	521	0	521	12	99	321	432	89	521
1996	629	0	629	88	113	384	585	44	629
1997	638	0	638	76	99	392	567	71	638
1998	603	0	603	79	90	362	531	72	603
1999	827	0	827	79	125	548	752	75	827
2000	1,123	0	1,123	199	365	519	1,083	40	1,123
2001	1,389	0	1,389	163	414	740	1,317	72	1,389
2002	1,679	0	1,679	230	348	1,115	1,693	(14)	1,679
2003	1,748	102	1,850	272	275	1,340	1,887	(37)	1,850
2004	1,979	330	2,309	282	407	1,479	2,168	141	2,309
2005	2,098	75	2,173	262	274	1,539	2,075	98	2,173
2006	2,233	316	2,549	338	396	1,696	2,430	119	2,549
2007	1,978	723	2,701	467	276	1,980	2,723	(22)	2,701
2008	210	2,180	2,390	408	251	1,827	2,486	(96)	2,390
2009	861	1,654	2,515	396	219	1,723	2,338	177	2,515
2010	753	1,462	2,215	264	140	1,642	2,046	169	2,215
2011	559	1,642	2,201	324	239	1,497	2,060	141	2,201
2012	750	1,371	2,121	250	340	1,418	2,008	113	2,121

* Loss = Total production less total delivered

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE B-12

SANTA MARGARITA RIVER WATERSHED
MISCELLANEOUS WATER PRODUCTION AND IMPORTS

Quantities in Acre Feet

WATER YEAR	IMPORT		PRODUCTION				
	WESTERN MWD IMPORTS TO IMPROVEMENT DISTRICT A	ANZA MUTUAL WATER COMPANY	OUTDOOR RESORTS RANCHO CALIFORNIA, INC.	QUIET OAKS MOBILE HOME PARK	LAKE RIVERSIDE ESTATES	HAWTHORN WATER SYSTEM	JOJOBA HILLS SKP RESORT
1966	23.50						
1967	20.40						
1968	27.00						
1969	24.60						
1970	30.60						
1971	34.40						
1972	34.10						
1973	30.20						
1974	36.40						
1975	34.20						
1976	35.00						
1977	24.20						
1978	26.00						
1979	24.00						
1980	24.70						
1981	34.30						
1982	34.20						
1983	26.00						
1984	26.00						
1985	27.00						
1986	34.40						
1987	35.50						
1988	35.70						
1989	22.80	33.00	42.00	23.50	249.52		
1990	21.90	37.00	50.69	23.50	247.42		
1991	20.70	35.06	50.59	12.21	339.77		
1992	24.60	31.21	42.86	12.24	279.04		
1993	31.40	32.16	42.44	12.20	192.09		
1994	36.60	37.32	38.04	23.82	262.69		
1995	29.10	45.69	69.54	22.60	130.06		
1996	35.10	45.53	58.59	21.96	219.73		
1997	30.40	43.87	83.42	30.25	233.56		
1998	31.00	39.54	87.42	24.41	134.96		
1999	40.70	33.30	70.74	25.70	209.55		
2000	41.90	44.67	90.10	24.58	316.57		53.28
2001	58.70	45.00	208.64	23.21	274.25		74.87
2002	64.40	41.10	216.13	24.43	323.65	82.87	91.83
2003	42.40	44.04	201.63	34.56	255.93	81.61	74.70
2004	50.30	40.44	216.77	32.20	350.80	94.19	74.89
2005	62.20	38.26	187.06	18.09	208.08	55.87	66.95
2006	65.80	51.36	198.92	27.30	268.60	40.25	64.68
2007	45.30	39.33	480.70	19.80	421.56	37.22	66.98
2008	53.90	34.13	483.69	23.30	334.31	21.56	65.50
2009	50.90	34.13	492.26	23.30	347.51	25.36	67.86
2010	62.30	36.97	510.42	23.30	255.19	24.01	55.39
2011	52.10	27.17	494.40	23.30	270.44	19.27	56.97
2012	48.50	26.22	506.40	23.30	310.31	26.37	69.12

SANTA MARGARITA RIVER WATERSHED
ANNUAL WATERMASTER REPORT
WATER YEAR 2011-12

APPENDIX C
SUBSTANTIAL USERS OUTSIDE
ORGANIZED WATER SERVICE AREAS

July 2013

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

APPENDIX C

SANTA MARGARITA RIVER WATERSHED
SUBSTANTIAL USERS OUTSIDE ORGANIZED WATER SERVICE AREAS

CURRENT OWNER	ADDRESS	ASSESSOR PARCEL NO.	PARCEL ACREAGE	ACRES IRRIGATED 2011-12	IRRIGATED CROP 2011-12	WELL/ DIVERSION LOCATION TWP/RNG/SEC	WELL PRODUCTION AC. FT	SURFACE DIVERSION AC. FT
AGUANGA GROUNDWATER AREA								
Vail Custodial Services and Vail Lake Rancho California	43425 Sage Road 44175 Sage Road Aguanga, CA 92536	917-050-007	82.19	Total				
		917-050-009	309.74					
		581-070-013	43.10	of				
		581-070-015	2.73					
		581-070-016	157.21					
		581-150-013	120.56					
		581-150-016	25.37					
				30.00	Alfalfa	8S/1E-7N(1) 8S/1E-7N(2) 8S/1E-7Q(1) 8S/1E-7Q(2)	Total of 90.00	
Val Verde Partners	43023 Hwy 79 Aguanga, CA 92536 m/t P.O. Box 1974 Rancho Santa Fe CA 92067	583-040-022	97.78	** Total		8S/1E-19Q(1)	** 0.00	
		583-040-021	13.45			8S/1E-19Q(2)	** 0.00	
		583-130-055	40.00	of	Oats and Pasture			
		583-120-092	160.00					
		583-060-003-9	41.60	13.45				
						8S/1E-29L - Diversion		** 56.8
Zen-Kamata, LLC Kamata, Nobuo and Osamu	42551 Hwy 79 Aguanga, CA 92536 m/t 2635 N. First St., Ste. 213 San Jose, CA 95134	583-040-028	25.52	0.00				
		583-040-029	19.89	0.00		8S/1E-19K 8S/1E-19G4	0.00 0.00	
		583-040-024	23.48	0.00				
		583-040-025	23.12	0.00				
		583-040-026	23.16	0.00				
		583-040-027	22.64	0.00				
						8S/1E-29L - Diversion		0.00
Aguanga Properties, LLC (Twin Creek Ranch)	44201 Hwy 79 44735 Hwy 79 Aguanga, CA 92536 m/t Chester Mason P. O. Box 892378 Temecula, CA 92589	583-120-091	39.57	10.00	Row Crops	8S/1E-33D	Total	
		583-120-083	68.09	60.00	Row Crops	8S/1E-28N1 8S/1E-28N(2)		
		583-120-090	132.82	40.00	Row Crops	8S/1E-29H	of	
		583-150-001	80.00	20.00	Row Crops			
		583-140-014	48.03	15.00	Row Crops	8S/1E-33F		
		583-140-015	40.00	35.00	Row Crops	8S/1E-33G1		
		583-140-016	40.00	35.00	Row Crops	8S/1E-33B	900.00	
		583-140-018	10.09	0.00				
		583-140-019	10.12	0.00				
		583-140-020	10.15	0.00				

Well number in parentheses designated by Watermaster

** Water Use Report Form not submitted to Watermaster for Water Year 2011-12, indicated value assumed to be the same as prior year.

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

APPENDIX C

SANTA MARGARITA RIVER WATERSHED
SUBSTANTIAL USERS OUTSIDE ORGANIZED WATER SERVICE AREAS

CURRENT OWNER	ADDRESS	ASSESSOR PARCEL NO.	PARCEL ACREAGE	ACRES IRRIGATED 2011-12	IRRIGATED CROP 2011-12	WELL/ DIVERSION LOCATION TWP/RNG/SEC	WELL PRODUCTION AC. FT	SURFACE DIVERSION AC. FT
AGUANGA GROUNDWATER AREA (Cont)								
Yanik, Robert	41750 Highway 79 Aguanga, CA 92536	917-050-006	233.57	60.00	Row Crops	8S/1W-13Q1	Total of 696.00	
		917-170-003	80.81	38.00	Row Crops	8S/1W-13Q2		
		917-290-001	126.26	38.00	Row Crops			
		917-290-002	82.25	38.00	Row Crops			
Harris, Dolores G.	44444 Sage Road Aguanga, CA 92536	581-160-025	18.10	17.00	Citrus & Grass	8S/1E-18J(1)	0.00	
						8S/1E-18J(2)	0.00	
		581-160-015	7.42	10.00	Fruit			
		581-150-009	7.00	6.00	Fruit	8S/1E-18H(1)	6.26	
						8S/1E-18H(2)	0.00	
		581-180-022	30.00	0.00				
		581-180-004	20.00	0.00				
		581-180-020	20.00	0.00		8S/1E-17M	19.75	
Valley-Wide Recreation and Parks District	901 W. Esplanade Ave San Jacinto, CA 92582	581-180-021	2.15	0.00		8S/1E-17E	39.08	
		581-170-009	7.82	7.82	Grass	Used 8S/1E-17E owned by Harris		
Wilson Creek Farms	44200 Sage Road Aguanga, CA 92536 m/t P. O. Box 2921 Hemet, CA 92546	581-170-012	190.40	20.00	Row Crops	8S/1E-17B	300.00	
		581-170-013	99.63	60.00	Row Crops			
		581-180-005	2.76					
		581-180-009	120.00	60.00	Pasture			
		581-190-013	280.00	110.00	Row Crops			
Wilson Creek Development, LLC	44200 Sage Road Aguanga, CA 92536 m/t P. O. Box 2921 Hemet, CA 92546	581-190-014	40.00					410.00
		581-070-002	160.00					
		581-070-005	640.00			8S/1E-9Q - Diversion		
		581-100-013	80.00					
		581-100-019	30.00					
		581-100-020	10.00					
		581-100-022	20.00					
		581-100-038	9.53					
		581-100-039	9.23					
		581-100-040	8.91					
		TOTAL AGUANGA GROUNDWATER AREA				723.27		

Well number in parentheses designated by Watermaster

** Water Use Report Form not submitted to Watermaster for Water Year 2011-12, indicated value assumed to be the same as prior year.

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

APPENDIX C

SANTA MARGARITA RIVER WATERSHED
SUBSTANTIAL USERS OUTSIDE ORGANIZED WATER SERVICE AREAS

CURRENT OWNER	ADDRESS	ASSESSOR PARCEL NO.	PARCEL ACREAGE	ACRES IRRIGATED 2011-12	IRRIGATED CROP 2011-12	WELL/ DIVERSION LOCATION TWP/RNG/SEC	WELL PRODUCTION AC. FT	SURFACE DIVERSION AC. FT	
TEMECULA CREEK ABOVE AGUANGA GROUNDWATER AREA									
Agri-Empire, Inc.	m/t P. O. Box 490 San Jacinto, CA 92383	113-090-01***	377.07	95.00	Potatoes				
		113-130-01***	150.09	0.00		9S/2E-17D - Spring		0.00	
		113-140-03	196.54	0.00		9S/2E-16N2	20.00		
						9S/2E-16M	165.00		
						9S/2E-16F1	112.00		
						9S/2E-16N1	70.00		
						9S/2E-16F2	0.00		
						9S/2E-16K - Diversion		0.00	
		114-020-09	37.16	0.00					
		114-030-07	93.38	0.00					
*** Land leased from the State of California		114-030-34	137.50	0.00					
		114-030-36	29.55	0.00					
* Land leased from Arlie W. and Coral R. Bergman	37126 Hwy 79 Warner Springs, CA 92086	113-140-01 *	358.62	80.00	Potatoes	9S/2E-16B(1)	241.00		
						9S/2E-16B(2)	0.00		
						9S/2E-16G	0.00		
		113-140-02 *	38.75	0.00					
Hill Springs Farm, LLC	38642 Highway 79 Warner Springs, CA 92086 m/t P.O. Box 1946 Duarte, CA 91009	113-060-012	63.21	0.00	Grapes	9S/2E-7D	0.00		
						9S/2E-7E - Diversion		0.00	
						9S/1E-1M - Diversion		0.00	
						9S/1E-1Q(1)	0.00		
						9S/1E-1Q(2)	71.50		
						9S/1E-12A	Domestic		
		112-030-38	40.00	0.00					
		112-030-67	67.41	0.00					
Lovingier Family Trust	35490 Highway 79 Warner Springs, CA 92086	114-120-042	78.41	Total	Pasture	9S/2E-35D1	Total		
						9S/2E-35D1			
		114-070-007	76.42			9S/2E-27R1	of		
						9S/2E-27R2			
						9S/2E-27J	645.81		
		114-070-27	19.15	of					
		114-070-28	19.15						
		114-070-34	167.94						
		114-080-014	42.51						
	114-080-013	21.30	169.95						
TOTAL TEMECULA CREEK ABOVE AGUANGA GROUNDWATER AREA				409.95			1,325.31	0.00	

Well number in parentheses designated by Watermaster

** Water Use Report Form not submitted to Watermaster for Water Year 2011-12, indicated value assumed to be the same as prior year.

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

APPENDIX C

SANTA MARGARITA RIVER WATERSHED
SUBSTANTIAL USERS OUTSIDE ORGANIZED WATER SERVICE AREAS

CURRENT OWNER	ADDRESS	ASSESSOR PARCEL NO.	PARCEL ACREAGE	ACRES IRRIGATED 2011-12	IRRIGATED CROP 2011-12	WELL/ DIVERSION LOCATION TWP/RNG/SEC	WELL PRODUCTION AC. FT	SURFACE DIVERSION AC. FT
WILSON CREEK ABOVE AGUANGA GROUNDWATER AREA								
ANZA VALLEY								
Greenwald, Alvin G.	55255 Mitchell Road Anza, CA 92539 m/t 6010 Wilshire Blvd., #500 Los Angeles, CA 90036	573-180-001	156.38	0.00		7S/3E-17E	0.00	0.00
Miller, Frank C. Grabowski-Miller, Jane	55520 Hwy 371 Anza, CA 92539	573-200-009	36.40	5.00	Grapes	7S/3E-17(N) 7S/3E-17(M) 7S/3E-17(P)	5.00 0.00 44.10	
Anza Development Corp Lanik, Gordon	m/t P.O. Box 391273 Anza, CA 92539	573-200-004 573-200-005 573-200-006 573-200-007 573-200-008 573-200-010	18.24 18.50 18.89 18.88 18.31 18.68	18.00	Potatoes	Note: This property is leased by Agri-Empire and irrigated from Well # 7S/3E-17(P) located on Frank Miller's property listed above.		
Agri-Empire, Inc.	P.O. Box 490 San Jacinto, CA 92383							
	Section 10	575-050-044	14.36	0.00				
	Section 11	575-060-002	133.93	0.00		7S/3E-11N4 7S/3E-11P3	269.00 179.00	
	Section 13	575-100-009 575-100-032 575-100-033 575-100-034 575-100-035 575-100-036 575-100-037 575-100-039 575-100-040 575-100-041 575-100-042	19.94 89.02 89.08 37.63 157.20 27.91 57.80 7.91 0.88 19.93 60.00	0.00 0.00 0.00 0.00 0.00 0.00 0.00 0.00 0.00 0.00 0.00				
	Section 14	575-110-021 575-110-027 575-110-030 575-310-002 575-310-011 575-310-012 575-310-013 575-310-014 575-310-027 575-310-028	143.75 54.45 74.86 39.09 80.00 80.00 17.46 0.75 17.46 0.92	110.00 0.00 0.00 0.00 17.00 0.00 0.00 0.00 0.00 0.00	Row Crops Potatoes	7S/3E-14D1 7S/3E-14C2	73.00 211.00	
	Section 15	575-080-010 575-080-014 575-080-015 575-080-017 575-080-018 575-080-019 575-080-021 575-080-022 575-080-024 575-080-027 575-090-010	4.77 9.92 4.35 9.75 10.13 31.29 20.00 20.00 20.00 20.00 38.80	0.00 0.00 0.00 0.00 0.00 0.00 0.00 0.00 0.00 0.00 0.00				

Well number in parentheses designated by Watermaster

** Water Use Report Form not submitted to Watermaster for Water Year 2011-12, indicated value assumed to be the same as prior year.

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

APPENDIX C

SANTA MARGARITA RIVER WATERSHED
SUBSTANTIAL USERS OUTSIDE ORGANIZED WATER SERVICE AREAS

CURRENT OWNER	ADDRESS	ASSESSOR PARCEL NO.	PARCEL ACREAGE	ACRES IRRIGATED 2011-12	IRRIGATED CROP 2011-12	WELL/ DIVERSION LOCATION TWP/RNG/SEC	WELL PRODUCTION AC. FT	SURFACE DIVERSION AC. FT
WILSON CREEK ABOVE AGUANGA GROUNDWATER AREA								
ANZA VALLEY (Cont)								
Agri-Empire, Inc. (Cont)	Section 17	573-180-011	39.74	0.00				
	Section 20	576-060-009	8.26	Total				
		576-060-031	16.09					
		576-060-033	79.45					
		576-060-038	5.41	of				
		576-070-003	80.00					
		576-070-005	116.57	94.00	Potatoes			
	Section 21	576-100-061	37.71	40.00	Row Crops			
		576-110-001	160.00	39.00	Potatoes	7S/3E-21P(1)	390.00	
				40.00	Row Crops	7S/3E-21P(2)	0.00	
		576-110-002	28.00	0.00				
		576-110-003	2.00	0.00				
		576-110-004	50.00	30.00	Row Crops			
		576-110-006	19.29	Total				
		576-110-007	17.82					
		576-110-008	17.00	of		7S/3E-21R3	251.00	
						7S/3E-21R(4)	505.00	
		576-110-009	18.41	72.52	Row Crops			
	Section 22	575-130-003	19.55	0.00				
		575-130-006	40.89	0.00				
		575-130-008	18.56	Total				
		575-130-009	20.06					
		575-130-010	20.07					
		575-130-011	19.19	of				
		575-130-012	18.18					
		575-130-013	19.02					
		575-130-014	19.00					
		575-130-015	17.58	77.00	Potatoes			
		575-120-012	88.03	0.00				
		575-120-018	20.45	0.00				
		575-120-019	20.45	0.00				
		575-120-032	4.69	0.00				
		575-120-033	4.68	0.00				
		575-120-034	4.68	0.00				
		575-120-035	4.28	0.00				
	Section 23	575-140-006	9.90	0.00				
		575-140-020	90.48	57.00	Potatoes			

Well number in parentheses designated by Watermaster

** Water Use Report Form not submitted to Watermaster for Water Year 2011-12, indicated value assumed to be the same as prior year.

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

APPENDIX C

SANTA MARGARITA RIVER WATERSHED
SUBSTANTIAL USERS OUTSIDE ORGANIZED WATER SERVICE AREAS

CURRENT OWNER	ADDRESS	ASSESSOR PARCEL NO.	PARCEL ACREAGE	ACRES IRRIGATED 2011-12	IRRIGATED CROP 2011-12	WELL/ DIVERSION LOCATION TWP/RNG/SEC	WELL PRODUCTION AC. FT	SURFACE DIVERSION AC. FT
WILSON CREEK ABOVE AGUANGA GROUNDWATER AREA								
ANZA VALLEY (Cont)								
Burnett, Gregory V.	36990 Bonita Vista	573-040-001	235.20	0.00		7S/3E-5	4.00	
	Anza, CA 92539	573-040-002	30.00	0.00				
	m/t P. O. Box 391111	573-050-001	246.33	0.00				
	Anza, CA 92539							
Domestic and Commercial Wells Reported by Bureau of Indian Affairs								
Cahuilla Indian Reservation							Total	
	<u>Wells in</u>	<u>Wells out of</u>	<u>Wells with QYAL and/or QTOAL</u>					
	<u>Basement Complex</u>	<u>Watershed</u>						
	7S/2E-14L1	8S/3E-2A1	7S/2E-14J1	7S/2E-28Q1	7S/3E-31L			
	7S/2E-25D1	8S/3E-2B1	7S/2E-14M1	7S/2E-33C1	7S/3E-31L2			
	7S/2E-26B1	8S/3E-2D1	7S/2E-14M2	7S/2E-33E1	7S/3E-34E1			
	7S/2E-26B2	8S/3E-2E1	7S/2E-14R1	7S/2E-33N1	7S/3E-34N1			
	7S/2E-26B3	8S/3E-2G1	7S/2E-23A1	7S/3E-27C1	7S/3E-34Q1			
	7S/2E-34E1	8S/3E-2H1	7S/2E-23D1	7S/3E-27C2	8S/2E-4D1			
	7S/2E-36A1	8S/3E-2K1	7S/2E-23F1	7S/3E-27H1	8S/2E-4N1			
	7S/2E-36J1		7S/2E-23G1	7S/3E-27M1	8S/2E-4N2			
	7S/2E-36R1		7S/2E-23H1	7S/3E-28A1	8S/2E-4P1			
	7S/3E-26A1		7S/2E-23K1	7S/3E-28A2	8S/2E-4R1			
	7S/3E-29Q1		7S/2E-23M1	7S/3E-28D1	8S/2E-4R2			
	7S/3E-30H1		7S/2E-23P1	7S/3E-29C1	8S/3E-5Q1			
	7S/3E-31A1		7S/2E-23Q1	7S/3E-29M1	8S/3E-6J1			
	7S/3E-31N1		7S/2E-25C1	7S/3E-30P1				
	7S/3E-31Q1		7S/2E-25F1	7S/3E-30Q1				
	7S/3E-32D1		7S/2E-25R1	7S/3E-30R1				
	7S/3E-32D2		7S/2E-26E1	7S/3E-30R2				
	8S/3E-6B1		7S/2E-26L1	7S/3E-30R3				
	8S/3E-6B2		7S/2E-27A1	7S/3E-31C1				
	8S/3E-6G1		7S/2E-27H1	7S/3E-31F1				
	8S/3E-6R1		7S/2E-28N1					
						Domestic Stock Watering	46.00	5.60
SUBTOTAL ANZA VALLEY				599.52			1,977.10	5.60
WILSON CREEK ABOVE AGUANGA GROUNDWATER AREA								
LEWIS VALLEY								
Green Shell Company Shellabarger, James L.	39850 Sage Road Hemet, CA 92343	571-080-012	80.00	** 40.00	Olive Trees	7S/1E-20Q	** 44.00	
SUBTOTAL LEWIS VALLEY				40.00			44.00	0.00
TOTAL WILSON CREEK ABOVE AGUANGA GROUNDWATER AREA				639.52			2,021.10	5.60

Well number in parentheses designated by Watermaster

** Water Use Report Form not submitted to Watermaster for Water Year 2011-12, indicated value assumed to be the same as prior year.

APPENDIX C

**SANTA MARGARITA RIVER WATERSHED
SUBSTANTIAL USERS OUTSIDE ORGANIZED WATER SERVICE AREAS**

CURRENT OWNER	ADDRESS	ASSESSOR PARCEL NO.	PARCEL ACREAGE	ACRES IRRIGATED 2011-12	IRRIGATED CROP 2011-12	WELL/ DIVERSION LOCATION TWP/RNG/SEC	WELL PRODUCTION AC. FT	SURFACE DIVERSION AC. FT
MURRIETA-TEMECULA GROUNDWATER AREA								
Louidar	c/o McMillan Farm Mgt. 29379 Rancho Cal. Rd #201 Temecula, CA 92390	943-040-011 943-060-010 943-060-011	19.22 90.76 26.47	** 18.00 ** 89.00 ** 24.00	Citrus Citrus Citrus	7S/2W-28L	** 249.00	
Anza Grove Cavaletto, Selina J. Lassalette Enterprise	c/o McMillan Farm Mgt. 29379 Rancho Cal. Rd, #201 Temecula, CA 92390	942-180-002 942-240-003 942-240-004 942-240-005	40.00 40.00 40.00 35.00	Total of 155.00	Citrus	7S/2W-26B1 7S/2W-26B2	294.00	
Vail Lake USA, LLC Mendoza, Bertha	38695 Highway 79 Warner Springs, CA 92086 m/t 29400 Rancho Cal. Road Temecula, CA 92593	917-240-019 917-240-015 917-150-006 917-150-002	54.13 20.00 120.00 117.76	** 0.00 ** 0.00 ** 110.00 ** 0.00	Citrus	8S/1W-21K(1) 8S/1W-21K(2) 8S/1W-21P(1) 8S/1W-21P(2)	** 262.00 ** 0.00 ** 0.00 ** 0.00	
Wild Horse Peak Vineyard Mountain	Highway 79 S Temecula, CA m/t 3719 South Plaza Drive Santa Ana, CA 92704	943-230-001 917-250-004 917-250-005 917-250-007	109.34 80.00 80.00 240.00	75.00 Total of 220.00	Grapes Grapes	7S/2W-26L 8S/1W-25Q(1) 8S/1W-25P(1) 8S/1W-25N(1)Spring 3 8S/1W-36K Spring 4 8S/1W-36H Spring 6 8S/1W-36K(1) 8S/1W-36K(2) 8S/1W-36K(3) 8S/1W-36L - Stream Diversion	0.00 0.00 28.00 59.00 56.00 94.00	0.00 0.00 0.00 52.00
Regency Properties Temecula Creek Golf	44051 Rainbow Cyn Rd. Temecula, CA 92592	922-220-002 922-220-003 922-220-004 922-220-007 922-220-008 922-230-002 922-230-003 922-230-004 922-230-007 922-230-008	86.11 5.75 52.18 14.36 3.99 59.29 1.00 40.00 25.00 16.11	Total of 150.00	Grass	8S/2W-19(D)	275.98	
Carson, Carol J.	25471 Hayes Ave Murrieta, CA 92562	909-260-036 909-260-042	8.87 4.31	7.00 3.50	Pasture Pasture	7S/3W-29G	39.90	
TOTAL MURRIETA-TEMECULA GROUNDWATER AREA				851.50			1,357.88	52.00

Well number in parentheses designated by Watermaster

** Water Use Report Form not submitted to Watermaster for Water Year 2011-12, indicated value assumed to be the same as prior year.

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

APPENDIX C

SANTA MARGARITA RIVER WATERSHED
SUBSTANTIAL USERS OUTSIDE ORGANIZED WATER SERVICE AREAS

CURRENT OWNER	ADDRESS	ASSESSOR PARCEL NO.	PARCEL ACREAGE	ACRES IRRIGATED 2011-12	IRRIGATED CROP 2011-12	WELL/ DIVERSION LOCATION TWP/RNG/SEC	WELL PRODUCTION AC. FT	SURFACE DIVERSION AC. FT
SANTA MARGARITA RIVER BELOW GORGE								
DE LUZ CREEK								
Stehly Family Holdings, LLC	40922 DeLuz Road Fallbrook, CA 92028 m/t 13268 McNally Road Valley Center, CA 92082	101-271-28	45.01	** 10.00	Avocados and Citrus	8S/4W-29D(1) 8s/4W-29D(2)	** 1.00 ** 8.00	
Prestininzi, Pete and Dorothy N.	2525 E. Mission Road Fallbrook, CA 92028 Richmond Truck Trail and DeLuz Murrieta Road	101-220-12 101-210-53	31.63 50.44	6.00 12.00	Pasture & Flowers Avocados and Citrus	8S/4W-20A(1) 8S/4W-20H(1) 8S/4W-20H(2) 8S/4W-20A - Diversion	16.00 16.00 14.00	0.00
Alfred Varela Sr. Family Living Trust Varela, Alfred	41125 DeLuz Road Fallbrook, CA 92028	101-210-11	15.23	8.50 0.50	Avocados Citrus	8S/4W-20Q(1) 8S/4W-20Q(2)	Total of 21.60	
Lake Forest, LLC	41257 DeLuz Road Fallbrook, CA 92028 m/t 26051 Glen Canyon Dr. Laguna Hills, CA 92653	101-210-12	30.28	9.00 15.00 1.00	Avocados Citrus Row crops	8S/4W-20Q(1) 8S/4W-20Q(2) 8S/4W-20Q(3)	Total of 50.00	
Wagner Family Trust	41128 DeLuz Road Fallbrook, CA 92028	101-210-23 101-210-22	17.19 4.55	15.00 3.00	Avocados Persimmons	8S/4W-20P(1) 8S/4W-20P(2) 8S/4W-20P(3)	0.00 0.00 39.30	
Chambers Family, LLC	40888 Deluz-Murrieta Road 38664 DeLuz Road Fallbrook, CA 92028 m/t Thomas Montllor 910 N. Pacific St., Apt. 38 Oceanside, CA 92054	101-571-03 102-130-42	41.72 54.37	40.00 5.00	Flowers Fruit	8S/4W-28A 8S/4W-28A - Diversion	52.00	8.00
Welburn Family Trust Wellburn, Douglas and Sue	40787 DeLuz-Murrieta Rd. Fallbrook, CA 92028	101-571-19 101-571-20 101-571-21	4.01 4.00 14.28	6.00 4.00 2.00	Gourds Melons Fruit Trees and Avocados	8S/4W-28G1	40.00	
Poladian, Jacqueline Bluebird Ranch	2193 Calle Rociada Fallbrook, CA m/t P. O. Box 1089 Fallbrook, CA 92088	101-312-01 101-312-02	82.29 58.17	42.00 45.00 5.00	Flowers Flowers Avocados	8S/4W-31L 8S/4W-31L - Diversion 8S/4W-31K(1) 8S/4W-31K(2) 8S/4W-31K(3)	Total of 162.18	31.48
Norman and Deborah Vanginkel Trust	39452 DeLuz Road Fallbrook, CA 92028 m/t 21136 Trailside Drive Yorba Linda, CA 92887	101-312-03 102-052-04 102-731-02	80.00 22.04 4.26	10.00 15.00	Nursery Stock Avocados	8S/4W-31J(2) 8S/4W-31J(3) 8S/4W-31J(4) 8S/4W-31J(5)	10.00 0.00 40.00 0.00	
Ross Lake, LLC Rose, William and Joanne	39985 Dally Road Fallbrook, CA 92028	101-430-30 101-500-01 101-480-14	16.39 16.62 13.20	Total of 21.00	Avocados Limes Flowers	8S/4W-34- Lake Diversion		7.00
SUBTOTAL DELUZ CREEK				275.00			470.08	46.48

Well number in parentheses designated by Watermaster

** Water Use Report Form not submitted to Watermaster for Water Year 2011-12, indicated value assumed to be the same as prior year.

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

APPENDIX C

SANTA MARGARITA RIVER WATERSHED
SUBSTANTIAL USERS OUTSIDE ORGANIZED WATER SERVICE AREAS

CURRENT OWNER	ADDRESS	ASSESSOR PARCEL NO.	PARCEL ACREAGE	ACRES IRRIGATED 2011-12	IRRIGATED CROP 2011-12	WELL/ DIVERSION LOCATION TWP/RNG/SEC	WELL PRODUCTION AC. FT	SURFACE DIVERSION AC. FT
SANTA MARGARITA RIVER BELOW GORGE (Cont)								
SANDIA CREEK								
Cal June, Inc.	40376 Sandia Creek Fallbrook, CA 92028 m/t P. O. Box 9551 No. Hollywood, CA 91609	101-360-40	126.32	55.00	Avocados	8S/4W-25P(1) 8S/4W-25P(2) 8S/4W-25P(3) 8S/4W-25P(4) 8S/4W-25P(5) 8S/4W-25P - Diversion	Total of 9.00	
SUBTOTAL SANDIA CREEK				55.00			9.00	0.00
SANTA MARGARITA RIVER								
San Diego State University Foundation	47981 Willow Glen Rd. Temecula, CA 92592 m/t Matt Rahn, Director SDSU Foundation 5500 Campanile Dr. San Diego, CA 92182-4614	918-040-011 918-060-017	120.00 40.00	5.00 15.00	Citrus Avocados	8S/3W-33Q1 8S/3W-33Q(2) 8S/3W-33Q - Diversion	4.31 0.00	41.30
SUBTOTAL SANTA MARGARITA RIVER				20.00			4.31	41.30
TOTAL SANTA MARGARITA RIVER BELOW GORGE				350.00			483.39	87.78
LOWER MURRIETA								
Ronnenberg Family Trust (Sage Ranch Nursery)	42522 E. Benton Rd. Aguanga, CA 92536 m/t c/o Cliff Ronnenberg 11292 Western Avenue Stanton, CA 90680	571-020-046 571-020-047 571-020-048 571-020-049 571-020-004 571-520-007 571-520-008 571-520-009 571-520-012 915-140-069 915-140-070 470-210-007 470-220-004	81.09 40.80 36.75 148.86 1.50 109.50 99.43 80.23 77.54 91.56 21.39 53.62 109.23	0.00 0.00 0.00 0.00 0.00 Total of 300.00		7S/1E-7D Olive trees 7S/1E-7E - Diversion	5.50	100.00
EG High Desert Properties LLC	39800 E. Benton Rd. Temecula, CA 92390 m/t 12881 Bradley Avenue Sylmar, CA 91342	915-120-045	37.45	10.00	Pasture	7S/1W-10R(1) 7S/1W-10R(2) 7S/1W-10R(3) 7S/1W-10R(4) 7S/1W-10R(5) 7S/1W-10R(6) 7S/1W-10R(7)	Total of 38.00 Domestic 0.00 0.00	
TOTAL LOWER MURRIETA				310.00			43.50	100.00
GRAND TOTAL				3,284.24			7,282.27	712.18
GRAND TOTAL				3,284.24	Not including Cahuilla Indian Reservation		7,236.27	706.58

Well number in parentheses designated by Watermaster

** Water Use Report Form not submitted to Watermaster for Water Year 2011-12, indicated value assumed to be the same as prior year.

SANTA MARGARITA RIVER WATERSHED
ANNUAL WATERMASTER REPORT
WATER YEAR 2011-12

APPENDIX D
WATER QUALITY DATA

July 2013

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-3

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS SAMPLED BY WESTERN MUNICIPAL WATER DISTRICT
MURRIETA DIVISION

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
Holiday Well 7S/3W-20C09	06/16/89	1300	775	122	39	100	2	178	66	372	40
	10/18/91	---	---	---	---	---	---	---	---	---	25
	11/15/91	---	---	---	---	---	---	---	---	---	26
	12/13/91	---	---	---	---	---	---	---	---	---	28
	01/10/92	---	---	---	---	---	---	---	---	---	27
	02/07/92	---	---	---	---	---	---	---	---	---	27
	05/01/92	---	---	---	---	---	---	---	---	---	32
	05/29/92	---	---	---	---	---	---	---	---	---	28
	08/21/92	---	---	---	---	---	---	---	---	---	27
	01/22/93	960	605	83	29	83	2	130	84	278	33
	10/15/93	---	---	---	---	---	---	---	---	---	32
	03/30/94	---	---	---	---	---	---	---	---	---	44
	06/22/94	---	---	---	---	---	---	---	---	---	35
	09/14/94	---	---	---	---	---	---	---	---	---	31
	12/07/94	---	---	---	---	---	---	---	---	---	30
	03/01/95	---	---	---	---	---	---	---	---	---	32
	06/21/95	---	---	---	---	---	---	---	---	---	11
	09/13/95	---	---	---	---	---	---	---	---	---	27
	12/06/95	---	---	---	---	---	---	---	---	---	26
	03/27/96	---	---	---	---	---	---	---	---	---	15
	06/06/96	---	---	---	---	---	---	---	---	---	24
	09/11/96	---	---	---	---	---	---	---	---	---	22
	11/08/96	---	---	---	---	---	---	---	---	---	55
	11/14/96	---	---	---	---	---	---	---	---	---	25
	12/05/96	---	---	---	---	---	---	---	---	---	24
	03/27/97	---	---	---	---	---	---	---	---	---	20
	06/18/97	---	---	---	---	---	---	---	---	---	21
	12/03/97	---	---	---	---	---	---	---	---	---	18
	03/25/98	---	---	---	---	---	---	---	---	---	21
	04/22/98	1090	680	89	29	85	1	150	76	290	22
	06/17/98	---	---	---	---	---	---	---	---	---	23
	10/01/98	---	---	---	---	---	---	---	---	---	25
	12/02/98	---	---	---	---	---	---	---	---	---	28
	02/24/99	---	---	---	---	---	---	---	---	---	33
	03/24/99	---	---	---	---	---	---	---	---	---	26
	09/09/99	---	---	---	---	---	---	---	---	---	36
	12/03/99	---	---	---	---	---	---	---	---	---	32
	07/12/00	---	---	---	---	---	---	---	---	---	21
	08/04/00	1290	790	110	36	99	---	180	110	320	21
	10/24/01	---	---	---	---	---	---	---	---	---	17
	03/06/02	---	---	---	---	---	---	---	---	---	15
	07/11/02	---	780	---	---	---	---	---	---	310	---
	10/03/03	---	800	113	---	---	---	---	---	332	---
	04/21/04	---	---	---	---	---	---	---	---	---	11
	01/27/05	---	980	160	47	---	---	---	---	440	---

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-3

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS SAMPLED BY WESTERN MUNICIPAL WATER DISTRICT
MURRIETA DIVISION

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
Holiday Well	03/30/05	---	---	---	---	---	---	---	---	---	35
7S/3W-20C09	01/26/06	1700	1000	160	48	130	1.6	240	130	---	46
(Cont)	01/30/06	---	---	---	---	---	---	---	---	---	49
House Well	06/16/89	660	345	34	3	95	2	87	60	153	<1
7S/3W-20G06	02/27/91	770	---	---	---	---	---	110	65	168	<1
	03/01/91	730	---	---	---	---	---	110	---	---	<1
	03/08/91	680	420	42	5	90	2	110	68	122	<1
	05/10/91	750	---	---	---	---	---	---	---	---	<1
	10/11/91	---	---	---	---	---	---	---	---	---	<1
	11/08/91	---	---	---	---	---	---	---	---	---	<1
	05/22/92	---	---	---	---	---	---	---	---	---	<1
	08/14/92	---	---	---	---	---	---	---	---	---	<1
	01/22/93	720	415	40	5	106	2	100	68	168	<1
	09/07/94	---	---	---	---	---	---	---	---	---	<1
	12/27/95	---	---	---	---	---	---	---	---	---	<1
	03/22/95	---	---	---	---	---	---	---	---	---	<1
	06/14/95	---	---	---	---	---	---	---	---	---	<1
	09/06/95	---	---	---	---	---	---	---	---	---	<1
	12/27/95	---	---	---	---	---	---	---	---	---	<1
	03/20/96	---	---	---	---	---	---	---	---	---	<2
	06/12/96	---	---	---	---	---	---	---	---	---	<2
	09/04/96	---	---	---	---	---	---	---	---	---	<2
	12/26/96	---	---	---	---	---	---	---	---	---	<2
	03/19/97	---	---	---	---	---	---	---	---	---	<2
	06/12/97	---	---	---	---	---	---	---	---	---	<2
	12/30/97	---	---	---	---	---	---	---	---	---	<2
	03/18/98	---	---	---	---	---	---	---	---	---	<2
	04/15/98	660	360	30	3	94	1	91	62	130	<2
	06/10/98	---	---	---	---	---	---	---	---	---	<2
	10/01/98	---	---	---	---	---	---	---	---	---	<2
	12/23/98	---	---	---	---	---	---	---	---	---	<2
	02/17/99	---	---	---	---	---	---	---	---	---	<2
	03/17/99	---	---	---	---	---	---	---	---	---	<2
	06/09/99	---	---	---	---	---	---	---	---	---	<2
	09/01/99	---	---	---	---	---	---	---	---	---	<2
	12/22/99	---	---	---	---	---	---	---	---	---	ND
	03/15/00	640	370	29	3	92	2	82	61	130	<2
	06/07/00	---	---	---	---	---	---	---	---	---	<2
	09/27/00	---	---	---	---	---	---	---	---	---	<2
	10/24/01	---	---	---	---	---	---	---	---	---	<2
	03/06/02	---	---	---	---	---	---	---	---	---	<2
	07/11/02	---	440	---	---	---	---	---	---	170	---
	10/03/03	630	380	34	3	103	---	87	---	140	ND
	04/21/04	---	---	---	---	---	---	---	---	---	<2

ND - None Detected

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-3

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS SAMPLED BY WESTERN MUNICIPAL WATER DISTRICT
MURRIETA DIVISION

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
South Well 7S/3W-20D	09/07/90	690	405	62	17	68	2	83	56	229	4
	10/04/91	---	---	---	---	---	---	---	---	---	2
	11/01/91	---	---	---	---	---	---	---	---	---	3
	11/26/91	---	---	---	---	---	---	---	---	---	2
	05/15/92	---	---	---	---	---	---	---	---	---	<1
	10/01/93	---	---	---	---	---	---	---	---	---	2
	09/28/94	---	---	---	---	---	---	---	---	---	1
	12/21/94	---	---	---	---	---	---	---	---	---	3
	03/15/95	---	---	---	---	---	---	---	---	---	2
	06/07/95	---	---	---	---	---	---	---	---	---	2
	09/27/95	---	---	---	---	---	---	---	---	---	2
	12/20/95	---	---	---	---	---	---	---	---	---	3
	03/13/96	---	---	---	---	---	---	---	---	---	2
	06/15/96	---	---	---	---	---	---	---	---	---	3
	09/25/96	---	---	---	---	---	---	---	---	---	3
	12/18/96	---	---	---	---	---	---	---	---	---	3
	04/09/97	---	---	---	---	---	---	---	---	---	2
	06/04/97	---	---	---	---	---	---	---	---	---	2
	03/11/98	---	---	---	---	---	---	---	---	---	<2
	04/08/98	820	500	73	18	67	2	92	73	250	3
	06/03/98	---	---	---	---	---	---	---	---	---	3
	10/01/98	---	---	---	---	---	---	---	---	---	3
	12/16/98	---	---	---	---	---	---	---	---	---	2
	03/10/98	---	---	---	---	---	---	---	---	---	2
	06/09/99	---	---	---	---	---	---	---	---	---	2
	09/22/99	---	---	---	---	---	---	---	---	---	<2
	12/15/99	---	---	---	---	---	---	---	---	---	ND
	02/09/00	810	460	55	14	84	1	99	63	210	<2
	05/03/00	---	---	---	---	---	---	---	---	---	<2
	08/04/00	780	440	47	9	100	---	99	48	210	<2
	08/23/00	---	---	---	---	---	---	---	---	---	<2
	10/24/01	---	---	---	---	---	---	---	---	---	<2
	03/20/02	---	---	---	---	---	---	---	---	---	4
	07/11/02	---	460	---	---	---	---	---	---	180	---
	10/03/03	---	460	59	---	---	---	---	---	207	---
	04/21/04	---	---	---	---	---	---	---	---	---	<2
	01/27/05	---	610	110	28	---	---	---	---	300	---
	03/30/05	---	---	---	---	---	---	---	---	---	5
	01/26/06	800	440	42	9.1	110	1.2	120	65	---	1.2
	04/12/06	---	---	---	---	---	---	---	---	---	6.1
	05/10/06	---	---	---	---	---	---	---	---	---	1.6
	06/14/06	---	---	---	---	---	---	---	---	---	1.4

ND - None Detected

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-3

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS SAMPLED BY WESTERN MUNICIPAL WATER DISTRICT
MURRIETA DIVISION

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
South Well 7S/3W-20D (Cont)	07/12/06	---	---	---	---	---	---	---	---	---	<1
	08/09/06	---	---	---	---	---	---	---	---	---	1.4
	09/13/06	---	---	---	---	---	---	---	---	---	1.5
	10/11/06	---	---	---	---	---	---	---	---	---	1.4
	11/08/06	---	---	---	---	---	---	---	---	---	1.3
	12/13/06	---	---	---	---	---	---	---	---	---	1.3
	01/10/07	---	---	---	---	---	---	---	---	---	1.4
	02/13/07	---	---	---	---	---	---	---	---	---	5.3
	03/14/07	---	---	---	---	---	---	---	---	---	1.2
	04/11/07	---	---	---	---	---	---	---	---	---	<2
	05/09/07	---	---	---	---	---	---	---	---	---	<2
	06/13/07	---	---	---	---	---	---	---	---	---	1.2
	07/11/07	---	---	---	---	---	---	---	---	---	4.7
	08/15/07	800	480	40	8.5	100	<1	110	61	200	1.1
	09/12/07	---	---	---	---	---	---	---	---	---	5.6
	11/14/07	---	---	---	---	---	---	---	---	---	1.4
	12/04/07	---	---	---	---	---	---	---	---	---	1.2
	01/24/08	---	---	---	---	---	---	---	---	---	4.6
	03/26/08	---	---	---	---	---	---	---	---	---	3.9
	04/23/08	---	---	---	---	---	---	---	---	---	4.1
	06/09/08	---	---	---	---	---	---	---	---	---	4.1
	07/14/08	---	---	---	---	---	---	---	---	---	5.1
	09/08/08	---	---	---	---	---	---	---	---	---	4.9
	01/19/09	---	---	---	---	---	---	---	---	---	6.7
	11/13/09	1300	820	120	34	110	1.8	200	140	320	---
	11/17/09	---	---	---	---	---	---	---	---	---	5.8
	11/09/11	---	---	---	---	---	---	---	---	---	1.6
	01/26/12	---	---	---	---	---	---	---	---	---	1.5
North Well 7S/3W-18J02	06/16/89	730	390	40	7	98	2	98	45	201	<1
	10/25/91	---	---	---	---	---	---	---	---	---	<1
	11/22/91	---	---	---	---	---	---	---	---	---	<1
	05/08/92	---	---	---	---	---	---	---	---	---	<1
	08/28/92	---	---	---	---	---	---	---	---	---	<1
	01/22/93	680	405	39	8	99	2	100	51	183	<1
	10/22/93	---	---	---	---	---	---	---	---	---	<1
	07/08/94	810	520	---	---	87	---	130	53	---	<1
	09/21/94	---	---	---	---	---	---	---	---	---	<1
	12/14/94	---	---	---	---	---	---	---	---	---	<1
	03/08/95	---	---	---	---	---	---	---	---	---	<1
	06/28/95	---	---	---	---	---	---	---	---	---	<1
	09/20/95	---	---	---	---	---	---	---	---	---	<1
	12/13/95	---	---	---	---	---	---	---	---	---	<1
	03/06/96	---	---	---	---	---	---	---	---	---	<2
	06/26/96	---	---	---	---	---	---	---	---	---	<2

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-3

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS SAMPLED BY WESTERN MUNICIPAL WATER DISTRICT
MURRIETA DIVISION

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
North Well 7S/3W-18J02 (Cont)	09/18/96	---	---	---	---	---	---	---	---	---	<2
	12/11/96	---	---	---	---	---	---	---	---	---	<2
	06/25/97	---	---	---	---	---	---	---	---	---	<2
	07/08/98	760	460	49	9	100	2	110	51	220	<2
	10/01/98	---	---	---	---	---	---	---	---	---	<2
	12/09/98	---	---	---	---	---	---	---	---	---	<2
	02/03/99	---	---	---	---	---	---	---	---	---	<2
	03/03/99	---	---	---	---	---	---	---	---	---	<2
	06/23/99	---	---	---	---	---	---	---	---	---	<2
	09/22/99	---	---	---	---	---	---	---	---	---	<2
	12/08/99	---	---	---	---	---	---	---	---	---	<2
	01/05/00	780	440	47	9	100	---	99	48	210	<2
	05/03/00	---	---	---	---	---	---	---	---	---	<2
	07/19/00	---	---	---	---	---	---	---	---	---	<2
	10/24/01	---	---	---	---	---	---	---	---	---	<2
	03/06/02	---	---	---	---	---	---	---	---	---	<2
	07/11/02	---	420	---	---	---	---	---	---	180	---
	10/03/03	---	440	53	---	---	---	---	---	---	---
	04/21/04	---	---	---	---	---	---	---	---	---	<2
	01/27/05	---	440	59	10	---	---	---	---	230	---
	03/30/05	---	---	---	---	---	---	---	---	---	<2
	01/26/06	820	450	60	11	96	2	120	52	---	1
	05/10/06	---	---	---	---	---	---	---	---	---	<1
	07/19/06	---	---	---	---	---	---	---	---	---	<1
	08/16/06	---	---	---	---	---	---	---	---	---	<1
	09/20/06	---	---	---	---	---	---	---	---	---	<1
	10/18/06	---	---	---	---	---	---	---	---	---	<1
	11/15/06	---	---	---	---	---	---	---	---	---	<1
	01/17/07	---	---	---	---	---	---	---	---	---	<1
	02/21/07	---	---	---	---	---	---	---	---	---	<2
	03/21/07	---	---	---	---	---	---	---	---	---	<2
	04/18/07	---	---	---	---	---	---	---	---	---	<2
	05/16/07	---	---	---	---	---	---	---	---	---	<2
	07/23/07	---	500	---	---	---	---	---	---	---	---
	07/26/07	---	540	---	---	---	---	---	---	---	---
	08/15/07	830	520	59	11	89	1.2	110	54	230	<2
	09/19/07	---	---	---	---	---	---	---	---	---	<2
	12/04/07	---	---	---	---	---	---	---	---	---	1.5
	01/24/08	---	---	---	---	---	---	---	---	---	1.8
	03/26/08	---	---	---	---	---	---	---	---	---	2.5
	04/23/08	---	---	---	---	---	---	---	---	---	2.0
	05/19/08	---	---	---	---	---	---	---	---	---	2.2
	06/16/08	---	---	---	---	---	---	---	---	---	2.1
	07/21/08	---	---	---	---	---	---	---	---	---	<2

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-3

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS SAMPLED BY WESTERN MUNICIPAL WATER DISTRICT
MURRIETA DIVISION

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
North Well 7S/3W-18J02 (Cont)	09/15/08	---	---	---	---	---	---	---	---	---	2.0
	01/19/09	---	---	---	---	---	---	---	---	---	1
	02/23/09	---	---	---	---	---	---	---	---	---	<2
	03/16/09	---	---	---	---	---	---	---	---	---	<2
	04/20/09	---	---	---	---	---	---	---	---	---	<2
	05/18/09	---	---	---	---	---	---	---	---	---	<2
	06/02/09	830	470	54	11	92	1.6	100	54	230	<2
	06/08/09	830	410	57	10	89	1.6	110	54	230	<2
	06/15/09	---	---	---	---	---	---	---	---	---	<1
	07/07/09	870	490	51	10	87	1.5	110	56	220	---
	07/20/09	830	460	54	10	90	1.7	110	52	220	<2
	08/03/09	820	480	49	9	82	1.4	120	49	220	<2
	08/25/09	---	---	---	---	---	---	---	---	---	1.2
	09/08/09	800	460	55	11	97	1.7	120	52	220	<2
	09/21/09	---	---	---	---	---	---	---	---	---	1.1
	10/05/09	780	470	55	11	97	1.8	110	53	220	<2
	10/19/09	---	---	---	---	---	---	---	---	---	<2
	11/02/09	790	470	55	11	91	1.7	110	53	220	<2
	11/16/09	---	---	---	---	---	---	---	---	---	<2
	12/07/09	810	480	56	11	94	1.8	110	52	220	<1
	12/21/09	---	---	---	---	---	---	---	---	---	<2
	01/04/10	810	470	57	11	91	1.7	110	52	220	<2
	01/18/10	---	---	---	---	---	---	---	---	---	<2
	02/01/10	860	460	59	13	87	1.7	110	54	240	1.2
	02/17/10	---	---	---	---	---	---	---	---	---	1.1
	03/01/10	810	460	56	11	88	1.7	110	55	220	<2
	03/15/10	---	---	---	---	---	---	---	---	---	<2
	04/07/10	820	450	56	11	92	1.5	110	52	220	<2
	04/19/10	---	---	---	---	---	---	---	---	---	<2
	05/03/10	810	450	57	11	92	1.5	110	52	220	<2
	05/17/10	---	---	---	---	---	---	---	---	---	1.1
	06/01/10	820	520	52	11	90	1.9	100	50	220	<2
	06/21/10	---	---	---	---	---	---	---	---	---	<2
	07/19/10	---	---	---	---	---	---	---	---	---	<2
	08/02/10	830	470	52	10	88	1.7	100	47	220	<2
	08/16/10	---	---	---	---	---	---	---	---	---	<2
	11/17/10	830	510	51	20	78	3.6	94	160	120	<2
	02/01/11	860	480	59	12	95	1.7	110	54	220	<2
	04/04/11	800	460	53	11	93	1.6	110	52	210	<2
	04/18/11	---	---	---	---	---	---	---	---	---	<2
	06/21/11	---	---	---	---	---	---	---	---	---	<2
	07/18/11	---	---	---	---	---	---	---	---	---	<1.0
	08/16/11	---	---	---	---	---	---	---	---	---	<1.0

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-3

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS SAMPLED BY WESTERN MUNICIPAL WATER DISTRICT
MURRIETA DIVISION

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
North Well 7S/3W-18J02 (Cont)	09/19/11	---	---	---	---	---	---	---	---	---	<1.0
	10/03/11	770	470	55	11	97	1.9	110	54	210	<1.0
	10/17/11	---	---	---	---	---	---	---	---	---	<1.0
	11/02/11	820	440	55	11	92	1.8	110	54	200	<1.0
	11/15/11	---	---	---	---	---	---	---	---	---	1.1
	12/06/11	820	510	52	10	95	1.6	120	55	200	1.0
	12/19/11	---	---	---	---	---	---	---	---	---	1.1
	12/28/11	820	440	53	11	93	1.8	110	54	200	<1.0
	01/04/12	810	480	53	10	94	1.7	110	57	200	<1.0
	01/16/12	---	---	---	---	---	---	---	---	---	<1.0
	02/01/12	830	510	57	11	93	2.1	120	58	220	<1.0
	02/06/12	---	---	---	---	---	---	---	---	---	<1.0
	02/15/12	810	450	52	10	88	1.7	120	55	210	<1.0
	03/01/12	760	460	62	13	87	1.8	120	57	230	1.0
	03/19/12	---	---	---	---	---	---	---	---	---	<1.0
	04/16/12	---	---	---	---	---	---	---	---	---	1.1
	04/17/12	---	---	---	---	---	---	---	---	---	1.2
	05/02/12	800	460	52	11	96	1.8	120	61	210	<1.0
	05/14/12	---	---	---	---	---	---	---	---	---	<1.0
	06/04/12	820	460	50	10	92	1.8	88	110	200	1.2
	06/19/12	---	---	---	---	---	---	---	---	---	<1.0
	07/02/12	830	510	54	11	93	1.7	120	55	210	1.0
	07/17/12	---	---	---	---	---	---	---	---	---	<1.0
	07/25/12	---	---	---	---	---	---	---	---	---	<1.0
	08/01/12	830	470	56	11	98	1.7	110	54	210	<1.0
	08/13/12	---	---	---	---	---	---	---	---	---	<1.0
	09/10/12	830	440	52	10	96	1.9	110	54	210	<1.0
	09/17/12	---	---	---	---	---	---	---	---	---	<1.0
New Clay Well 7S/3W-20	03/09/04	480	340	23	1	87	1	79	64	98	<2
	01/26/06	590	310	20	1.2	93	1.2	85	57	---	<1
	01/31/06	---	---	---	---	---	---	---	---	---	7.2
	01/31/06	---	---	---	---	---	---	---	---	---	6.9
	04/04/06	---	---	---	---	---	---	---	---	---	<1
	04/12/06	---	---	---	---	---	---	---	---	---	<1
	05/10/06	---	---	---	---	---	---	---	---	---	<1
	06/07/06	---	---	---	---	---	---	---	---	---	<1
	07/05/06	---	---	---	---	---	---	---	---	---	<1
	08/02/06	---	---	---	---	---	---	---	---	---	<1
	09/06/06	---	---	---	---	---	---	---	---	---	<1
	10/04/06	---	---	---	---	---	---	---	---	---	<1
	11/01/06	---	---	---	---	---	---	---	---	---	<1
	12/06/06	---	---	---	---	---	---	---	---	---	<1
	01/04/07	---	---	---	---	---	---	---	---	---	<1
	02/07/07	---	---	---	---	---	---	---	---	---	<1
	03/07/07	---	---	---	---	---	---	---	---	---	<2
	04/04/07	---	---	---	---	---	---	---	---	---	<2
	05/02/07	---	---	---	---	---	---	---	---	---	<2
	06/06/07	---	---	---	---	---	---	---	---	---	<2

ND - None Detected

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-3

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS SAMPLED BY WESTERN MUNICIPAL WATER DISTRICT
MURRIETA DIVISION

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
New Clay Well 7S/3W-20 (Cont)	07/05/07	---	---	---	---	---	---	---	---	---	<2
	08/01/07	---	---	---	---	---	---	---	---	---	<2
	08/15/07	510	270	13	<1	91	1	65	50	83	<2
	09/05/07	---	---	---	---	---	---	---	---	---	<2
	12/04/07	---	---	---	---	---	---	---	---	---	<2
	03/26/08	---	---	---	---	---	---	---	---	---	<1
	04/23/08	---	---	---	---	---	---	---	---	---	<1
	05/05/08	---	---	---	---	---	---	---	---	---	<1
	06/02/08	---	---	---	---	---	---	---	---	---	<1
	07/07/08	---	---	---	---	---	---	---	---	---	<1
	09/02/08	---	---	---	---	---	---	---	---	---	<2
	01/19/09	---	---	---	---	---	---	---	---	---	<2
	11/13/09	630	350	25	4.7	97	1.5	84	76	110	---
	11/17/09	---	---	---	---	---	---	---	---	---	<2
	08/25/11	700	380	30	2.7	110	1.8	97	62	150	<1.0
	05/21/12	---	---	---	---	---	---	---	---	---	<0.20
	06/01/12	590	340	19	<1.0	93	1.4	83	56	110	<1.0
Lynch Well 7S/3W-17R02	06/16/89	760	410	70	17	55	1	86	30	262	8
Morris Well 7S/3W-19R	09/07/90	530	280	38	7	68	3	50	49	168	3
Alson Well 7S/3W-7M	06/06/90	1520	915	138	46	110	1	250	81	433	31
	07/21/98	1260	880	100	37	120	<1	180	92	330	23
	09/09/98	1200	850	110	39	120	<1	180	100	320	23
	05/03/00	---	---	---	---	---	---	---	---	---	20
	05/19/00	1290	800	97	36	110	<1	180	96	330	19
	11/28/01	1290	750	93	33	110	<1	180	96	310	17
	03/06/02	---	---	---	---	---	---	---	---	---	20
	07/01/02	---	650	---	---	---	---	---	---	270	---
	10/03/03	880	550	80	26	95	---	ND	ND	259	ND
	01/27/05	1100	640	100	32	110	---	150	81	320	---
	01/26/06	1500	870	120	41	120	1.2	230	120	---	18
	04/12/06	---	---	---	---	---	---	---	---	---	19
	05/10/06	---	---	---	---	---	---	---	---	---	18
	06/28/06	---	---	---	---	---	---	---	---	---	20
	07/26/06	---	---	---	---	---	---	---	---	---	20
	08/23/06	---	---	---	---	---	---	---	---	---	18
	09/27/06	---	---	---	---	---	---	---	---	---	21
	10/25/06	---	---	---	---	---	---	---	---	---	22
	11/22/06	---	---	---	---	---	---	---	---	---	22
	12/27/06	---	---	---	---	---	---	---	---	---	21

ND - None Detected

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-3

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS SAMPLED BY WESTERN MUNICIPAL WATER DISTRICT
MURRIETA DIVISION

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
Alson Well	01/24/07	---	---	---	---	---	---	---	---	---	22
7S/3W-7M	02/28/07	---	---	---	---	---	---	---	---	---	22
(Cont)	03/29/07	---	---	---	---	---	---	---	---	---	23
	04/25/07	---	---	---	---	---	---	---	---	---	19

Page Intentionally Blank

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-4

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS SAMPLED BY RANCHO CALIFORNIA WATER DISTRICT

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							NO3
				Ca	Mg	Na	K	Cl	SO4	HCO3	
No. 101 7S/3W-34G1	06/01/88	810	495	76	15	79	8	116	16	314	---
	08/05/88	---	---	---	---	---	---	---	---	---	<1
	05/23/90	630	365	30	6	91	2	101	35	107	3
	08/04/93	860	465	76	14	78	2	120	22	275	<1
	08/09/96	820	480	69	14	83	2	110	15	310	<2
	10/16/97	---	---	---	---	---	---	---	---	---	<2
	08/11/99	840	510	70	14	85	2	110	17	300	<2
	06/25/02	---	---	---	---	---	---	---	---	---	<2
	08/14/02	870	500	66	14	85	2.5	120	15	250	<2
	06/11/03	---	---	---	---	---	---	---	---	---	<2
	06/15/04	---	---	---	---	---	---	---	---	---	<2
	06/14/05	---	---	---	---	---	---	---	---	---	<1
	08/09/05	880	440	75	15	87	2.5	140	22	300	<1
	06/07/06	---	---	---	---	---	---	---	---	---	<1
	06/01/07	---	---	---	---	---	---	---	---	---	<2
	06/03/08	---	620	---	---	---	---	---	---	---	<2
	08/11/08	1000	550	91	18	110	2.9	150	36	300	<2
	09/09/08	---	620	---	---	---	---	---	---	---	---
	01/08/09	---	840	---	---	---	---	---	---	---	---
	06/25/09	---	810	---	---	---	---	---	---	---	<2
	03/24/10	---	620	---	---	---	---	---	---	---	---
	06/02/10	---	670	---	---	---	---	---	---	---	<2
	09/01/11	---	620	---	---	---	---	---	---	---	---
	12/09/11	---	610	---	---	---	---	---	---	---	---
	03/07/12	---	650	---	---	---	---	---	---	---	---
	06/12/12	---	650	---	---	---	---	---	---	---	<1
	09/13/12	---	650	---	---	---	---	---	---	---	---
No. 102 8S/3W-2Q1	01/04/89	695	370	9	2	134	1	101	25	195	<1
	01/15/92	930	615	38	4	160	3	160	55	250	<1
	05/17/95	850	475	21	1	144	1	120	130	98	<1
	06/20/95	1190	700	26	2	207	2	150	220	131	<1
	06/09/97	---	---	---	---	---	---	---	---	---	<2
No. 105 7S/3W-25M1	07/06/89	500	280	30	6	66	2	71	22	134	14
	03/17/93	480	310	17	2	80	2	67	22	110	14
No. 106 7S/3W-26R1	06/29/88	920	485	38	5	143	3	182	66	70	16
	05/13/92	880	515	35	4	142	2	180	72	110	17
	05/16/95	870	495	32	3	138	2	160	57	116	14
	07/07/97	---	---	---	---	---	---	---	---	---	8
	07/20/98	---	---	---	---	---	---	---	---	---	9
	07/20/99	---	---	---	---	---	---	---	---	---	9
	07/06/00	---	---	---	---	---	---	---	---	---	8

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-4

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS SAMPLED BY RANCHO CALIFORNIA WATER DISTRICT

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
No. 106 7S/3W-26R1 (Cont)	05/01/01	490	300	7	<1	96	<1	70	23	100	8
	07/10/01	---	---	---	---	---	---	---	---	---	12
	07/03/02	---	---	---	---	---	---	---	---	---	8
	07/07/03	---	---	---	---	---	---	---	---	---	6.8
	05/11/04	530	310	9	<1	93	1	80	25	88	8
	07/13/04	---	---	---	---	---	---	---	---	---	8
	07/07/05	---	---	---	---	---	---	---	---	---	6.5
	07/19/06	---	---	---	---	---	---	---	---	---	6.1
	05/02/07	550	290	8.8	<1	91	<1	84	26	85	3.7
	07/03/07	---	---	---	---	---	---	---	---	---	6
	07/07/08	---	370	---	---	---	---	---	---	---	12
	01/13/09	---	440	---	---	---	---	---	---	---	---
	04/16/09	---	310	---	---	---	---	---	---	---	---
	07/01/09	---	340	---	---	---	---	---	---	---	6.8
	03/18/10	---	440	---	---	---	---	---	---	---	---
	05/06/10	720	410	23	1.6	120	1.5	130	57	100	12
	06/02/10	---	390	---	---	---	---	---	---	---	---
	07/13/10	---	---	---	---	---	---	---	---	---	2
	09/01/10	---	340	---	---	---	---	---	---	---	---
	12/09/10	---	410	---	---	---	---	---	---	---	---
	04/15/11	---	400	---	---	---	---	---	---	---	---
	07/06/11	---	300	---	---	---	---	---	---	---	6
	10/04/11	---	320	---	---	---	---	---	---	---	---
	01/31/12	---	430	---	---	---	---	---	---	---	---
	04/09/12	---	430	---	---	---	---	---	---	---	---
No. 107 7S/3W-26J1	04/11/88	490	365	19	4	73	2	69	22	116	15
	05/29/91	950	535	63	15	104	3	130	120	171	11
No. 108 7S/3W-25E1	05/25/88	780	455	51	11	96	2	120	68	153	14
	05/29/91	930	500	59	14	104	3	130	110	153	10
	05/13/94	640	395	23	5	100	2	120	51	104	7
	05/16/95	---	---	---	---	---	---	---	---	---	5
	05/13/97	540	300	7	<1	110	<1	110	15	85	4
	05/05/99	---	---	---	---	---	---	---	---	---	8
	05/16/00	630	350	7	<1	110	<1	130	12	65	3
	05/02/01	---	---	---	---	---	---	---	---	---	2
	11/19/02	---	---	---	---	---	---	---	---	---	2
	04/14/05	---	---	---	---	---	---	---	---	---	2
	04/18/06	---	---	---	---	---	---	---	---	---	1
	05/12/06	750	360	8.2	<1	140	<1	190	7.9	50	1.1
	02/13/08	---	---	---	---	---	---	---	---	---	1.4
	08/06/08	---	400	---	---	---	---	---	---	---	---
	02/05/09	---	340	---	---	---	---	---	---	---	2.2
	05/08/09	730	380	7.2	<1	130	<1	170	9.4	60	<2.0
	08/05/09	---	370	---	---	---	---	---	---	---	---
	02/03/10	---	---	---	---	---	---	---	---	---	3

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-4

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS SAMPLED BY RANCHO CALIFORNIA WATER DISTRICT

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
No. 108 7S/3W-25E1 (Cont)	05/06/10	---	380	---	---	---	---	---	---	---	---
	08/13/10	---	350	---	---	---	---	---	---	---	---
	11/03/10	---	380	---	---	---	---	---	---	---	---
	02/02/11	---	350	---	---	---	---	---	---	---	2
	05/05/11	---	380	---	---	---	---	---	---	---	---
	08/02/11	---	400	---	---	---	---	---	---	---	---
	11/01/11	---	350	---	---	---	---	---	---	---	---
	02/08/12	---	350	---	---	---	---	---	---	---	<2.0
	05/02/12	700	380	7.2	<1	130	1.2	180	10	63	2.3
No. 109 8S/2W-17J1	06/01/88	1400	920	136	35	120	4	100	300	296	---
	08/05/88	---	---	---	---	---	---	---	---	---	10
	06/12/91	1330	800	110	26	120	5	120	270	275	9
	06/22/94	1370	1010	138	32	124	5	140	320	287	7
	06/06/95	---	---	---	---	---	---	---	---	---	8
	06/13/97	1440	1010	130	31	140	4	140	330	280	10
	07/16/97	---	---	---	---	---	---	---	---	---	2.2 as N
	04/14/99	---	---	---	---	---	---	---	---	---	12
	04/11/00	---	---	---	---	---	---	---	---	---	13
	06/21/00	1330	870	120	28	130	4	120	280	270	3.2
	04/10/01	---	---	---	---	---	---	---	---	---	13
	06/11/03	1400	970	140	32	130	4	130	340	290	12
	06/19/03	1400	970	150	32	120	4.2	130	340	290	12
	01/07/04	---	---	---	---	---	---	---	---	---	13
	01/11/05	---	---	---	---	---	---	---	---	---	13
	01/04/06	---	---	---	---	---	---	---	---	---	12
	07/12/06	1300	930	130	30	130	4.8	130	280	280	12
	01/10/07	---	---	---	---	---	---	---	---	---	13
	01/04/08	---	---	---	---	---	---	---	---	---	13
	07/07/08	---	810	---	---	---	---	---	---	---	---
	01/13/09	---	860	---	---	---	---	---	---	---	16
	04/02/09	---	810	---	---	---	---	---	---	---	---
	07/06/09	---	770	---	---	---	---	---	---	---	---
	01/05/10	---	---	---	---	---	---	---	---	---	14
	04/07/10	---	930	---	---	---	---	---	---	---	---
	07/01/10	---	1000	---	---	---	---	---	---	---	---
	10/06/10	---	830	---	---	---	---	---	---	---	---
	01/12/11	---	920	---	---	---	---	---	---	---	14
	01/25/12	---	880	---	---	---	---	---	---	---	12
	04/03/12	---	910	---	---	---	---	---	---	---	---
No. 110 8S/1W-06K1	03/31/88	1100	630	70	23	132	6	115	163	268	3
	03/11/93	1010	610	60	21	124	5	110	200	201	3
	04/27/95	---	---	---	---	---	---	---	---	---	1
	07/20/99	---	---	---	---	---	---	---	---	---	<2
	07/06/00	---	---	---	---	---	---	---	---	---	2
	07/10/01	---	---	---	---	---	---	---	---	---	2

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-4

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS SAMPLED BY RANCHO CALIFORNIA WATER DISTRICT

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
No. 110 8S/1W-06K1 (Cont)	03/11/02	850	500	58	20	81	5	74	190	160	<2
	07/03/02	---	---	---	---	---	---	---	---	---	<2
	09/16/03	---	---	---	---	---	---	---	---	---	2
	09/01/04	---	---	---	---	---	---	---	---	---	2
	03/02/05	810	510	56	21	79	4.9	76	170	150	<2
	09/07/05	---	---	---	---	---	---	---	---	---	1.8
	09/06/07	---	---	---	---	---	---	---	---	---	2
	03/04/08	980	560	59	21	95	4.6	110	160	190	2.5
	01/20/09	---	610	---	---	---	---	---	---	---	---
	04/02/09	---	550	---	---	---	---	---	---	---	---
	07/09/09	---	560	---	---	---	---	---	---	---	---
	01/06/10	---	560	---	---	---	---	---	---	---	---
	04/07/10	---	630	---	---	---	---	---	---	---	---
	07/01/10	---	730	---	---	---	---	---	---	---	---
	09/01/10	---	---	---	---	---	---	---	---	---	<2
	10/07/10	---	600	---	---	---	---	---	---	---	---
	01/12/11	---	520	---	---	---	---	---	---	---	---
	04/05/11	---	560	---	---	---	---	---	---	---	---
	07/06/11	---	530	---	---	---	---	---	---	---	---
	09/02/11	---	---	---	---	---	---	---	---	---	3.8
	10/13/11	---	470	---	---	---	---	---	---	---	---
	02/16/12	---	440	---	---	---	---	---	---	---	---
	04/04/12	---	400	---	---	---	---	---	---	---	---
	09/05/12	---	---	---	---	---	---	---	---	---	1.5
No. 113 7S/2W-25H01	03/28/88	700	400	41	12	87	2	11	20	192	18
	03/21/91	570	290	21	5	79	2	88	17	119	11
	03/03/94	700	410	46	13	86	2	120	25	189	19
	04/27/95	---	---	---	---	---	---	---	---	---	24
	03/20/97	880	500	53	15	96	2	140	33	200	22
	07/20/98	---	---	---	---	---	---	---	---	---	23
	09/16/98	---	---	---	---	---	---	---	---	---	22
	02/25/99	---	---	---	---	---	---	---	---	---	19
	04/14/99	---	---	---	---	---	---	---	---	---	17
	06/03/99	---	---	---	---	---	---	---	---	---	21
	09/14/99	---	---	---	---	---	---	---	---	---	22
	10/21/99	---	---	---	---	---	---	---	---	---	25
	11/02/99	---	---	---	---	---	---	---	---	---	22
	12/14/99	---	---	---	---	---	---	---	---	---	23
	01/11/00	---	---	---	---	---	---	---	---	---	18
	03/07/00	810	470	75	16	59	2	70	94	200	11
	04/11/00	---	---	---	---	---	---	---	---	---	23
	05/03/00	---	---	---	---	---	---	---	---	---	24
	06/21/00	---	---	---	---	---	---	---	---	---	23
	09/13/00	---	---	---	---	---	---	---	---	---	23
	10/06/00	---	---	---	---	---	---	---	---	---	21

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-4

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS SAMPLED BY RANCHO CALIFORNIA WATER DISTRICT

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l								
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3	
No. 113 7S/2W-25H01 (Cont)	02/14/01	---	---	---	---	---	---	---	---	---	---	16
	05/30/01	---	---	---	---	---	---	---	---	---	---	23
	06/12/01	---	---	---	---	---	---	---	---	---	---	22
	08/01/01	---	---	---	---	---	---	---	---	---	---	22
	11/13/01	---	---	---	---	---	---	---	---	---	---	22
	05/01/02	---	---	---	---	---	---	---	---	---	---	19
	08/06/02	---	---	---	---	---	---	---	---	---	---	20
	11/05/02	---	---	---	---	---	---	---	---	---	---	21
	02/07/03	---	---	---	---	---	---	---	---	---	---	22
	03/05/03	1000	610	65	19	110	2.5	160	41	260	---	26
	08/05/03	---	---	---	---	---	---	---	---	---	---	21
	11/13/03	---	---	---	---	---	---	---	---	---	---	24
	02/10/04	---	---	---	---	---	---	---	---	---	---	24
	05/04/04	---	---	---	---	---	---	---	---	---	---	23
	08/10/04	---	---	---	---	---	---	---	---	---	---	24
	11/17/04	---	---	---	---	---	---	---	---	---	---	25
	02/09/05	---	---	---	---	---	---	---	---	---	---	25
	05/12/05	---	---	---	---	---	---	---	---	---	---	23
	11/02/05	---	---	---	---	---	---	---	---	---	---	25
	02/14/06	---	---	---	---	---	---	---	---	---	---	24
	03/08/06	880	540	54	15	100	2.3	140	31	210	---	24
	05/11/06	---	---	---	---	---	---	---	---	---	---	24
	08/03/06	---	---	---	---	---	---	---	---	---	---	21
	11/08/06	---	---	---	---	---	---	---	---	---	---	23
	02/07/07	---	---	---	---	---	---	---	---	---	---	24
	05/01/07	---	---	---	---	---	---	---	---	---	---	23
	08/07/07	---	---	---	---	---	---	---	---	---	---	23
	02/12/08	---	---	---	---	---	---	---	---	---	---	22
	05/06/08	---	540	---	---	---	---	---	---	---	---	21
	08/11/08	---	530	---	---	---	---	---	---	---	---	21
	11/06/08	---	570	---	---	---	---	---	---	---	---	24
	02/05/09	---	530	---	---	---	---	---	---	---	---	21
	03/03/09	930	520	56	15	97	2.1	150	41	210	---	22
	05/11/09	---	---	---	---	---	---	---	---	---	---	19
	08/04/09	---	520	---	---	---	---	---	---	---	---	20
	02/02/10	---	510	---	---	---	---	---	---	---	---	22
	05/07/10	---	600	---	---	---	---	---	---	---	---	22
	08/10/10	---	540	---	---	---	---	---	---	---	---	22
	11/03/10	---	520	---	---	---	---	---	---	---	---	21
	02/15/11	---	550	---	---	---	---	---	---	---	---	20
	05/04/11	---	550	---	---	---	---	---	---	---	---	20
	08/03/11	---	540	---	---	---	---	---	---	---	---	20
	11/02/11	---	540	---	---	---	---	---	---	---	---	21
	02/02/12	---	580	---	---	---	---	---	---	---	---	21
	05/03/12	---	570	---	---	---	---	---	---	---	---	20
	08/09/12	---	---	---	---	---	---	---	---	---	---	20

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-4

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS SAMPLED BY RANCHO CALIFORNIA WATER DISTRICT

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
No. 118 8S/3W-11B	08/08/90	715	480	14	1	162	1	120	79	101	1
	09/26/90	---	---	---	---	---	---	---	---	---	1
	09/10/93	860	525	19	1	178	1	130	94	198	<1
	06/20/95	---	---	---	---	---	---	---	---	---	<1
	09/16/96	970	560	33	2	180	2	120	120	230	<2
	07/23/97	---	---	---	---	---	---	---	---	---	0.2 as N
	09/16/98	---	---	---	---	---	---	---	---	---	2
	11/02/99	1040	580	46	4	170	2	130	100	240	<2
	09/20/00	---	---	---	---	---	---	---	---	---	<2
	08/18/02	---	---	---	---	---	---	---	---	---	<2
	11/08/02	1100	590	46	4.5	160	1.3	140	94	240	<2
	09/23/03	---	---	---	---	---	---	---	---	---	<2
	12/30/04	---	---	---	---	---	---	---	---	---	<2
	01/25/05	---	---	---	---	---	---	---	---	---	<2
	09/07/05	---	---	---	---	---	---	---	---	---	<1
	11/03/05	980	590	55	5	150	1.7	140	110	240	<1
	09/05/07	---	---	---	---	---	---	---	---	---	1.1
	09/08/08	---	670	---	---	---	---	---	---	---	<2
	11/06/08	1100	640	71	150	150	1.9	150	140	250	ND
	12/05/08	---	660	---	---	---	---	---	---	---	---
	03/03/09	---	620	---	---	---	---	---	---	---	---
	06/04/09	---	610	---	---	---	---	---	---	---	---
	03/03/10	---	640	---	---	---	---	---	---	---	---
	06/02/10	---	630	---	---	---	---	---	---	---	---
	09/02/10	---	640	---	---	---	---	---	---	---	2.2
	12/08/10	---	640	---	---	---	---	---	---	---	---
	03/02/11	---	650	---	---	---	---	---	---	---	---
	06/08/11	---	640	---	---	---	---	---	---	---	---
	09/02/11	---	620	---	---	---	---	---	---	---	2
	12/06/11	---	610	---	---	---	---	---	---	---	---
	06/12/12	---	640	---	---	---	---	---	---	---	---
No. 119 8S/2W-19J	07/16/96	450	280	44	9	35	<1	39	18	180	15
	08/14/97	---	---	---	---	---	---	---	---	---	12
	12/24/97	---	320	---	---	---	---	---	---	---	3.1 as N
	03/04/98	---	380	---	---	---	---	---	---	---	3.3 as N
	06/04/98	---	---	---	---	---	---	---	---	---	3.8 as N
	06/12/98	---	400	---	---	---	---	---	---	---	---
	09/16/98	---	---	---	---	---	---	---	---	---	3.7 as N
	01/08/99	---	430	---	---	---	---	---	---	---	---
	04/13/99	---	---	---	---	---	---	---	---	---	28
	06/02/99	---	560	---	---	---	---	---	---	---	4.8 as N
	07/27/99	940	640	103	21	58	1	70	150	264	30
	09/14/99	---	---	---	---	---	---	---	---	---	22

ND - None Detected

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-4

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS SAMPLED BY RANCHO CALIFORNIA WATER DISTRICT

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
No. 119 8S/2W-19J (Cont)	09/14/99	---	---	---	---	---	---	---	---	---	4.8 as N
	10/26/99	---	---	---	---	---	---	---	---	---	24
	11/02/99	---	---	---	---	---	---	---	---	---	22
	12/14/99	---	560	---	---	---	---	---	---	---	22
	04/04/00	---	---	---	---	---	---	---	---	---	20
	12/14/00	---	---	---	---	---	---	---	---	---	4.6 as N
	03/29/01	---	---	---	---	---	---	---	---	---	20
	06/20/01	---	---	---	---	---	---	---	---	---	4.2 as N
	09/14/01	---	---	---	---	---	---	---	---	---	4.2 as N
	09/28/01	---	---	---	---	---	---	---	---	---	18
	11/16/01	---	---	---	---	---	---	---	---	---	16
	05/23/02	---	480	---	---	---	---	---	---	---	18
	07/24/02	770	490	81	15	49	1.1	51	90	240	19
	11/08/02	---	---	---	---	---	---	---	---	---	15
	02/19/03	---	---	---	---	---	---	---	---	---	17
	02/10/04	---	---	---	---	---	---	---	---	---	15
	02/28/05	---	---	---	---	---	---	---	---	---	10
	07/06/05	820	600	95	20	63	1.4	64	140	260	13
	02/07/06	---	---	---	---	---	---	---	---	---	15
	02/07/07	---	---	---	---	---	---	---	---	---	15
	02/12/08	---	---	---	---	---	---	---	---	---	15
	05/14/08	---	520	---	---	---	---	---	---	---	13
	07/08/08	810	520	88	17	57	1.4	66	120	250	14
	08/11/08	---	480	---	---	---	---	---	---	---	13
	11/17/08	---	520	---	---	---	---	---	---	---	16
	02/05/09	---	460	---	---	---	---	---	---	---	13
	05/11/09	---	560	---	---	---	---	---	---	---	12
	08/04/09	---	540	---	---	---	---	---	---	---	14
	01/12/10	---	580	---	---	---	---	---	---	---	15
	04/09/10	---	560	---	---	---	---	---	---	---	13
	07/01/10	---	620	---	---	---	---	---	---	---	14
	10/07/10	---	610	---	---	---	---	---	---	---	14
	01/12/11	---	480	---	---	---	---	---	---	---	13
	04/12/11	---	560	---	---	---	---	---	---	---	12
	07/07/11	840	560	85	18	60	1.9	84	120	250	16
	10/13/11	---	610	---	---	---	---	---	---	---	15
	01/10/12	---	520	---	---	---	---	---	---	---	14
	04/03/12	---	550	---	---	---	---	---	---	---	---
No. 120 8S/2W-17G	06/20/90	570	330	6	1	116	1	82	31	113	11
	06/10/93	590	340	6	<1	122	1	85	35	104	12
	07/19/96	630	360	6	<1	120	1	88	42	120	14
	06/16/97	---	---	---	---	---	---	---	---	---	10
	08/14/97	---	---	---	---	---	---	---	---	---	9
	06/02/99	620	360	6	<1	122	<1	84	45	120	10

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-4

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS SAMPLED BY RANCHO CALIFORNIA WATER DISTRICT

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
No. 120 8S/2W-17G (Cont)	06/06/00	---	---	---	---	---	---	---	---	---	11
	06/13/01	---	---	---	---	---	---	---	---	---	12
	06/01/02	670	370	8.1	<1	130	1	86	46	130	11
	06/11/03	---	---	---	---	---	---	---	---	---	12
	06/22/04	---	---	---	---	---	---	---	---	---	15
	06/15/05	720	410	11	<1	140	1.3	90	62	140	12
	06/07/06	---	---	---	---	---	---	---	---	---	11
	06/01/07	---	---	---	---	---	---	---	---	---	10
	06/05/08	690	400	11	<1	140	104	89	66	140	10
	06/05/08	---	400	---	---	---	---	---	---	---	10
	09/15/08	---	350	---	---	---	---	---	---	---	---
	08/21/09	---	500	---	---	---	---	---	---	---	11
	02/02/10	---	440	---	---	---	---	---	---	---	---
	05/05/10	---	440	---	---	---	---	---	---	---	---
	08/09/10	---	430	---	---	---	---	---	---	---	11
	11/03/10	---	400	---	---	---	---	---	---	---	---
	02/02/11	---	440	---	---	---	---	---	---	---	---
	05/04/11	---	450	---	---	---	---	---	---	---	---
	08/02/11	---	420	---	---	---	---	---	---	---	10
	11/03/11	---	380	---	---	---	---	---	---	---	---
No. 121 7S/3W-34J	02/07/12	---	430	---	---	---	---	---	---	---	---
	05/03/12	---	410	---	---	---	---	---	---	---	---
	08/09/12	---	400	---	---	---	---	---	---	---	10
	10/27/89	900	475	63	14	99	2	109	28	290	<1
	05/19/92	1000	560	72	17	120	3	170	56	270	<1
	07/18/97	---	---	---	---	---	---	---	---	---	ND
	07/24/97	---	640	---	---	---	---	---	---	---	ND
No. 122 8S/2W-20P1	08/20/97	---	---	---	---	---	---	---	---	---	ND
	09/03/97	---	---	---	---	---	---	---	---	---	ND
	06/19/02	---	---	---	---	---	---	---	---	---	ND
	06/23/97	---	---	---	---	---	---	---	---	---	6
	07/25/97	660	460	64	13	44	1	61	65	190	8
	10/10/97	---	---	---	---	---	---	---	---	---	9
	12/23/97	---	400	---	---	---	---	---	---	---	1.8 as N
	03/25/98	---	450	---	---	---	---	---	---	---	2.2 as N
	06/03/98	---	---	---	---	---	---	---	---	---	2.4 as N
	06/05/98	---	460	---	---	---	---	---	---	---	---
	09/17/98	---	---	---	---	---	---	---	---	---	2.2 as N
	01/08/99	---	450	---	---	---	---	---	---	---	---
	06/03/99	---	470	---	---	---	---	---	---	---	2.1 as N
	04/13/99	---	---	---	---	---	---	---	---	---	9
	09/21/99	---	---	---	---	---	---	---	---	---	2.1 as N
	03/07/00	---	---	---	---	---	---	---	---	---	16
	04/04/00	---	---	---	---	---	---	---	---	---	9

ND - None Detected

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-4

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS SAMPLED BY RANCHO CALIFORNIA WATER DISTRICT

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
No. 122 8S/2W-20P1 (Cont)	06/28/00	780	470	79	16	62	1	73	100	210	11
	12/13/00	---	---	---	---	---	---	---	---	---	2.5 as N
	03/27/01	---	---	---	---	---	---	---	---	---	2.5 as N
	04/18/01	---	---	---	---	---	---	---	---	---	10
	06/20/01	---	---	---	---	---	---	---	---	---	2.4 as N
	09/13/01	---	---	---	---	---	---	---	---	---	2.7 as N
	12/13/01	---	550	---	---	---	---	---	---	---	---
	05/14/02	---	570	---	---	---	---	---	---	---	9
	03/05/03	---	---	---	---	---	---	---	---	---	10
	03/16/04	---	---	---	---	---	---	---	---	---	12
	03/17/05	---	---	---	---	---	---	---	---	---	9
	03/21/06	---	---	---	---	---	---	---	---	---	9.4
	03/06/07	---	---	---	---	---	---	---	---	---	9.7
	03/03/08	---	---	---	---	---	---	---	---	---	8.5
	03/07/08	---	620	---	---	---	---	---	---	---	---
	10/08/08	---	620	---	---	---	---	---	---	---	---
	01/20/09	---	680	---	---	---	---	---	---	---	---
	03/10/09	---	---	---	---	---	---	---	---	---	8.9
	04/16/09	---	660	---	---	---	---	---	---	---	---
	07/14/09	---	670	---	---	---	---	---	---	---	---
	03/15/10	---	640	---	---	---	---	---	---	---	10
	03/10/11	---	---	---	---	---	---	---	---	---	9.6
	05/25/11	---	670	---	---	---	---	---	---	---	---
	08/04/11	---	680	---	---	---	---	---	---	---	---
	01/10/12	---	680	---	---	---	---	---	---	---	---
	03/06/12	---	---	---	---	---	---	---	---	---	9.1
	04/03/12	---	730	---	---	---	---	---	---	---	---
	08/07/12	1100	710	110	20	87	1.9	84	190	260	8.0
No. 123 8S/1W-7B	06/06/90	1100	690	69	27	132	6	130	170	281	4
	06/10/93	1120	690	74	25	136	6	120	190	250	5
	02/05/97	930	550	55	18	110	5	83	130	250	1.3
	04/27/99	---	---	---	---	---	---	---	---	---	3
	06/02/99	---	---	---	---	---	---	---	---	---	3
	07/20/99	---	---	---	---	---	---	---	---	---	2
	08/11/99	---	---	---	---	---	---	---	---	---	2
	09/14/99	---	---	---	---	---	---	---	---	---	2
	10/21/99	---	---	---	---	---	---	---	---	---	2
	11/02/99	---	---	---	---	---	---	---	---	---	2
	02/09/00	1150	610	59	20	100	5	83	150	240	3
	02/09/01	---	---	---	---	---	---	---	---	---	3
	03/10/03	880	550	59	20	87	4.5	80	180	170	<2
	02/03/04	---	---	---	---	---	---	---	---	---	2
	02/14/05	---	---	---	---	---	---	---	---	---	2
	02/14/06	---	---	---	---	---	---	---	---	---	3.6
	03/14/06	890	530	65	22	88	5	91	180	180	2.3
	04/24/07	---	---	---	---	---	---	---	---	---	1.4

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-4

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS SAMPLED BY RANCHO CALIFORNIA WATER DISTRICT

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
No. 123 8S/1W-7B (Cont)	05/01/07	---	---	---	---	---	---	---	---	---	2.7
	06/05/07	---	---	---	---	---	---	---	---	---	2.2
	07/05/07	---	---	---	---	---	---	---	---	---	2.5
	08/07/07	---	---	---	---	---	---	---	---	---	2.2
	09/05/07	---	---	---	---	---	---	---	---	---	2.1
	09/06/07	---	---	---	---	---	---	---	---	---	2
	10/03/07	---	---	---	---	---	---	---	---	---	2
	12/13/07	---	---	---	---	---	---	---	---	---	1.9
	01/10/08	---	---	---	---	---	---	---	---	---	1.4
	02/13/08	---	---	---	---	---	---	---	---	---	1.1
	03/03/08	---	---	---	---	---	---	---	---	---	1.3
	03/07/08	---	540	---	---	---	---	---	---	---	---
	04/08/08	---	---	---	---	---	---	---	---	---	2.2
	05/12/08	---	---	---	---	---	---	---	---	---	2.4
	06/23/08	---	---	---	---	---	---	---	---	---	2.7
	07/08/08	---	---	---	---	---	---	---	---	---	2.9
	08/12/08	---	---	---	---	---	---	---	---	---	2.6
	09/15/08	---	---	---	---	---	---	---	---	---	2.7
	11/06/08	---	---	---	---	---	---	---	---	---	2.6
	12/05/08	---	---	---	---	---	---	---	---	---	2
	01/07/09	---	640	---	---	---	---	---	---	---	ND
	02/04/09	---	---	---	---	---	---	---	---	---	1.6
	03/09/09	980	610	62	21	97	5	98	180	110	<2.0
	04/02/09	---	600	---	---	---	---	---	---	---	<2.0
	05/07/09	---	---	---	---	---	---	---	---	---	<2.0
	06/01/09	---	---	---	---	---	---	---	---	---	<2.0
	07/09/09	---	590	---	---	---	---	---	---	---	<2.0
	08/05/09	---	---	---	---	---	---	---	---	---	<2.0
	01/06/10	---	590	---	---	---	---	---	---	---	1.4
	02/02/10	---	---	---	---	---	---	---	---	---	1.1
	03/03/10	---	---	---	---	---	---	---	---	---	1.2
	04/08/10	---	600	---	---	---	---	---	---	---	1.2
	05/06/10	---	---	---	---	---	---	---	---	---	1.5
	06/02/10	---	---	---	---	---	---	---	---	---	<2
	07/01/10	---	750	---	---	---	---	---	---	---	<2
	08/10/10	---	---	---	---	---	---	---	---	---	2.4
	09/01/10	---	---	---	---	---	---	---	---	---	2.1
	10/07/10	---	630	---	---	---	---	---	---	---	<2
	11/01/10	---	---	---	---	---	---	---	---	---	<2
	12/02/10	---	---	---	---	---	---	---	---	---	<2
	01/12/11	---	570	---	---	---	---	---	---	---	2
	02/15/11	---	---	---	---	---	---	---	---	---	2
	03/09/11	---	---	---	---	---	---	---	---	---	2
	04/05/11	---	580	---	---	---	---	---	---	---	2

ND - None Detected

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-4

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS SAMPLED BY RANCHO CALIFORNIA WATER DISTRICT

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
No. 123 8S/1W-7B (Cont)	05/05/11	---	---	---	---	---	---	---	---	---	2
	06/07/11	---	---	---	---	---	---	---	---	---	2
	07/06/11	---	600	---	---	---	---	---	---	---	2
	08/03/11	---	---	---	---	---	---	---	---	---	2
	09/02/11	---	---	---	---	---	---	---	---	---	2.3
	10/13/11	---	550	---	---	---	---	---	---	---	2.2
	11/10/11	---	---	---	---	---	---	---	---	---	<2
	12/07/11	---	---	---	---	---	---	---	---	---	<2
	01/06/12	---	540	---	---	---	---	---	---	---	<2.0
	09/05/12	---	---	---	---	---	---	---	---	---	1.4
No. 124 8S/2W-11R1	06/20/90	660	380	38	4	92	3	97	48	153	13
	07/22/93	690	430	42	5	89	3	90	57	159	17
	07/18/95	---	---	---	---	---	---	---	---	---	11
	10/26/99	700	420	45	4	94	3	97	61	160	16
	07/06/00	---	---	---	---	---	---	---	---	---	17
	07/10/01	---	---	---	---	---	---	---	---	---	16
	07/03/02	---	---	---	---	---	---	---	---	---	10
	10/02/02	600	330	24	2.4	92	1.9	75	38	150	10
	01/08/03	---	---	---	---	---	---	---	---	---	2.3 as N
	07/01/03	---	---	---	---	---	---	---	---	---	8.3
	07/07/04	---	---	---	---	---	---	---	---	---	9.4
	07/06/05	---	---	---	---	---	---	---	---	---	8.4
	10/05/05	580	360	19	2.4	96	1.6	74	35	140	7.8
	09/26/06	---	---	---	---	---	---	---	---	---	17
	09/05/07	---	---	---	---	---	---	---	---	---	8.2
	10/28/08	780	490	52	6.5	84	3.1	91	84	150	1.8
	01/13/09	---	390	---	---	---	---	---	---	---	---
	04/07/09	---	330	---	---	---	---	---	---	---	---
	07/09/09	---	320	---	---	---	---	---	---	---	---
	01/06/10	---	390	---	---	---	---	---	---	---	---
	04/08/10	---	360	---	---	---	---	---	---	---	---
	07/01/10	---	390	---	---	---	---	---	---	---	---
	10/06/10	---	320	---	---	---	---	---	---	---	10
	01/04/11	---	390	---	---	---	---	---	---	---	---
	04/05/11	---	390	---	---	---	---	---	---	---	---
	07/06/11	---	350	---	---	---	---	---	---	---	---
	10/12/11	610	390	23	2.5	95	2.2	80	44	150	9.8
	10/12/11	---	320	---	---	---	---	---	---	---	10
	01/10/12	---	330	---	---	---	---	---	---	---	---
	04/04/12	---	410	---	---	---	---	---	---	---	---
No. 125 8S/2W-12H	06/20/90	740	425	17	5	132	3	99	54	186	4
	06/10/93	770	450	18	5	140	3	150	60	131	3
	06/20/95	---	---	---	---	---	---	---	---	---	2
	06/09/97	---	---	---	---	---	---	---	---	---	2
	09/17/98	---	---	---	---	---	---	---	---	---	3

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-4

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS SAMPLED BY RANCHO CALIFORNIA WATER DISTRICT

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
No. 125 8S/2W-12H (Cont)	06/03/99	720	440	10	3	135	2	89	76	170	<2
	11/02/99	---	---	---	---	---	---	---	---	---	3
	11/15/00	---	---	---	---	---	---	---	---	---	2
	07/24/01	---	---	---	---	---	---	---	---	---	4
	06/19/02	700	400	8.8	2.3	130	1.8	87	54	170	<2
	07/03/02	---	---	---	---	---	---	---	---	---	2
	01/13/03	---	---	---	---	---	---	---	---	---	.38 as N
	07/01/03	---	---	---	---	---	---	---	---	---	<2
	06/09/04	---	---	---	---	---	---	---	---	---	<2
	06/14/05	650	350	8.3	2.1	130	1.6	82	52	180	1.8
	06/13/06	---	---	---	---	---	---	---	---	---	2.8
	06/05/07	---	---	---	---	---	---	---	---	---	1.6
	06/10/08	770	460	17	4.6	150	2.4	93	64	190	2.7
	09/15/08	---	370	---	---	---	---	---	---	---	---
	12/05/08	---	450	---	---	---	---	---	---	---	---
	03/04/09	---	440	---	---	---	---	---	---	---	---
	06/01/09	---	560	---	---	---	---	---	---	---	<2.0
	07/27/10	---	480	---	---	---	---	---	---	---	3.7
	10/06/10	---	430	---	---	---	---	---	---	---	---
	01/14/11	---	420	---	---	---	---	---	---	---	---
	04/05/11	---	390	---	---	---	---	---	---	---	---
No. 126 8S/2W-15H	05/04/88	480	290	4	<1	106	<1	53	14	64	<1
	07/06/89	500	270	2	1	108	<1	55	11	98	<1
	07/18/95	540	315	1	<1	122	<1	72	11	122	<1
	07/07/97	---	---	---	---	---	---	---	---	---	<2
	07/16/97	---	---	---	---	---	---	---	---	---	0.2 as N
	07/23/97	---	---	---	---	---	---	---	---	---	0.2 as N
	08/20/97	---	---	---	---	---	---	---	---	---	0.4 as N
	09/03/97	---	---	---	---	---	---	---	---	---	0.2 as N
	09/17/97	---	---	---	---	---	---	---	---	---	0.2 as N
	07/20/98	520	330	2	<1	120	<1	56	11	130	<2
	09/16/98	---	300	---	---	---	---	---	---	---	0.4 as N
	04/14/99	---	---	---	---	---	---	---	---	---	2
	04/11/00	---	---	---	---	---	---	---	---	---	<2
	04/11/01	---	---	---	---	---	---	---	---	---	2
	07/12/01	530	300	2	<1	100	<1	53	12	140	<2
	06/20/02	---	---	---	---	---	---	---	---	---	<2
	08/06/02	---	---	---	---	---	---	---	---	---	<2
	01/08/03	---	---	---	---	---	---	---	---	---	0.25 as N
	11/04/03	---	---	---	---	---	---	---	---	---	<2
	07/22/04	520	310	1.5	ND	110	ND	59	10	120	0.27 as N
	11/03/04	---	---	---	---	---	---	---	---	---	<2
	11/02/05	---	---	---	---	---	---	---	---	---	<1
	11/08/06	---	---	---	---	---	---	---	---	---	<1
	07/03/07	530	330	1.4	<1	110	<1	62	10	140	<2
	11/14/07	---	---	---	---	---	---	---	---	---	1.9
	08/07/08	---	280	---	---	---	---	---	---	---	---

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-4

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS SAMPLED BY RANCHO CALIFORNIA WATER DISTRICT

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
No. 126 8S/2W-15H (Cont)	02/04/09	---	280	---	---	---	---	---	---	---	---
	05/06/09	---	280	---	---	---	---	---	---	---	---
	08/04/09	---	270	---	---	---	---	---	---	---	---
	02/03/10	---	290	---	---	---	---	---	---	---	---
	05/06/10	---	390	---	---	---	---	---	---	---	---
	07/13/10	530	300	1.6	<1	110	<1	58	11	130	<2
	08/24/10	---	330	---	---	---	---	---	---	---	---
	11/03/10	---	300	---	---	---	---	---	---	---	1.5
	02/04/11	---	280	---	---	---	---	---	---	---	---
	05/03/11	---	300	---	---	---	---	---	---	---	---
	08/02/11	---	280	---	---	---	---	---	---	---	---
	11/01/11	---	270	---	---	---	---	---	---	---	<2
	02/06/12	---	350	---	---	---	---	---	---	---	---
	05/02/12	---	330	---	---	---	---	---	---	---	---
	08/06/12	---	290	---	---	---	---	---	---	---	---
No. 128 7/3W-36M	07/06/89	400	230	27	3	54	2	59	7	101	25
	07/08/92	390	230	21	2	59	2	55	1	110	24
	07/20/95	380	275	16	2	66	1	65	10	101	19
	07/07/97	---	---	---	---	---	---	---	---	---	15
	07/20/98	370	260	12	<1	71	1	48	11	110	14
	06/02/99	---	---	---	---	---	---	---	---	---	13
	06/08/01	---	---	---	---	---	---	---	---	---	14
	07/10/01	400	230	10	<1	68	<1	44	12	100	12
	06/20/02	---	---	---	---	---	---	---	---	---	12
	01/08/03	---	---	---	---	---	---	---	---	---	12
	01/14/04	---	---	---	---	---	---	---	---	---	10
	07/14/04	390	240	8.3	1	67	1	48	11	92	13
	01/11/05	---	---	---	---	---	---	---	---	---	6
	01/10/06	---	---	---	---	---	---	---	---	---	7.9
No. 129 7S/2W-20L	11/29/89	430	260	16	3	66	2	71	16	92	9
	08/08/90	440	280	20	5	64	2	72	14	119	10
	04/01/92	---	---	---	---	---	---	---	---	---	12
	09/10/93	470	275	24	6	60	2	74	16	110	13
	08/09/96	460	270	19	3	67	2	70	15	100	11
	02/04/97	---	---	---	---	---	---	---	---	---	53
	12/20/00	550	330	44	13	47	2	81	14	130	20
	03/22/01	---	---	---	---	---	---	---	---	---	20
	04/17/01	---	---	---	---	---	---	---	---	---	20
	05/02/01	---	---	---	---	---	---	---	---	---	18
	06/08/01	---	---	---	---	---	---	---	---	---	20
	10/16/01	---	---	---	---	---	---	---	---	---	19
	11/13/01	---	---	---	---	---	---	---	---	---	18
	02/26/02	---	---	---	---	---	---	---	---	---	16
	05/23/02	---	---	---	---	---	---	---	---	---	14
	09/18/02	---	---	---	---	---	---	---	---	---	15

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-4

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS SAMPLED BY RANCHO CALIFORNIA WATER DISTRICT

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
No. 130 8S/2W-11R	02/17/88	650	365	16	1	132	1	69	64	0	4
	02/14/91	640	365	4	<1	132	1	68	56	122	---
	04/24/91	---	---	---	---	---	---	---	---	---	3
	02/09/94	650	410	3	<1	148	1	81	72	146	4
	05/16/95	---	---	---	---	---	---	---	---	---	4
	02/05/97	780	450	4	<1	170	<1	78	82	150	5
	05/14/97	---	---	---	---	---	---	---	---	---	4
	04/14/99	---	---	---	---	---	---	---	---	---	5
	02/10/00	750	440	4	<1	170	<1	76	77	170	5
	04/12/00	---	---	---	---	---	---	---	---	---	5
	05/25/00	---	---	---	---	---	---	---	---	---	6
	05/24/01	---	---	---	---	---	---	---	---	---	6
	05/24/02	---	---	---	---	---	---	---	---	---	5
	02/19/03	820	460	4.1	<1	170	<1	87	96	180	5
	05/04/04	---	---	---	---	---	---	---	---	---	5.1
	05/12/05	---	---	---	---	---	---	---	---	---	5
	02/14/06	800	450	4.1	<1	170	<1	83	91	200	5.1
	05/12/06	---	---	---	---	---	---	---	---	---	4.5
	05/01/07	---	---	---	---	---	---	---	---	---	4.5
	05/07/08	---	440	---	---	---	---	---	---	---	4.1
	08/12/08	---	470	---	---	---	---	---	---	---	---
	11/09/08	---	560	---	---	---	---	---	---	---	---
	02/11/09	840	440	4.6	<1	170	<1	91	110	150	4.8
	05/11/09	---	480	---	---	---	---	---	---	---	3.5
	08/31/09	---	470	---	---	---	---	---	---	---	---
	02/04/10	---	480	---	---	---	---	---	---	---	---
	05/06/10	---	410	---	---	---	---	---	---	---	4.5
	08/11/10	---	460	---	---	---	---	---	---	---	---
	11/01/10	---	480	---	---	---	---	---	---	---	---
	12/02/10	---	400	---	---	---	---	---	---	---	---
	07/15/11	---	480	---	---	---	---	---	---	---	---
	08/04/11	---	---	---	---	---	---	---	---	---	4.7
	10/13/11	---	490	---	---	---	---	---	---	---	---
	01/10/12	---	460	---	---	---	---	---	---	---	---
	02/09/12	810	480	4.4	<1.0	160	1.2	80	100	180	4.0
	08/08/12	---	---	---	---	---	---	---	---	---	4.2
No. 131 8S/1W-12J	03/10/88	530	270	4	<1	108	1	57	52	31	1
	03/21/91	630	335	7	<1	120	1	74	65	98	3
	03/03/94	660	345	9	<1	124	2	86	73	119	2
	03/30/95	---	---	---	---	---	---	---	---	---	2
	03/20/97	660	370	6	<1	125	1	81	73	100	2
	07/07/97	---	---	---	---	---	---	---	---	---	<2
	07/27/98	---	---	---	---	---	---	---	---	---	2
	06/03/99	---	---	---	---	---	---	---	---	---	<2
	03/07/00	720	380	9	<1	140	2	81	80	130	3
	06/21/00	---	---	---	---	---	---	---	---	---	2

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-4

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS SAMPLED BY RANCHO CALIFORNIA WATER DISTRICT

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
No. 131 8S/1W-12J (Cont)	06/27/01	---	---	---	---	---	---	---	---	---	2
	06/05/02	---	---	---	---	---	---	---	---	---	<2
	03/13/03	700	390	8	<1	130	1.4	88	88	130	3
	06/11/03	---	---	---	---	---	---	---	---	---	<2
	06/09/04	---	---	---	---	---	---	---	---	---	<2
	06/15/05	---	---	---	---	---	---	---	---	---	2
	03/07/06	710	420	9	<1	140	1.5	93	93	130	3
	06/07/06	---	---	---	---	---	---	---	---	---	1.7
	06/26/07	---	---	---	---	---	---	---	---	---	2.4
	06/04/08	---	390	---	---	---	---	---	---	---	1.5
	09/15/08	---	330	---	---	---	---	---	---	---	---
	12/03/08	---	430	---	---	---	---	---	---	---	---
	03/04/09	640	370	6	<1	130	1.2	71	77	130	<2.0
	03/04/09	---	380	---	---	---	---	---	---	---	---
	06/02/09	---	360	---	---	---	---	---	---	---	<2.0
	03/03/10	---	380	---	---	---	---	---	---	---	---
	06/02/10	---	360	---	---	---	---	---	---	---	2
	09/01/10	---	360	---	---	---	---	---	---	---	---
	03/02/11	---	430	---	---	---	---	---	---	---	---
	06/07/11	---	360	---	---	---	---	---	---	---	2
	09/02/11	---	330	---	---	---	---	---	---	---	---
	12/07/11	---	420	---	---	---	---	---	---	---	---
	03/02/12	---	410	---	---	---	---	---	---	---	---
	06/05/12	---	350	---	---	---	---	---	---	---	1.5
	09/05/12	---	370	---	---	---	---	---	---	---	---
No. 132 8S/1W-07D	04/18/88	1000	620	94	13	103	6	109	153	235	2
	05/08/91	920	590	64	19	110	5	100	160	201	<1
	05/13/94	730	460	50	15	78	5	73	110	195	1
	05/16/95	---	---	---	---	---	---	---	---	---	<1
	07/18/95	860	520	59	17	100	4	90	130	223	1
	07/20/98	900	590	69	20	110	5	89	150	230	2
	01/06/99	---	---	---	---	---	---	---	---	---	2
	02/03/99	---	---	---	---	---	---	---	---	---	2
	04/14/99	---	---	---	---	---	---	---	---	---	3
	06/03/99	---	---	---	---	---	---	---	---	---	3
	07/27/99	---	---	---	---	---	---	---	---	---	5
	08/11/99	---	---	---	---	---	---	---	---	---	4
	09/15/99	---	---	---	---	---	---	---	---	---	4
	10/21/99	---	---	---	---	---	---	---	---	---	4
	11/02/99	---	---	---	---	---	---	---	---	---	3
	12/15/99	---	---	---	---	---	---	---	---	---	3
	05/03/00	---	---	---	---	---	---	---	---	---	2
	05/16/01	800	500	57	17	74	5	63	180	150	3
	05/01/02	---	---	---	---	---	---	---	---	---	2
	05/03/05	---	---	---	---	---	---	---	---	---	<2
	05/12/06	---	---	---	---	---	---	---	---	---	3.2

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-4

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS SAMPLED BY RANCHO CALIFORNIA WATER DISTRICT

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
No. 132 8S/1W-07D (Cont)	05/01/07	---	---	---	---	---	---	---	---	---	4.7
	05/03/07	820	500	53	16	64	4.4	72	150	160	3.2
	05/06/08	---	670	---	---	---	---	---	---	---	3.6
	08/12/08	---	690	---	---	---	---	---	---	---	---
	11/06/08	---	650	---	---	---	---	---	---	---	---
	02/05/09	---	570	---	---	---	---	---	---	---	---
	05/11/09	---	590	---	---	---	---	---	---	---	<2.0
	08/05/09	---	600	---	---	---	---	---	---	---	---
	02/03/10	---	580	---	---	---	---	---	---	---	---
	05/06/10	960	600	67	22	88	5.6	96	220	170	1.2
	08/10/10	---	570	---	---	---	---	---	---	---	---
	11/01/10	---	610	---	---	---	---	---	---	---	---
	02/15/11	---	580	---	---	---	---	---	---	---	---
	05/04/11	---	590	---	---	---	---	---	---	---	2
	08/03/11	---	580	---	---	---	---	---	---	---	---
	11/02/11	---	510	---	---	---	---	---	---	---	---
	02/08/12	---	450	---	---	---	---	---	---	---	---
	05/02/12	---	420	---	---	---	---	---	---	---	3.3
	08/08/12	---	360	---	---	---	---	---	---	---	---
No. 133 8S/1W-7C	03/28/90	970	605	50	20	112	5	120	131	235	3
	03/11/93	970	580	48	19	120	4	110	140	204	3
	06/06/95	---	---	---	---	---	---	---	---	---	2
	07/18/95	850	680	26	10	142	2	120	100	174	2
	06/23/97	---	---	---	---	---	---	---	---	---	3
	07/20/98	790	500	24	9	140	2	96	93	170	2
	08/02/00	---	---	---	---	---	---	---	---	---	3
	03/28/01	800	460	22	10	130	2	98	100	170	<2
	08/02/01	---	---	---	---	---	---	---	---	---	<2
	09/18/02	---	---	---	---	---	---	---	---	---	2
	09/16/03	---	---	---	---	---	---	---	---	---	2
	03/12/04	810	500	25	10	130	2.4	95	99	180	2
	03/07/07	820	500	26	9.7	140	2.4	94	98	160	2.3
	03/03/08	---	---	---	---	---	---	---	---	---	2.1
	03/07/08	---	480	---	---	---	---	---	---	---	---
	07/08/08	---	470	---	---	---	---	---	---	---	---
	01/07/09	---	540	---	---	---	---	---	---	---	---
	03/04/09	---	---	---	---	---	---	---	---	---	2.6
	04/02/09	---	460	---	---	---	---	---	---	---	---
	07/09/09	---	450	---	---	---	---	---	---	---	---
	01/06/10	---	490	---	---	---	---	---	---	---	---
	03/03/10	860	460	37	16	110	3.1	110	110	200	3
	04/08/10	---	490	---	---	---	---	---	---	---	---
	07/08/10	---	470	---	---	---	---	---	---	---	---
	10/06/10	---	460	---	---	---	---	---	---	---	---
	01/12/11	---	490	---	---	---	---	---	---	---	---
	03/09/11	---	---	---	---	---	---	---	---	---	2.9

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-4

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS SAMPLED BY RANCHO CALIFORNIA WATER DISTRICT

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
No. 133 8S/1W-7C (Cont)	04/05/11	---	460	---	---	---	---	---	---	---	---
	07/06/11	---	440	---	---	---	---	---	---	---	---
	10/13/11	---	470	---	---	---	---	---	---	---	---
No. 135 7S/3W-27M	05/24/89	2450	1390	122	65	300	2	410	225	464	33
	06/06/90	1540	945	73	36	215	1	250	150	323	13
	12/11/90	4400	2670	270	109	480	4	1030	380	314	<1
	08/06/92	1800	810	63	33	170	1	200	160	281	---
	01/16/97	---	---	---	---	---	---	---	---	---	3.7 as N
	02/04/97	---	---	---	---	---	---	---	---	---	3.5 as N
	02/12/97	---	---	---	---	---	---	---	---	---	4.0 as N
	02/20/97	---	---	---	---	---	---	---	---	---	3.4 as N
	02/25/97	---	---	---	---	---	---	---	---	---	3.4 as N
	03/04/97	---	---	---	---	---	---	---	---	---	3.7 as N
	03/18/97	---	---	---	---	---	---	---	---	---	3.3 as N
	03/25/97	---	---	---	---	---	---	---	---	---	3.5 as N
	04/08/97	---	---	---	---	---	---	---	---	---	3.4 as N
	04/15/97	---	---	---	---	---	---	---	---	---	3.4 as N
	04/22/97	---	---	---	---	---	---	---	---	---	3.5 as N
	05/06/97	1930	1050	97	48	220	2	340	190	360	3.3 as N
	05/14/97	---	---	---	---	---	---	---	---	---	3.4 as N
	05/21/97	---	---	---	---	---	---	---	---	---	3.3 as N
	06/04/97	---	---	---	---	---	---	---	---	---	3.3 as N
	06/11/97	---	---	---	---	---	---	---	---	---	3.3 as N
	06/18/97	---	---	---	---	---	---	---	---	---	3.3 as N
	06/25/97	---	---	---	---	---	---	---	---	---	3.3 as N
	07/02/97	---	---	---	---	---	---	---	---	---	3.3 as N
	09/17/97	1960	1260	---	---	---	---	430	220	---	13
No. 138 8S/2W-6F	10/30/90	460	240	19	2	74	2	71	13	113	18
	10/06/93	420	240	11	<1	70	1	56	10	92	14
	10/11/96	430	270	9	<1	78	1	55	8.9	100	15
	04/14/99	---	---	---	---	---	---	---	---	---	5
	06/03/99	---	---	---	---	---	---	---	---	---	3
	10/26/99	430	240	10	<1	76	1	60	11	100	19
	03/13/00	---	---	---	---	---	---	---	---	---	5
	03/22/01	---	---	---	---	---	---	---	---	---	17
	03/13/02	---	---	---	---	---	---	---	---	---	21
	06/20/02	---	---	---	---	---	---	---	---	---	16
	10/02/02	440	220	10	<1	75	1.2	58	7.8	96	17
	06/12/03	---	---	---	---	---	---	---	---	---	16
	12/30/04	---	---	---	---	---	---	---	---	---	5
	01/27/05	---	---	---	---	---	---	---	---	---	12
	10/18/05	430	280	11	<1	72	1.3	65	8.3	110	18
	01/06/06	---	---	---	---	---	---	---	---	---	17
	01/10/07	---	---	---	---	---	---	---	---	---	16
	01/08/08	---	---	---	---	---	---	---	---	---	16

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-4

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS SAMPLED BY RANCHO CALIFORNIA WATER DISTRICT

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
No. 138 8S/2W-6F (Cont)	10/08/08	430	220	12	59	82	1.1	59	11	32	18
	01/08/09	---	---	---	---	---	---	---	---	---	18
	01/12/09	---	280	---	---	---	---	---	---	---	---
	04/08/09	---	250	---	---	---	---	---	---	---	---
	07/06/09	---	240	---	---	---	---	---	---	---	---
	01/06/10	---	250	---	---	---	---	---	---	---	16
	04/08/10	---	270	---	---	---	---	---	---	---	---
	07/14/10	---	260	---	---	---	---	---	---	---	---
	10/05/10	---	230	---	---	---	---	---	---	---	---
	01/12/11	---	190	---	---	---	---	---	---	---	17
	04/06/11	---	290	---	---	---	---	---	---	---	---
	07/07/11	---	250	---	---	---	---	---	---	---	---
	10/04/11	440	240	10	1.0	78	1.9	62	10	110	17
	10/04/11	---	200	---	---	---	---	---	---	---	---
	01/17/12	---	260	---	---	---	---	---	---	---	16
	04/03/12	---	280	---	---	---	---	---	---	---	---
No. 139 7S/2W-32G	12/29/87	460	295	24	7	65	1	60	11	104	7
	11/23/92	450	275	32	9	46	2	60	13	134	20
	12/19/95	500	298	36	12	50	2	72	12	156	2.8
	03/25/97	---	---	---	---	---	---	---	---	---	10
	03/13/00	---	---	---	---	---	---	---	---	---	9
	03/28/01	---	---	---	---	---	---	---	---	---	8
	03/11/02	530	280	29	10	57	2	73	13	140	9
	03/09/04	---	---	---	---	---	---	---	---	---	8
	03/09/05	520	310	21	7.7	72	1.3	78	13	150	6
	03/09/06	---	---	---	---	---	---	---	---	---	9.9
	03/07/07	---	---	---	---	---	---	---	---	---	6.9
	04/15/08	550	340	40	14	43	1.9	80	10	150	14
	07/17/08	---	330	---	---	---	---	---	---	---	---
	10/08/08	---	320	---	---	---	---	---	---	---	---
	01/13/09	---	390	---	---	---	---	---	---	---	---
	07/06/09	---	290	---	---	---	---	---	---	---	---
	04/08/09	---	310	---	---	---	---	---	---	---	5.8
	05/17/10	---	320	---	---	---	---	---	---	---	---
	08/09/10	---	340	---	---	---	---	---	---	---	---
	10/21/10	---	---	---	---	---	---	---	---	---	8.9
	11/03/10	---	290	---	---	---	---	---	---	---	---
	02/09/11	---	340	---	---	---	---	---	---	---	---
	04/21/11	570	340	39	15	45	2.3	97	16	140	12
	05/04/11	---	340	---	---	---	---	---	---	---	---
	07/07/11	---	350	---	---	---	---	---	---	---	---
	08/04/11	---	320	---	---	---	---	---	---	---	---
	10/05/11	---	---	---	---	---	---	---	---	---	6.1
	11/02/11	---	310	---	---	---	---	---	---	---	---
	02/09/12	---	330	---	---	---	---	---	---	---	---
	05/02/12	---	320	---	---	---	---	---	---	---	---
	08/09/12	---	310	---	---	---	---	---	---	---	---

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-4

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS SAMPLED BY RANCHO CALIFORNIA WATER DISTRICT

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
No. 140 7S/2W-33F	02/18/88	560	325	33	10	65	2	77	14	153	13
	01/15/92	450	235	11	2	88	1	68	18	107	2
	02/28/95	560	325	36	11	58	2	94	14	140	12
	03/25/97	---	---	---	---	---	---	---	---	---	8
	02/27/98	650	360	31	11	76	2	95	16	130	5
	09/17/98	---	---	---	---	---	---	---	---	---	8
	05/16/01	---	---	---	---	---	---	---	---	---	11
	02/01/01	650	370	31	12	72	2	110	21	150	4
	05/24/02	---	---	---	---	---	---	---	---	---	7
	04/05/05	680	390	37	16	69	2.3	140	18	150	4
	04/06/06	---	---	---	---	---	---	---	---	---	4.4
	04/24/07	---	---	---	---	---	---	---	---	---	3
	04/08/08	630	340	26	9.5	79	1.9	110	21	140	2.7
	04/08/08	---	350	---	---	---	---	---	---	---	2.7
	07/07/08	---	360	---	---	---	---	---	---	---	---
	01/07/09	---	400	---	---	---	---	---	---	---	---
	04/15/09	---	380	---	---	---	---	---	---	---	4.6
	07/06/09	---	360	---	---	---	---	---	---	---	---
	01/06/10	---	350	---	---	---	---	---	---	---	---
	04/08/10	---	350	---	---	---	---	---	---	---	2.1
	07/14/10	---	360	---	---	---	---	---	---	---	---
	10/05/10	---	350	---	---	---	---	---	---	---	---
	01/12/11	---	280	---	---	---	---	---	---	---	---
	04/05/11	640	360	26	9.4	82	1.9	100	19	130	2.4
	04/05/11	---	340	---	---	---	---	---	---	---	2.7
	10/05/11	---	360	---	---	---	---	---	---	---	---
	01/17/12	---	380	---	---	---	---	---	---	---	---
	04/03/12	---	390	---	---	---	---	---	---	---	---
No. 141 8S/2W-11P	01/06/88	780	440	64	11	82	3	65	91	217	13
	01/30/92	820	500	63	13	95	3	79	110	238	19
	03/30/95	840	490	58	11	100	3	70	97	241	14
	03/25/97	---	---	---	---	---	---	---	---	---	15
	03/26/98	760	480	62	12	90	3	69	86	230	16
	01/04/99	---	---	---	---	---	---	---	---	---	14
	02/12/99	---	---	---	---	---	---	---	---	---	19
	10/21/99	---	---	---	---	---	---	---	---	---	17
	11/03/99	---	---	---	---	---	---	---	---	---	14
	12/14/99	---	---	---	---	---	---	---	---	---	14
	06/20/00	---	---	---	---	---	---	---	---	---	15
	01/04/01	700	450	52	6	84	3	75	70	190	15
	09/28/01	---	---	---	---	---	---	---	---	---	18
	11/08/02	---	---	---	---	---	---	---	---	---	15
	09/16/03	---	---	---	---	---	---	---	---	---	19
	01/13/04	760	490	65	11	84	3.1	70	90	220	21
	01/06/05	---	---	---	---	---	---	---	---	---	18

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-4

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS SAMPLED BY RANCHO CALIFORNIA WATER DISTRICT

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
No. 141 8S/2W-11P (Cont)	01/06/06	---	---	---	---	---	---	---	---	---	16
	06/04/08	---	410	---	---	---	---	---	---	---	11
	12/05/08	---	480	---	---	---	---	---	---	---	---
	03/04/09	---	440	---	---	---	---	---	---	---	---
	06/02/09	---	390	---	---	---	---	---	---	---	10
	01/05/10	760	450	62	8.1	84	3.5	77	68	200	16
	03/03/10	---	480	---	---	---	---	---	---	---	---
	06/02/10	---	400	---	---	---	---	---	---	---	13
	09/01/10	---	370	---	---	---	---	---	---	---	---
	01/12/11	---	460	---	---	---	---	---	---	---	---
	04/05/11	---	420	---	---	---	---	---	---	---	---
	06/07/11	---	---	---	---	---	---	---	---	---	12
	07/06/11	---	360	---	---	---	---	---	---	---	---
	10/11/11	---	420	---	---	---	---	---	---	---	---
	01/10/12	---	400	---	---	---	---	---	---	---	---
	04/03/12	---	510	---	---	---	---	---	---	---	---
	06/05/12	---	---	---	---	---	---	---	---	---	12
No. 143 8S/2W-17J	01/15/88	670	345	8	2	134	1	91	57	95	11
	10/17/90	660	345	25	4	112	2	89	62	140	12
	03/03/94	690	370	24	3	114	2	93	68	131	11
	03/30/95	---	---	---	---	---	---	---	---	---	11
	03/25/97	600	330	15	2	110	1	87	44	89	9
	07/18/97	---	---	---	---	---	---	---	---	---	2.0 as N
	07/23/97	---	---	---	---	---	---	---	---	---	2.0 as N
	08/20/97	---	---	---	---	---	---	---	---	---	2.3 as N
	09/03/97	---	---	---	---	---	---	---	---	---	2.2 as N
	09/17/97	---	---	---	---	---	---	---	---	---	2.0 as N
	09/17/98	---	350	---	---	---	---	---	---	---	2.3 as N
	10/21/99	---	---	---	---	---	---	---	---	---	13
	03/07/00	730	400	21	3	120	2	84	68	140	12
	10/13/00	---	---	---	---	---	---	---	---	---	8
	10/10/01	---	---	---	---	---	---	---	---	---	8
	11/19/02	---	---	---	---	---	---	---	---	---	10
	01/13/03	---	---	---	---	---	---	---	---	---	2.1 as N
	03/10/03	650	370	14	1.9	110	1	92	52	130	10
	01/07/04	---	---	---	---	---	---	---	---	---	12
	01/18/05	---	---	---	---	---	---	---	---	---	10
	01/06/06	---	---	---	---	---	---	---	---	---	8.7
	06/08/06	560	270	9.5	1.3	100	1	86	<0.5	100	7.2
	01/10/07	---	---	---	---	---	---	---	---	---	7.3
	01/04/08	---	---	---	---	---	---	---	---	---	7.1
	01/08/09	---	---	---	---	---	---	---	---	---	9
	02/04/09	---	300	---	---	---	---	---	---	---	---
	05/11/09	---	290	---	---	---	---	---	---	---	---

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-4

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS SAMPLED BY RANCHO CALIFORNIA WATER DISTRICT

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
No. 143 8S/2W-17J (Cont)	08/05/09	---	300	---	---	---	---	---	---	---	---
	01/05/10	---	---	---	---	---	---	---	---	---	6.5
	02/04/10	---	320	---	---	---	---	---	---	---	---
	05/06/10	---	330	---	---	---	---	---	---	---	---
	08/13/10	---	280	---	---	---	---	---	---	---	---
	11/01/10	---	350	---	---	---	---	---	---	---	---
	01/13/11	---	---	---	---	---	---	---	---	---	9.1
	02/09/11	---	320	---	---	---	---	---	---	---	---
	05/04/11	---	300	---	---	---	---	---	---	---	---
	08/03/11	---	320	---	---	---	---	---	---	---	---
	11/02/11	---	370	---	---	---	---	---	---	---	---
	01/06/12	---	---	---	---	---	---	---	---	---	7.2
	02/09/12	---	300	---	---	---	---	---	---	---	---
	05/10/12	---	300	---	---	---	---	---	---	---	---
	06/05/12	540	320	7.3	1.1	100	1.0	73	21	100	5.9
	08/07/12	---	310	---	---	---	---	---	---	---	---
No. 144 7S/3W-27D3	09/14/88	610	335	8	<1	114	1	95	33	92	<1
	12/19/95	730	420	34	1	124	1	120	33	186	<1
	12/20/00	690	400	28	1	120	<1	120	35	170	<2
	05/22/01	---	---	---	---	---	---	---	---	---	<2
	08/20/02	---	---	---	---	---	---	---	---	---	<2
	08/27/03	---	---	---	---	---	---	---	---	---	<2
	12/16/03	630	420	33	1.8	110	1	110	28	170	<2
	08/12/04	---	---	---	---	---	---	---	---	---	<2
	10/11/05	---	---	---	---	---	---	---	---	---	2
	12/07/06	670	370	21	1	98	1.2	110	27	150	<1
	08/07/07	---	---	---	---	---	---	---	---	---	<2
	08/11/08	---	320	---	---	---	---	---	---	---	<2
	02/09/09	---	340	---	---	---	---	---	---	---	---
	05/08/09	---	360	---	---	---	---	---	---	---	---
	08/05/09	---	370	---	---	---	---	---	---	---	<2
	02/04/10	---	380	---	---	---	---	---	---	---	---
	05/06/10	---	410	---	---	---	---	---	---	---	---
	08/10/10	---	370	---	---	---	---	---	---	---	<2
	11/10/10	---	400	---	---	---	---	---	---	---	---
	02/02/11	---	340	---	---	---	---	---	---	---	---
	05/04/11	---	350	---	---	---	---	---	---	---	---
	08/09/11	---	340	---	---	---	---	---	---	---	<2
	11/02/11	---	320	---	---	---	---	---	---	---	---
	02/08/12	---	320	---	---	---	---	---	---	---	---
	05/03/12	---	340	---	---	---	---	---	---	---	---
	08/09/12	---	330	---	---	---	---	---	---	---	<1.0

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-4

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS SAMPLED BY RANCHO CALIFORNIA WATER DISTRICT

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
No. 145 7S/3W-28C	10/04/90	800	490	43	8	110	2	110	78	171	<1
	10/06/93	650	375	23	3	106	1	85	58	146	<1
	11/27/96	650	340	26	2	110	1	87	48	150	<2
	02/04/97	670	370	24	2	110	1	87	55	160	<2
	01/28/98	---	---	---	---	---	---	---	---	---	<2
	01/04/99	---	---	---	---	---	---	---	---	---	<2
	10/26/99	690	400	29	3	110	1	96	61	170	<2
	01/06/00	---	---	---	---	---	---	---	---	---	<2
	01/25/01	---	---	---	---	---	---	---	---	---	<2
	01/18/02	---	---	---	---	---	---	---	---	---	<2
	10/09/02	690	390	26	2.3	110	1.2	94	52	160	<2
	01/15/03	---	---	---	---	---	---	---	---	---	<2
	01/07/04	---	---	---	---	---	---	---	---	---	<2
	01/13/05	---	---	---	---	---	---	---	---	---	<2
	10/11/05	680	430	33	2.7	120	1.4	100	54	180	<1
	10/18/05	700	440	34	2.8	120	1.5	100	59	180	<1
	04/13/06	---	---	---	---	---	---	---	---	---	<1
	01/19/07	---	---	---	---	---	---	---	---	---	<1
	01/04/08	---	---	---	---	---	---	---	---	---	<2
	08/11/08	---	360	---	---	---	---	---	---	---	---
	10/08/08	720	400	37	3.2	100	1.3	95	56	150	ND
	01/06/09	---	---	---	---	---	---	---	---	---	ND
	02/03/09	---	390	---	---	---	---	---	---	---	---
	05/08/09	---	410	---	---	---	---	---	---	---	---
	08/05/09	---	400	---	---	---	---	---	---	---	---
	01/07/10	---	---	---	---	---	---	---	---	---	<2
	02/04/10	---	400	---	---	---	---	---	---	---	---
	05/07/10	---	470	---	---	---	---	---	---	---	---
	08/10/10	---	390	---	---	---	---	---	---	---	---
	11/10/10	---	410	---	---	---	---	---	---	---	---
	01/12/11	---	---	---	---	---	---	---	---	---	<2
	02/09/11	---	390	---	---	---	---	---	---	---	---
	05/05/11	---	380	---	---	---	---	---	---	---	---
	08/04/11	---	360	---	---	---	---	---	---	---	---
	10/05/11	670	380	28	2.6	110	1.6	100	49	160	<2
	11/10/11	---	400	---	---	---	---	---	---	---	---
	01/12/12	---	---	---	---	---	---	---	---	---	<1.0
	02/08/12	---	510	---	---	---	---	---	---	---	---
	05/17/12	---	440	---	---	---	---	---	---	---	---
	08/09/12	---	410	---	---	---	---	---	---	---	---
No. 146 7S/3W-28	12/10/96	900	500	57	23	98	<1	100	64	280	15
	03/02/00	---	---	---	---	---	---	---	---	---	4

ND- None Detected

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-4

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS SAMPLED BY RANCHO CALIFORNIA WATER DISTRICT

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
No. 149 8S/1W-2C	06/15/93	---	---	---	---	---	---	---	---	---	5
	10/10/01	---	---	---	---	---	---	---	---	---	4
	03/11/02	1040	610	61	23	120	4	100	170	250	4
	12/11/02	---	---	---	---	---	---	---	---	---	3.2
	01/23/03	---	---	---	---	---	---	---	---	---	4
	03/12/03	1000	600	59	22	120	3.7	100	170	230	3
	01/13/04	---	---	---	---	---	---	---	---	---	4
	01/11/06	---	---	---	---	---	---	---	---	---	2.5
	03/09/06	940	580	56	21	110	3.8	87	160	220	2.7
	01/24/07	---	---	---	---	---	---	---	---	---	2.4
	03/11/08	---	550	---	---	---	---	---	---	---	---
	07/08/08	---	590	---	---	---	---	---	---	---	---
	01/08/09	---	590	---	---	---	---	---	---	---	2.6
	03/04/09	900	590	52	20	100	3.6	93	170	210	2.5
	04/02/09	---	570	---	---	---	---	---	---	---	---
	07/13/09	---	560	---	---	---	---	---	---	---	---
	01/07/10	---	570	---	---	---	---	---	---	---	2.6
	04/08/10	---	570	---	---	---	---	---	---	---	---
	05/12/11	---	570	---	---	---	---	---	---	---	2
	08/03/11	---	600	---	---	---	---	---	---	---	---
	11/09/11	---	620	---	---	---	---	---	---	---	---
	02/09/12	---	580	---	---	---	---	---	---	---	---
	03/02/12	970	600	59	20	99	4.4	95	180	190	2.3
	05/03/12	---	600	---	---	---	---	---	---	---	2.0
	08/08/12	---	610	---	---	---	---	---	---	---	---
No. 149A 7S/3W-28A	08/26/88	950	540	71	211	96	1	115	47	302	18
	10/31/91	800	480	36	13	122	3	93	110	195	---
No. 150 7S/3W-27P	09/29/88	1950	1235	134	29	225	2	290	220	390	15
	12/21/91	1000	590	74	17	108	4	130	110	207	---
No. 151 8S/2W-2G	07/25/91	860	485	53	16	103	4	90	130	183	---
	07/28/91	730	400	39	12	100	3	91	58	177	---
	07/29/91	600	340	9	2	122	5	63	34	204	---
	10/17/91	510	295	3	<1	118	1	45	10	137	---
	08/10/94	550	340	3	<1	110	1	59	22	119	<1
	06/16/97	---	---	---	---	---	---	---	---	---	<2
	08/14/97	540	300	2	<1	110	<1	44	10	160	<2
	09/16/98	---	---	---	---	---	---	---	---	---	<2
	01/06/00	510	300	1	<1	110	<1	33	4.6	180	<2
	01/06/05	---	---	---	---	---	---	---	---	---	<2
	05/12/09	530	380	1	1	110	<1	36	7.7	140	<2.0
	05/05/10	---	---	---	---	---	---	---	---	---	<2
	10/28/10	---	290	---	---	---	---	---	---	---	---
	12/01/10	---	290	---	---	---	---	---	---	---	---

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-4

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS SAMPLED BY RANCHO CALIFORNIA WATER DISTRICT

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
No. 151 8S/2W-2G (Cont)	03/09/11	---	310	---	---	---	---	---	---	---	---
	05/03/11	---	---	---	---	---	---	---	---	---	<2
	06/02/11	---	280	---	---	---	---	---	---	---	---
	09/06/11	---	310	---	---	---	---	---	---	---	---
	12/06/11	---	300	---	---	---	---	---	---	---	---
	03/05/12	---	290	---	---	---	---	---	---	---	---
	05/02/12	490	300	1.3	<1	110	<1	38	4.2	180	<1
	06/05/12	---	240	---	---	---	---	---	---	---	---
	09/04/12	---	300	---	---	---	---	---	---	---	---
No. 151 7S/3W-34B	09/20/88	5780	3410	280	114	840	5	1660	670	369	<1
	Abandoned										
No. 152 8S/1W-5K2	01/11/02	860	550	64	20	77	6	75	190	160	<2
	01/08/03	---	---	---	---	---	---	---	---	---	<2
	01/07/04	---	---	---	---	---	---	---	---	---	<2
	01/24/05	850	510	71	25	77	4.6	85	190	160	<2
	01/04/06	---	---	---	---	---	---	---	---	---	1.1
	01/10/07	---	---	---	---	---	---	---	---	---	<1
	04/08/08	---	510	---	---	---	---	---	---	---	---
	01/02/09	---	580	---	---	---	---	---	---	---	ND
	04/06/09	---	620	---	---	---	---	---	---	---	---
	07/13/09	---	610	---	---	---	---	---	---	---	---
	01/06/10	---	740	---	---	---	---	---	---	---	1.7
	04/19/10	---	670	---	---	---	---	---	---	---	---
	07/08/10	---	620	---	---	---	---	---	---	---	---
	10/07/10	---	580	---	---	---	---	---	---	---	---
	01/11/11	---	710	---	---	---	---	---	---	---	3.8
	04/13/11	---	490	---	---	---	---	---	---	---	---
	07/12/11	---	460	---	---	---	---	---	---	---	---
	10/06/11	---	420	---	---	---	---	---	---	---	---
	01/11/12	---	270	---	---	---	---	---	---	---	<1.1
	04/12/12	---	330	---	---	---	---	---	---	---	---
No. 153 8S/1W-5K3	12/29/93	804	485	53	18	92	5	86	120	214	<1
	04/13/99	880	540	63	23	79	5	68	220	150	<2
	04/11/00	---	---	---	---	---	---	---	---	---	2
	06/14/01	---	---	---	---	---	---	---	---	---	<2
	04/02/02	820	500	63	22	75	4.2	80	190	140	<2
	04/14/05	700	410	44	17	65	3	76	110	140	3
	04/04/06	---	---	---	---	---	---	---	---	---	2.3
	04/04/07	---	---	---	---	---	---	---	---	---	<2
	04/08/08	920	560	62	23	79	4.3	100	170	170	1.9
	01/02/09	---	570	---	---	---	---	---	---	---	---

ND - None Detected

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-4

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS SAMPLED BY RANCHO CALIFORNIA WATER DISTRICT

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
No. 153 8S/1W-5K3 (Cont)	04/06/09	--	610	--	--	--	--	--	--	--	<2.0
	07/13/09	--	590	--	--	--	--	--	--	--	--
	01/06/10	--	560	--	--	--	--	--	--	--	--
	04/08/10	--	610	--	--	--	--	--	--	--	1
	07/08/10	--	590	--	--	--	--	--	--	--	--
	10/07/10	--	540	--	--	--	--	--	--	--	--
	01/11/11	--	640	--	--	--	--	--	--	--	--
	04/13/11	850	520	45	17	93	3.8	92	130	170	2
	04/13/11	--	490	--	--	--	--	--	--	--	2
	07/12/11	--	450	--	--	--	--	--	--	--	--
	10/06/11	--	380	--	--	--	--	--	--	--	--
	01/11/12	--	280	--	--	--	--	--	--	--	--
	04/12/12	--	300	--	--	--	--	--	--	--	<1.0
No. 154 8S/1W-5L2	01/28/94	930	530	46	20	106	6	89	130	214	3
No. 155 7S/3W-28C	09/16/93	680	355	22	2	108	1	90	64	104	<1
	02/23/95	760	445	30	3	126	1	120	82	140	4
	06/06/95	--	--	--	--	--	--	--	--	--	5
	08/14/97	--	--	--	--	--	--	--	--	--	4
	02/25/98	880	540	43	5	130	1	100	100	190	5
	07/27/98	--	--	--	--	--	--	--	--	--	3
	02/09/00	--	--	--	--	--	--	--	--	--	2
	09/13/00	690	410	23	2	120	<1	100	72	130	2
	02/14/01	--	--	--	--	--	--	--	--	--	5
	02/21/02	--	--	--	--	--	--	--	--	--	2
	02/28/03	--	--	--	--	--	--	--	--	--	<2
	01/07/04	600	360	10	<1	120	<1	100	60	100	<2
	02/23/04	--	--	--	--	--	--	--	--	--	6
	10/11/05	--	--	--	--	--	--	--	--	--	2
	02/16/05	--	--	--	--	--	--	--	--	--	5
	02/07/06	--	--	--	--	--	--	--	--	--	4.9
	02/07/07	--	--	--	--	--	--	--	--	--	2.5
No. 156 7S/3W-18	08/11/08	670	350	48	13	78	2.2	70	62	190	1.9
	08/11/08	--	370	--	--	--	--	--	--	--	1.7
	05/08/09	--	400	--	--	--	--	--	--	--	--
	08/05/09	--	410	--	--	--	--	--	--	--	1.5
	02/03/10	--	370	--	--	--	--	--	--	--	--
	05/07/10	--	470	--	--	--	--	--	--	--	--
	08/10/10	--	390	--	--	--	--	--	--	--	<2
	11/10/10	--	410	--	--	--	--	--	--	--	--
	02/09/11	--	410	--	--	--	--	--	--	--	--
	05/04/11	--	400	--	--	--	--	--	--	--	--
	08/04/11	660	380	44	11	72	1.8	75	53	180	2

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-4

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS SAMPLED BY RANCHO CALIFORNIA WATER DISTRICT

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
No. 156 7S/3W-18 (Cont)	08/04/11	---	380	---	---	---	---	---	---	---	1.4
	11/10/11	---	390	---	---	---	---	---	---	---	---
	02/08/12	---	340	---	---	---	---	---	---	---	---
	05/03/12	---	360	---	---	---	---	---	---	---	---
	08/09/12	---	360	---	---	---	---	---	---	---	1.3
No. 157 8S/1W-5L	04/13/99	930	600	59	21	110	7	95	150	240	<2
	04/11/00	---	---	---	---	---	---	---	---	---	2
	06/14/01	---	---	---	---	---	---	---	---	---	<2
	04/02/02	830	520	60	22	78	4.1	78	190	150	<2
	04/14/05	720	420	47	18	69	3.2	74	120	150	2
	04/04/07	---	---	---	---	---	---	---	---	---	<2
	04/08/08	1100	640	68	24	110	4.3	130	170	230	2.6
	07/08/08	---	580	---	---	---	---	---	---	---	---
	01/02/09	---	560	---	---	---	---	---	---	---	---
	04/06/09	---	640	---	---	---	---	---	---	---	<2.0
	07/13/09	---	590	---	---	---	---	---	---	---	---
	01/07/10	---	660	---	---	---	---	---	---	---	---
	04/08/10	---	620	---	---	---	---	---	---	---	<2
	07/08/10	---	610	---	---	---	---	---	---	---	---
	10/07/10	---	540	---	---	---	---	---	---	---	---
	01/11/11	---	590	---	---	---	---	---	---	---	---
	04/13/11	830	520	49	17	84	3.4	89	120	180	<2
	04/13/11	---	490	---	---	---	---	---	---	---	<2
	07/12/11	---	460	---	---	---	---	---	---	---	---
	10/06/11	---	370	---	---	---	---	---	---	---	---
	01/11/12	---	260	---	---	---	---	---	---	---	---
	04/12/12	---	330	---	---	---	---	---	---	---	<1.0
No. 158 8S/1W-5K	06/21/94	1090	620	67	23	124	7	120	170	259	---
	04/14/99	1050	660	63	24	120	7	110	160	270	<2
	04/11/00	---	---	---	---	---	---	---	---	---	2
	06/14/01	---	---	---	---	---	---	---	---	---	2
	04/02/02	900	550	61	22	92	5.7	93	190	180	<2
	04/14/05	800	450	51	19	79	4.6	83	150	160	2
	04/04/06	---	---	---	---	---	---	---	---	---	3.9
	04/04/07	---	---	---	---	---	---	---	---	---	4.6
	04/08/08	1300	760	77	25	140	6.4	150	180	280	3.5
	07/08/08	---	750	---	---	---	---	---	---	---	---
	01/02/09	---	640	---	---	---	---	---	---	---	---
	04/06/09	---	650	---	---	---	---	---	---	---	<2.0
	07/13/09	---	670	---	---	---	---	---	---	---	---
	01/06/10	---	810	---	---	---	---	---	---	---	---
	04/08/10	---	800	---	---	---	---	---	---	---	1.5
	07/08/10	---	680	---	---	---	---	---	---	---	---
	10/07/10	---	750	---	---	---	---	---	---	---	---
	01/11/11	---	710	---	---	---	---	---	---	---	---

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-4

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS SAMPLED BY RANCHO CALIFORNIA WATER DISTRICT

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
No. 158 8S/1W-5K (Cont)	04/13/11	870	510	43	16	100	4.8	97	130	180	2
	04/13/11	---	530	---	---	---	---	---	---	---	2
	07/12/11	---	610	---	---	---	---	---	---	---	---
	10/06/11	---	570	---	---	---	---	---	---	---	---
	02/09/12	---	520	---	---	---	---	---	---	---	---
	04/12/12	---	---	---	---	---	---	---	---	---	<1.0
	05/02/12	---	460	---	---	---	---	---	---	---	---
	08/08/12	---	550	---	---	---	---	---	---	---	---
No. 201 7S/2W-27J	03/28/91	530	315	19	6	83	2	83	16	110	2
	03/11/93	460	300	8	2	87	1	51	20	146	<1
No. 202 7S/2W-36J1	12/11/88	740	440	47	18	84	3	97	48	223	17
No. 203 8S/1W-6P1	05/18/88	960	580	50	39	110	4	96	115	275	---
	06/29/88	970	530	44	36	112	4	120	123	250	5
	06/12/91	800	415	21	17	108	3	91	90	174	2
	06/22/94	980	645	59	38	99	4	130	130	256	4
	06/07/95	---	---	---	---	---	---	---	---	---	5
	06/23/97	880	530	31	26	120	3	100	110	230	4
	08/14/97	---	---	---	---	---	---	---	---	---	3
	11/02/99	---	---	---	---	---	---	---	---	---	5
	06/22/00	820	580	94	18	58	<1	63	110	250	22
	07/12/00	880	570	43	33	120	3	100	130	240	7
	08/08/00	---	---	---	---	---	---	---	---	---	6
	11/22/00	---	---	---	---	---	---	---	---	---	5
	11/20/01	---	---	---	---	---	---	---	---	---	5
	11/08/02	---	---	---	---	---	---	---	---	---	4
	01/08/03	---	---	---	---	---	---	---	---	---	.90 as N
	06/10/03	850	460	31	23	100	2.2	92	100	220	5
	11/04/03	---	---	---	---	---	---	---	---	---	5
	11/18/04	---	---	---	---	---	---	---	---	---	7
	06/08/06	940	540	39	32	110	3	100	130	220	5.5
	06/01/07	---	---	---	---	---	---	---	---	---	5.1
	06/04/08	---	520	---	---	---	---	---	---	---	4.3
	09/16/08	---	450	---	---	---	---	---	---	---	---
	12/02/08	---	500	---	---	---	---	---	---	---	---
	03/04/09	---	470	---	---	---	---	---	---	---	---
	06/01/09	---	440	---	---	---	---	---	---	---	2.7
	03/03/10	---	460	---	---	---	---	---	---	---	---
	06/02/10	---	490	---	---	---	---	---	---	---	3.3
	09/01/10	---	440	---	---	---	---	---	---	---	---
	12/08/10	---	450	---	---	---	---	---	---	---	---
	03/31/11	---	490	---	---	---	---	---	---	---	---
	06/02/11	---	430	---	---	---	---	---	---	---	3.2
	09/02/11	---	420	---	---	---	---	---	---	---	---

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-4

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS SAMPLED BY RANCHO CALIFORNIA WATER DISTRICT

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
No. 203 8S/1W-6P1 (Cont)	12/07/11	--	450	--	--	--	--	--	--	--	--
	06/05/12	740	430	19	15	110	2.3	72	94	180	3.2
	09/05/12	--	440	--	--	--	--	--	--	--	--
No. 204 7S/2W-26G	05/22/91	740	425	50	12	85	3	120	18	198	19
	05/13/94	690	375	37	7	85	3	130	19	125	19
No. 205 7S/3W-35A	03/28/88	500	290	23	3	81	2	83	27	107	21
	03/13/91	490	275	22	3	75	2	62	23	113	21
	03/03/94	510	275	20	2	72	2	72	24	104	20
	04/26/95	--	--	--	--	--	--	--	--	--	22
	03/25/97	480	270	20	2	75	2	66	18	110	21
	05/09/01	410	270	21	3	67	1	60	17	120	23
	11/13/01	--	--	--	--	--	--	--	--	--	21
	02/19/02	--	--	--	--	--	--	--	--	--	20
	05/14/02	--	--	--	--	--	--	--	--	--	18
	08/27/02	--	--	--	--	--	--	--	--	--	20
	11/20/02	--	--	--	--	--	--	--	--	--	18
	01/08/03	--	--	--	--	--	--	--	--	--	4.5 as N
	03/31/03	--	--	--	--	--	--	--	--	--	18
	06/11/03	--	--	--	--	--	--	--	--	--	18
	09/16/03	--	--	--	--	--	--	--	--	--	21
	12/04/03	--	--	--	--	--	--	--	--	--	20
	03/09/04	--	--	--	--	--	--	--	--	--	18
	06/09/04	--	--	--	--	--	--	--	--	--	18
	09/01/04	--	--	--	--	--	--	--	--	--	19
	12/07/04	--	--	--	--	--	--	--	--	--	20
	03/08/05	--	--	--	--	--	--	--	--	--	21
	06/07/05	--	--	--	--	--	--	--	--	--	17
	09/13/05	--	--	--	--	--	--	--	--	--	16
	12/05/05	--	--	--	--	--	--	--	--	--	15
	03/09/06	--	--	--	--	--	--	--	--	--	17
	06/07/06	--	--	--	--	--	--	--	--	--	17
	04/15/09	500	290	19	2	71	1.4	68	18	120	20
	07/14/09	--	270	--	--	--	--	--	--	--	20
	01/06/10	--	280	--	--	--	--	--	--	--	17
	04/08/10	--	--	--	--	--	--	--	--	--	14
	04/20/10	--	290	--	--	--	--	--	--	--	--
	07/20/10	--	260	--	--	--	--	--	--	--	16
	10/05/10	--	240	--	--	--	--	--	--	--	15
	01/04/11	--	210	--	--	--	--	--	--	--	19
	04/12/11	--	280	--	--	--	--	--	--	--	15
	07/08/11	--	260	--	--	--	--	--	--	--	14
	10/04/11	--	260	--	--	--	--	--	--	--	16
	01/12/12	--	250	--	--	--	--	--	--	--	16
	04/03/12	--	300	--	--	--	--	--	--	--	18
	04/24/12	470	260	16	1.4	73	1.6	70	18	98	16

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-4

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS SAMPLED BY RANCHO CALIFORNIA WATER DISTRICT

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
No. 207 8S/2W-14B	09/01/88	510	245	1	<1	108	<1	54	26	82	<1
	09/14/88	480	305	3	<1	106	<1	58	23	24	1
	08/14/91	480	245	1	<1	100	<1	52	28	55	<1
	08/10/94	440	285	2	<1	91	1	56	29	76	2
	08/15/97	510	280	2	<1	97	<1	52	25	98	<2
	07/27/98	---	---	---	---	---	---	---	---	---	2
	12/27/00	480	280	2	<1	100	<1	53	30	120	2
No. 208 7S/2W-35M	09/01/88	680	415	44	15	77	3	119	14	186	18
	09/14/88	690	440	44	14	77	3	129	14	183	16
	08/14/91	600	340	23	7	89	2	85	18	162	4
	08/10/94	560	370	22	6	89	2	93	20	156	5
	06/06/95	---	---	---	---	---	---	---	---	---	4
	08/12/96	---	---	---	---	---	---	---	---	---	2
	07/27/99	---	---	---	---	---	---	---	---	---	15
No. 209 7S/2W-28J	08/18/99	---	---	---	---	---	---	---	---	---	20
	05/22/91	790	435	40	14	105	2	150	35	162	8
	05/13/94	760	525	64	22	48	3	150	15	153	25
	06/20/95	---	---	---	---	---	---	---	---	---	5
No. 210 8S/2W-12K	05/15/97	690	390	10	3	130	<1	110	56	130	1.3
	04/15/59	1366	---	101	23	150	10	149	200	275	3
	01/18/63	400	926	99	30	17.5	4.5	145	255	329	4
	11/30/67	1415	890	136	5	152	10	146	230	305	3
	07/26/68	1250	825	96	22	144	8	130	190	290	5
	09/06/68	1310	840	82	26	132	5	142	222	276	12
	07/19/73	1200	579	84	21.4	149	6.8	122	237	301	19.7
	08/08/75	1140	695	84	14	150	6	101	190	287	15
	06/22/76	1240	675	76	26	142	7	101	205	278	36
	10/13/76	1120	640	92	22	100	6	110	170	262	5
	06/16/77	1130	610	84	18	114	6	110	170	259	11
	05/20/80	580	340	30	8	75	4	51	67	152	9
	04/03/86	800	540	65	17	86	4.5	75	112	235	3.5
	07/15/86	830	560	72	19	86	4	87	118	250	4
	03/28/88	1030	575	76	22	93	5	99	143	247	4
	09/25/91	1040	600	74	20	120	5	120	160	238	5
	09/19/94	645	460	52	14	79	4	70	100	198	2
	09/16/96	---	---	---	---	---	---	---	---	---	3
	09/16/98	---	---	---	---	---	---	---	---	---	3
	12/15/98	---	---	---	---	---	---	---	---	---	2
	01/04/99	---	---	---	---	---	---	---	---	---	2
	02/03/99	---	---	---	---	---	---	---	---	---	2
	04/08/99	---	---	---	---	---	---	---	---	---	3
	06/02/99	---	---	---	---	---	---	---	---	---	3
	09/07/99	---	---	---	---	---	---	---	---	---	4

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-4

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS SAMPLED BY RANCHO CALIFORNIA WATER DISTRICT

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
No. 210 8S/2W-12K (Cont)	10/21/99	---	---	---	---	---	---	---	---	---	5
	12/15/99	---	---	---	---	---	---	---	---	---	5
	05/03/00	---	---	---	---	---	---	---	---	---	5
	09/13/00	830	560	64	17	100	4	74	190	180	4
	05/08/01	---	---	---	---	---	---	---	---	---	4
	05/13/02	---	---	---	---	---	---	---	---	---	3
	01/08/03	---	---	---	---	---	---	---	---	---	.52 as N
	08/20/03	---	---	---	---	---	---	---	---	---	2.2
	09/16/03	830	560	65	18	78	4.5	76	180	160	2
	08/10/04	---	---	---	---	---	---	---	---	---	3.2
	08/02/05	---	---	---	---	---	---	---	---	---	5.4
	08/15/06	---	---	---	---	---	---	---	---	---	6.7
	08/14/07	---	---	---	---	---	---	---	---	---	12.0
	08/12/08	---	590	---	---	---	---	---	---	---	7.6
	03/05/09	---	520	---	---	---	---	---	---	---	---
	06/02/09	---	570	---	---	---	---	---	---	---	---
	08/05/09	---	---	---	---	---	---	---	---	---	4.9
	03/03/10	---	600	---	---	---	---	---	---	---	---
	06/02/10	---	600	---	---	---	---	---	---	---	---
	08/11/10	---	---	---	---	---	---	---	---	---	3.6
	09/08/10	---	600	---	---	---	---	---	---	---	---
	12/08/10	---	590	---	---	---	---	---	---	---	---
	03/09/11	---	620	---	---	---	---	---	---	---	---
	06/08/11	---	600	---	---	---	---	---	---	---	---
	11/10/11	---	600	---	---	---	---	---	---	---	3.8
	02/09/12	---	560	---	---	---	---	---	---	---	---
	05/02/12	---	540	---	---	---	---	---	---	---	---
	08/09/12	---	490	---	---	---	---	---	---	---	---
	09/05/12	840	530	60	19	84	5.6	86	150	180	12
No. 211 8S/2W-20R1	04/08/97	720	400	67	14	54	1	59	65	220	13
	12/23/97	---	410	---	---	---	---	---	---	---	3.1 as N
	03/25/98	---	620	---	---	---	---	---	---	---	3.6 as N
	06/03/98	---	---	---	---	---	---	---	---	---	3.4 as N
	06/05/98	---	480	---	---	---	---	---	---	---	---
	09/17/98	---	---	---	---	---	---	---	---	---	3.3 as N
	12/17/98	---	430	---	---	---	---	56	66	---	16
	06/03/99	---	430	---	---	---	---	---	---	---	3.4 as N
	12/14/99	---	310	---	---	---	---	---	---	---	10
	04/04/00	700	430	71	14	52	1	57	66	220	17
	06/22/00	---	400	---	---	---	---	---	---	---	15
	12/13/00	---	---	---	---	---	---	---	---	---	4.5 as N
	03/27/01	---	---	---	---	---	---	---	---	---	4.5 as N
	06/20/01	---	---	---	---	---	---	---	---	---	2.7 as N
	09/13/01	---	---	---	---	---	---	---	---	---	4.7 as N
	11/13/01	---	450	---	---	---	---	---	---	---	---

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-4

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS SAMPLED BY RANCHO CALIFORNIA WATER DISTRICT

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
No. 211 8S/2W-20R1 (Cont)	05/14/02	---	370	---	---	---	---	---	---	---	12
	07/15/03	630	370	61	11	46	1.2	46	51	220	11
	12/09/08	---	480	---	---	---	---	---	---	---	22
	03/09/09	---	560	---	---	---	---	---	---	---	17
	06/02/09	---	480	---	---	---	---	---	---	---	14
	01/12/10	---	360	---	---	---	---	---	---	---	6.3
	04/15/10	---	500	---	---	---	---	---	---	---	16
	07/21/10	---	510	---	---	---	---	---	---	---	15
	10/07/10	---	540	---	---	---	---	---	---	---	14
	01/18/11	---	550	---	---	---	---	---	---	---	15
	04/06/11	---	560	---	---	---	---	---	---	---	16
	07/07/11	---	520	---	---	---	---	---	---	---	13
	09/01/11	840	460	86	16	56	1.2	66	100	260	13
	10/12/11	---	420	---	---	---	---	---	---	---	14
	01/10/12	---	520	---	---	---	---	---	---	---	14
	04/18/12	---	510	---	---	---	---	---	---	---	14
No. 212 8S/2W-11N	03/28/88	640	330	42	2	74	3	81	33	146	14
	09/25/91	600	320	41	2	82	4	86	35	146	14
No. 215 7S/2W-34M	08/15/90	650	380	40	13	71	3	100	14	162	11
	09/26/90	---	---	---	---	---	---	---	---	---	13
	06/22/94	630	400	41	13	67	2	110	16	159	11
	06/16/97	630	370	29	9	81	2	110	16	160	6
	08/15/97	---	---	---	---	---	---	---	---	---	7
	08/11/04	630	380	35	12	76	2.6	100	14	150	<2
	09/09/04	---	---	---	---	---	---	---	---	---	9
	06/26/06	---	---	---	---	---	---	---	---	---	6.6
	06/05/07	---	---	---	---	---	---	---	---	---	2.4
	08/14/07	590	320	22	7.3	85	2.2	88	16	150	2.2
	12/02/08	---	370	---	---	---	---	---	---	---	---
	03/09/09	---	380	---	---	---	---	---	---	---	---
	06/04/09	---	300	---	---	---	---	---	---	---	---
	03/04/10	---	340	---	---	---	---	---	---	---	---
	06/18/10	---	340	---	---	---	---	---	---	---	---
	08/18/10	580	330	20	6.5	79	1.9	82	16	150	2.5
	09/03/10	---	330	---	---	---	---	---	---	---	2.2
	12/17/10	---	350	---	---	---	---	---	---	---	---
	03/15/11	---	250	---	---	---	---	---	---	---	---
	06/07/11	---	320	---	---	---	---	---	---	---	---
	12/06/11	---	320	---	---	---	---	---	---	---	---

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-4

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS SAMPLED BY RANCHO CALIFORNIA WATER DISTRICT

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
No. 216 8S/2W-7W	06/01/88	480	280	25	4	65	2	71	11	134	---
	06/29/88	480	275	29	5	59	3	81	7	110	26
	06/12/91	500	285	30	5	59	2	76	9	113	23
	05/27/92	470	285	33	6	53	2	72	10	119	20
	04/25/01	490	300	28	4	55	2	74	13	120	12
	09/21/04	540	320	31	5.6	53	2.1	74	10	130	14
	10/26/04	---	---	---	---	---	---	---	---	---	15
	11/02/04	---	---	---	---	---	---	---	---	---	15
	11/10/04	---	---	---	---	---	---	---	---	---	16
	10/18/05	---	---	---	---	---	---	---	---	---	19
	10/12/06	---	---	---	---	---	---	---	---	---	19
	09/07/07	510	300	28	4.7	57	3.5	82	12	110	18
	10/03/07	---	---	---	---	---	---	---	---	---	17
	04/23/09	---	---	---	---	---	---	---	---	---	14
	03/18/10	---	370	---	---	---	---	---	---	---	---
	04/08/10	---	---	---	---	---	---	---	---	---	12
	06/10/10	---	380	---	---	---	---	---	---	---	---
	09/01/10	---	340	---	---	---	---	---	---	---	---
	09/01/10	570	320	41	6.9	58	2.3	86	16	130	16
	12/08/10	---	360	---	---	---	---	---	---	---	---
	12/14/10	---	390	---	---	---	---	---	---	---	---
	06/08/11	---	390	---	---	---	---	---	---	---	---
	08/10/11	---	---	---	---	---	---	---	---	---	15
	12/08/11	---	400	---	---	---	---	---	---	---	---
	06/08/12	---	420	---	---	---	---	---	---	---	---
No. 217 8S/2W-17M1	03/28/88	580	285	8	1	108	1	81	20	113	15
	08/10/88	570	280	8	1	105	1	82	20	55	13
	08/14/91	570	305	17	2	99	2	74	28	134	16
	08/10/94	610	365	20	3	97	2	82	38	134	16
	08/15/97	660	370	20	3	107	1	80	41	130	13
	05/09/00	---	---	---	---	---	---	---	---	---	15
	10/12/00	650	380	19	2	110	1	81	49	150	16
	05/14/01	---	---	---	---	---	---	---	---	---	17
	05/14/02	---	---	---	---	---	---	---	---	---	12
	10/15/03	690	400	25	3.3	110	1.6	84	58	150	16
	05/06/04	---	---	---	---	---	---	---	---	---	17
	05/11/06	---	---	---	---	---	---	---	---	---	15
	05/15/07	---	---	---	---	---	---	---	---	---	16
	05/06/08	---	400	---	---	---	---	---	---	---	14
	08/12/08	---	430	---	---	---	---	---	---	---	---
	05/11/09	---	400	---	---	---	---	---	---	---	13
	08/05/09	---	400	---	---	---	---	---	---	---	---
	02/02/10	---	390	---	---	---	---	---	---	---	---
	05/06/10	---	480	---	---	---	---	---	---	---	17
	08/09/10	---	470	---	---	---	---	---	---	---	---
	11/16/10	---	420	---	---	---	---	---	---	---	---

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-4

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS SAMPLED BY RANCHO CALIFORNIA WATER DISTRICT

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
No. 217 8S/2W-17M1 (Cont)	02/02/11	---	410	---	---	---	---	---	---	---	---
	05/04/11	---	440	---	---	---	---	---	---	---	15
	08/02/11	---	440	---	---	---	---	---	---	---	---
	11/03/11	---	400	---	---	---	---	---	---	---	---
	02/07/12	---	420	---	---	---	---	---	---	---	---
	05/02/12	---	440	---	---	---	---	---	---	---	16
	08/07/12	---	450	---	---	---	---	---	---	---	---
No. 231 8S/2W-20B6	08/15/90	1280	805	126	18	120	5	100	310	244	9
	09/26/90	---	---	---	---	---	---	---	---	---	6
	03/04/92	1700	1270	180	51	160	6	140	510	332	5
	06/20/95	1640	1300	171	44	124	6	75	520	287	5.3
	02/27/98	---	---	---	---	---	---	---	---	---	3
	05/16/00	---	---	---	---	---	---	---	---	---	5
	05/24/01	1490	1080	140	35	120	5	120	340	330	3
	05/13/02	---	---	---	---	---	---	---	---	---	2
	07/12/05	---	---	---	---	---	---	---	---	---	2.2
	07/20/06	---	---	---	---	---	---	---	---	---	3.7
	05/02/07	1400	830	120	27	110	4	130	250	300	2.1
	03/07/08	---	900	---	---	---	---	---	---	---	2.4
	08/15/90	960	590	71	19	110	5	98	130	235	30
	09/26/90	---	---	---	---	---	---	---	---	---	35
No. 232 8S/2W-11J3	09/25/91	980	565	74	19	106	5	98	120	244	37
	09/19/94	805	495	54	14	92	4	80	110	207	15
	09/13/96	---	---	---	---	---	---	---	---	---	22
	11/04/97	1000	660	76	20	110	4	97	130	230	29
	07/27/98	---	---	---	---	---	---	---	---	---	38
	12/10/98	---	---	---	---	---	---	---	---	---	22
	01/06/98	---	---	---	---	---	---	---	---	---	30
	01/29/99	---	---	---	---	---	---	---	---	---	10
	02/03/99	---	---	---	---	---	---	---	---	---	26
	02/24/99	---	---	---	---	---	---	---	---	---	37
	04/08/99	---	---	---	---	---	---	---	---	---	33
	04/21/99	---	---	---	---	---	---	---	---	---	34
	06/23/99	---	---	---	---	---	---	---	---	---	33
	07/08/99	---	---	---	---	---	---	---	---	---	36
	08/25/99	---	---	---	---	---	---	---	---	---	33
	09/21/99	---	---	---	---	---	---	---	---	---	31
	10/06/99	---	---	---	---	---	---	---	---	---	30
	11/17/99	---	---	---	---	---	---	---	---	---	32
	12/14/99	---	---	---	---	---	---	---	---	---	32
	01/18/00	---	---	---	---	---	---	---	---	---	31
	02/29/00	---	---	---	---	---	---	---	---	---	10
	03/21/00	---	---	---	---	---	---	---	---	---	25
	04/11/00	---	---	---	---	---	---	---	---	---	29

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-4

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS SAMPLED BY RANCHO CALIFORNIA WATER DISTRICT .

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
No. 232 8S/2W-11J3 (Cont)	05/25/00	---	---	---	---	---	---	---	---	---	26
	06/21/00	---	---	---	---	---	---	---	---	---	26
	07/11/00	---	---	---	---	---	---	---	---	---	25
	09/13/00	920	590	65	17	105	4	91	150	210	21
	10/06/00	---	---	---	---	---	---	---	---	---	18
	11/08/00	---	---	---	---	---	---	---	---	---	17
	12/13/00	---	---	---	---	---	---	---	---	---	20
	01/04/01	---	---	---	---	---	---	---	---	---	19
	02/28/01	---	---	---	---	---	---	---	---	---	10
	04/10/01	---	---	---	---	---	---	---	---	---	20
	10/10/01	---	---	---	---	---	---	---	---	---	26
	05/14/02	---	---	---	---	---	---	---	---	---	22
	08/06/02	---	---	---	---	---	---	---	---	---	4*
	01/08/03	---	---	---	---	---	---	---	---	---	6.0 as N
	03/31/03	---	---	---	---	---	---	---	---	---	11
	06/10/03	---	---	---	---	---	---	---	---	---	31
	07/08/03	---	---	---	---	---	---	---	---	---	30
	08/20/03	---	---	---	---	---	---	---	---	---	28
	09/16/03	1100	680	67	18	110	4.3	100	150	240	33
	10/14/03	---	---	---	---	---	---	---	---	---	31
	01/14/04	---	---	---	---	---	---	---	---	---	23
	02/10/04	---	---	---	---	---	---	---	---	---	21
	04/14/04	---	---	---	---	---	---	---	---	---	25
	05/06/04	---	---	---	---	---	---	---	---	---	26
	06/22/04	---	---	---	---	---	---	---	---	---	25
	07/14/04	---	---	---	---	---	---	---	---	---	25
	08/10/04	---	---	---	---	---	---	---	---	---	31
	09/08/04	---	---	---	---	---	---	---	---	---	26
	10/26/04	---	---	---	---	---	---	---	---	---	15
	11/18/04	---	---	---	---	---	---	---	---	---	26
	12/07/04	---	---	---	---	---	---	---	---	---	16
	01/10/05	---	---	---	---	---	---	---	---	---	20
	02/14/05	---	---	---	---	---	---	---	---	---	14
	03/11/05	---	---	---	---	---	---	---	---	---	11
	04/13/05	---	---	---	---	---	---	---	---	---	25
	06/08/05	---	---	---	---	---	---	---	---	---	24
	07/12/05	---	---	---	---	---	---	---	---	---	22
	08/02/05	---	---	---	---	---	---	---	---	---	18

* Sample may have been switched with Well 233

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-4

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS SAMPLED BY RANCHO CALIFORNIA WATER DISTRICT

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
No. 232 8S/2W-11J3 (Cont)	09/20/05	---	---	---	---	---	---	---	---	---	19
	10/18/05	---	---	---	---	---	---	---	---	---	18
	11/08/05	---	---	---	---	---	---	---	---	---	18
	12/06/05	---	---	---	---	---	---	---	---	---	19
	01/04/06	---	---	---	---	---	---	---	---	---	15
	02/14/06	---	---	---	---	---	---	---	---	---	18
	03/13/06	---	---	---	---	---	---	---	---	---	8.3
	04/18/06	---	---	---	---	---	---	---	---	---	12
	05/12/06	---	---	---	---	---	---	---	---	---	15
	06/22/06	---	---	---	---	---	---	---	---	---	11
	07/19/06	---	---	---	---	---	---	---	---	---	13
	08/15/06	---	---	---	---	---	---	---	---	---	14
	11/02/06	---	---	---	---	---	---	---	---	---	15
	01/10/07	---	---	---	---	---	---	---	---	---	13
	02/07/07	---	---	---	---	---	---	---	---	---	15
	03/14/07	---	---	---	---	---	---	---	---	---	15
	04/17/07	---	---	---	---	---	---	---	---	---	14
	05/01/07	---	---	---	---	---	---	---	---	---	13
	06/01/07	---	---	---	---	---	---	---	---	---	11
	07/05/07	---	---	---	---	---	---	---	---	---	12
	08/14/07	---	---	---	---	---	---	---	---	---	14
	10/03/07	---	---	---	---	---	---	---	---	---	13
	12/05/07	---	---	---	---	---	---	---	---	---	12
	01/08/08	---	---	---	---	---	---	---	---	---	11
	02/13/08	---	---	---	---	---	---	---	---	---	6.9
	03/04/08	---	---	---	---	---	---	---	---	---	9.7
	03/07/08	---	610	---	---	---	---	---	---	---	---
	04/08/08	---	---	---	---	---	---	---	---	---	13
	05/07/08	---	---	---	---	---	---	---	---	---	12
	07/10/08	---	580	---	---	---	---	---	---	---	---
	07/28/08	---	---	---	---	---	---	---	---	---	12
	08/12/08	---	---	---	---	---	---	---	---	---	13
	12/03/08	---	---	---	---	---	---	---	---	---	14
	01/13/09	---	660	---	---	---	---	---	---	---	14
	02/05/09	---	---	---	---	---	---	---	---	---	13
	03/04/09	---	---	---	---	---	---	---	---	---	12
	04/02/09	---	580	---	---	---	---	---	---	---	13
	05/11/09	---	---	---	---	---	---	---	---	---	11
	06/02/09	---	---	---	---	---	---	---	---	---	11
	07/13/09	---	580	---	---	---	---	---	---	---	12
	08/05/09	---	---	---	---	---	---	---	---	---	12
	01/06/10	---	590	---	---	---	---	---	---	---	12
	02/03/10	---	---	---	---	---	---	---	---	---	10
	03/10/10	---	---	---	---	---	---	---	---	---	8.5

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-4

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS SAMPLED BY RANCHO CALIFORNIA WATER DISTRICT

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
No. 232 8S/2W-11J3 (Cont)	04/08/10	---	570	---	---	---	---	---	---	---	12
	05/07/10	---	---	---	---	---	---	---	---	---	13
	06/03/10	---	---	---	---	---	---	---	---	---	13
	07/08/10	---	570	---	---	---	---	---	---	---	13
	08/10/10	---	---	---	---	---	---	---	---	---	14
	09/02/10	---	---	---	---	---	---	---	---	---	3.6
	10/06/10	---	590	---	---	---	---	---	---	---	15
	11/16/10	---	---	---	---	---	---	---	---	---	13
	12/01/10	---	---	---	---	---	---	---	---	---	14
	01/04/11	---	490	---	---	---	---	---	---	---	7.9
	03/09/11	---	---	---	---	---	---	---	---	---	8.4
	04/05/11	---	560	---	---	---	---	---	---	---	13
	05/03/11	---	---	---	---	---	---	---	---	---	11
	06/08/11	---	---	---	---	---	---	---	---	---	11
	07/06/11	---	590	---	---	---	---	---	---	---	10
	08/03/11	---	---	---	---	---	---	---	---	---	10
	09/02/11	---	---	---	---	---	---	---	---	---	10
	10/14/11	---	610	---	---	---	---	---	---	---	11
	11/02/11	---	---	---	---	---	---	---	---	---	11
	12/07/11	---	---	---	---	---	---	---	---	---	11
	01/11/12	---	590	---	---	---	---	---	---	---	9.9
	02/02/12	---	---	---	---	---	---	---	---	---	9.4
	03/07/12	---	---	---	---	---	---	---	---	---	9.7
	04/04/12	---	580	---	---	---	---	---	---	---	8.4
	05/02/12	---	---	---	---	---	---	---	---	---	9.4
	06/05/12	---	---	---	---	---	---	---	---	---	9.6
	08/08/12	---	---	---	---	---	---	---	---	---	10
	09/05/12	950	610	69	19	100	4.5	99	200	190	11
No. 233 (Old 112) 8S/2W-12K2	06/15/88	900	535	71	21	100	5	96	136	247	4
	03/27/91	1020	580	66	19	114	5	95	140	247	12
	03/03/94	740	425	50	14	75	4	71	100	186	2
	04/27/95	---	---	---	---	---	---	---	---	---	6
	03/27/97	880	510	57	15	100	4	81	120	220	4
	01/04/99	---	---	---	---	---	---	---	---	---	5
	02/03/99	---	---	---	---	---	---	---	---	---	4
	04/08/99	---	---	---	---	---	---	---	---	---	4
	06/03/99	---	---	---	---	---	---	---	---	---	4
	07/20/99	---	---	---	---	---	---	---	---	---	5
	08/11/99	---	---	---	---	---	---	---	---	---	4
	09/07/99	---	---	---	---	---	---	---	---	---	4
	10/21/99	---	---	---	---	---	---	---	---	---	5
	11/03/99	---	---	---	---	---	---	---	---	---	4
	04/11/00	970	570	64	18	110	4	85	150	230	4
	10/06/00	---	---	---	---	---	---	---	---	---	3
	10/10/01	---	---	---	---	---	---	---	---	---	4
	08/06/02	---	---	---	---	---	---	---	---	---	26*
	01/13/03	---	---	---	---	---	---	---	---	---	1 as N
	07/07/03	---	---	---	---	---	---	---	---	---	2.7
	07/13/04	---	---	---	---	---	---	---	---	---	3
	07/12/05	---	---	---	---	---	---	---	---	---	2.8
	04/04/06	960	600	75	20	87	4.5	93	180	180	7.3

* Sample might have been switched with Well 232

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-4

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS SAMPLED BY RANCHO CALIFORNIA WATER DISTRICT

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
No. 233 (Old 112) 8S/2W-12K2 (Cont)	08/04/06	---	---	---	---	---	---	---	---	---	11
	08/14/07	---	---	---	---	---	---	---	---	---	8.1
	08/13/08	---	530	---	---	---	---	---	---	---	6.1
	02/05/09	---	570	---	---	---	---	---	---	---	---
	04/02/09	960	580	70	20	88	4.7	100	160	200	6.8
	05/11/09	---	610	---	---	---	---	---	---	---	---
	08/04/09	---	570	---	---	---	---	---	---	---	5
	02/02/10	---	560	---	---	---	---	---	---	---	---
	05/06/10	---	660	---	---	---	---	---	---	---	---
	08/10/10	---	580	---	---	---	---	---	---	---	5.1
	07/02/11	---	630	---	---	---	---	---	---	---	---
	08/03/11	---	---	---	---	---	---	---	---	---	4.2
	10/14/11	---	620	---	---	---	---	---	---	---	---
	01/10/12	---	580	---	---	---	---	---	---	---	---
	04/12/12	930	560	67	20	93	5.5	91	190	180	4.7
	04/12/12	---	570	---	---	---	---	---	---	---	---
	08/08/12	---	---	---	---	---	---	---	---	---	5.3
No. 234 (Old 114) 8S/2W-11P	03/31/88	840	480	54	15	100	4	61	109	241	18
	03/27/91	1020	605	69	19	114	5	77	138	256	37
	06/20/95	---	---	---	---	---	---	---	---	---	11
	09/26/96	---	---	---	---	---	---	---	---	---	9
	02/04/97	---	---	---	---	---	---	---	---	---	12
	04/25/97	840	500	56	15	95	4	77	120	230	8
	01/19/99	---	---	---	---	---	---	---	---	---	12
	02/12/99	---	---	---	---	---	---	---	---	---	16
	04/21/99	---	---	---	---	---	---	---	---	---	15
	06/03/99	---	---	---	---	---	---	---	---	---	16
	07/27/99	---	---	---	---	---	---	---	---	---	18
	08/19/99	---	---	---	---	---	---	---	---	---	17
	09/21/99	---	---	---	---	---	---	---	---	---	16
	10/26/99	---	---	---	---	---	---	---	---	---	13
	04/13/00	900	550	64	18	10	4	70	150	220	13
	07/06/00	---	---	---	---	---	---	---	---	---	12
	07/12/01	---	---	---	---	---	---	---	---	---	7
	08/02/01	---	---	---	---	---	---	---	---	---	<2
	11/20/02	---	---	---	---	---	---	---	---	---	3
	12/11/02	850	520	62	17	80	3.7	74	170	170	4
	11/04/03	---	---	---	---	---	---	---	---	---	10
	11/05/04	---	---	---	---	---	---	---	---	---	10
	11/03/05	---	---	---	---	---	---	---	---	---	12
	12/06/05	890	620	70	19	89	4.1	85	180	200	12
	11/08/06	---	---	---	---	---	---	---	---	---	14
	11/16/07	---	---	---	---	---	---	---	---	---	16
	08/12/08	---	610	---	---	---	---	---	---	---	---
	11/06/08	---	570	---	---	---	---	---	---	---	20
	12/03/08	960	660	83	21	89	4.9	87	160	230	20
	02/05/09	---	590	---	---	---	---	---	---	---	---
	05/07/09	---	620	---	---	---	---	---	---	---	---

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-4

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS SAMPLED BY RANCHO CALIFORNIA WATER DISTRICT

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
No. 234 (Old 114) 8S/2W-11P (Cont)	08/04/09	---	590	---	---	---	---	---	---	---	---
	02/03/10	---	610	---	---	---	---	---	---	---	---
	05/06/10	---	680	---	---	---	---	---	---	---	---
	08/10/10	---	610	---	---	---	---	---	---	---	---
	08/11/10	---	610	---	---	---	---	---	---	---	---
	11/01/10	---	610	---	---	---	---	---	---	---	21
	02/09/11	---	620	---	---	---	---	---	---	---	---
	05/03/11	---	620	---	---	---	---	---	---	---	---
	08/03/11	---	570	---	---	---	---	---	---	---	---
	11/02/11	---	560	---	---	---	---	---	---	---	20
	12/06/11	990	660	71	20	99	4.2	91	160	240	21
	05/03/12	---	620	---	---	---	---	---	---	---	---
	08/08/12	---	620	---	---	---	---	---	---	---	---
No. 235 (Old 137) 8S/3W-1Q1	06/24/88	460	310	40	10	41	2	58	10	140	15
	06/20/90	420	230	22	4	56	2	50	6	128	18
	06/10/93	370	235	15	2	65	2	51	9	113	17
	07/16/96	410	230	16	2	60	1	48	8.9	110	20
	06/09/97	---	---	---	---	---	---	---	---	---	17
	06/03/99	390	240	13	1	63	1	46	6.7	98	17
	11/03/99	---	---	---	---	---	---	---	---	---	16
	11/09/00	---	---	---	---	---	---	---	---	---	15
	11/20/01	---	---	---	---	---	---	---	---	---	13
	06/11/02	380	210	10	<1	62	1.2	48	7.2	100	16
	11/05/02	---	---	---	---	---	---	---	---	---	17
	11/18/03	---	---	---	---	---	---	---	---	---	11
	11/18/05	---	---	---	---	---	---	---	---	---	18
	06/22/05	380	230	9	<1	68	1.1	49	7.3	96	16
	11/08/05	---	---	---	---	---	---	---	---	---	17
	11/14/06	---	---	---	---	---	---	---	---	---	16
	06/11/08	400	210	11	1	72	1.4	48	8.4	100	15
	07/07/08	---	200	---	---	---	---	---	---	---	---
	01/13/09	---	260	---	---	---	---	---	---	---	---
	04/07/09	---	210	---	---	---	---	---	---	---	---
	07/13/09	---	200	---	---	---	---	---	---	---	---
	01/06/10	---	230	---	---	---	---	---	---	---	---
	04/08/10	---	220	---	---	---	---	---	---	---	---
	07/14/10	---	220	---	---	---	---	---	---	---	---
	10/05/10	---	180	---	---	---	---	---	---	---	---
	11/16/10	---	---	---	---	---	---	---	---	---	15
	01/12/11	---	170	---	---	---	---	---	---	---	---
	08/17/11	380	210	13	1.2	65	1.7	48	8.4	100	16
	08/17/11	---	230	---	---	---	---	---	---	---	---
	11/02/11	---	200	---	---	---	---	---	---	---	15
	02/09/12	---	200	---	---	---	---	---	---	---	---
	05/03/12	---	220	---	---	---	---	---	---	---	---
	08/09/12	---	200	---	---	---	---	---	---	---	---

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-4

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS SAMPLED BY RANCHO CALIFORNIA WATER DISTRICT

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
No. 301 7S/3W-18Q1	07/29/92	500	290	20	6	80	1	45	56	143	<1
	02/27/97	580	350	45	16	48	2	49	54	200	4
	08/15/97	---	---	---	---	---	---	---	---	---	6
	12/27/00	570	360	49	15	53	2	55	57	180	7
	02/22/02	---	---	---	---	---	---	---	---	---	<2
	05/14/02	550	340	---	---	---	---	57	50	---	3
	12/11/02	580	350	---	---	---	---	---	---	---	2.5
No. 302 7S/3W-18H	04/11/88	690	360	36	6	100	1	77	65	192	<1
	05/15/91	760	425	58	9	87	2	83	72	220	<1
	05/14/92	---	270	12	2	90	<1	48	48	---	---
	05/05/94	870	530	69	16	84	2	110	88	238	<1
	05/16/95	---	---	---	---	---	---	---	---	---	<1
	07/16/96	530	320	---	---	---	---	60	54	---	2
	05/13/97	560	500	73	14	94	2	110	86	240	<2
	07/27/99	---	---	---	---	---	---	---	---	---	<2
	05/17/00	520	320	11	1	99	<1	51	50	130	<2
	06/13/00	520	310	---	---	---	---	---	---	---	<2
	07/11/00	---	---	---	---	---	---	---	---	---	<2
	12/20/01	790	500	---	---	---	---	110	140	---	<2
	12/11/02	870	510	---	---	---	---	---	---	---	ND
	06/19/03	620	370	22	3.8	95	<1	77	63	140	<2
	03/17/04	830	510	---	---	---	---	110	85	---	<2
	06/22/04	---	---	---	---	---	---	---	---	---	<2
	09/21/04	900	550	---	---	---	---	110	82	---	<2
No. 309 7S/3W-27H	08/15/90	690	370	19	3	119	2	140	25	73	5
	04/11/91	---	---	---	---	---	---	---	---	---	<.001
	09/25/91	730	365	19	2	122	2	150	27	82	5
	08/11/94	730	430	20	2	120	2	160	30	73	5
	02/16/95	---	---	---	---	---	---	---	---	---	18
	07/16/97	---	---	---	---	---	---	---	---	---	1.1 as N
	07/23/97	---	---	---	---	---	---	---	---	---	1.2 as N
	08/20/97	---	---	---	---	---	---	---	---	---	1.1 as N
	09/03/97	---	---	---	---	---	---	---	---	---	1.1 as N
	09/18/97	---	---	---	---	---	---	---	---	---	1.1 as N
	10/03/97	790	520	21	2	130	2	170	33	85	6
	08/06/98	---	---	---	---	---	---	---	---	---	6
	09/16/98	---	460	---	---	---	---	---	---	---	1.4 as N
	07/20/99	---	---	---	---	---	---	---	---	---	6
	05/10/00	---	450	20	2	130	<1	---	---	85	---
	07/06/00	---	---	---	---	---	---	---	---	---	6

ND - None Detected

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-4

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS SAMPLED BY RANCHO CALIFORNIA WATER DISTRICT

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
No. 309 7S/3W-27H (Cont)	08/02/00	740	450	21	2	140	1	180	38	87	7
	07/19/01	---	---	---	---	---	---	---	---	---	7
	11/19/02	---	---	---	---	---	---	---	---	---	5
	01/13/03	---	---	---	---	---	---	---	---	---	1.1 as N
	08/20/03	880	490	21	2.1	140	1.5	190	33	83	5
	01/07/04	---	---	---	---	---	---	---	---	---	6
	11/11/05	---	---	---	---	---	---	---	---	---	6
	01/04/06	---	---	---	---	---	---	---	---	---	5.4
	12/07/06	870	470	21	1.9	140	2	190	36	84	5.4
	01/10/07	---	---	---	---	---	---	---	---	---	5.3
	01/08/08	---	---	---	---	---	---	---	---	---	5.4
	08/12/08	---	470	---	---	---	---	---	---	---	---
	01/06/09	---	---	---	---	---	---	---	---	---	6.7
	02/03/09	---	450	---	---	---	---	---	---	---	---
	04/01/09	---	---	25	2.9	---	---	---	---	---	---
	05/11/09	---	460	---	---	---	---	---	---	---	---
	08/04/09	---	450	---	---	---	---	---	---	---	---
	01/07/10	---	---	---	---	---	---	---	---	---	5.7
	02/02/10	---	480	---	---	---	---	---	---	---	---
	05/06/10	---	500	---	---	---	---	---	---	---	---
	08/09/10	---	490	---	---	---	---	---	---	---	---
	11/10/10	---	460	---	---	---	---	---	---	---	---
	01/04/11	---	---	---	---	---	---	---	---	---	5.8
	02/02/11	---	480	---	---	---	---	---	---	---	---
	05/04/11	---	470	---	---	---	---	---	---	---	---
	08/04/11	---	480	---	---	---	---	---	---	---	---
	11/02/11	---	460	---	---	---	---	---	---	---	---
	01/17/12	---	---	---	---	---	---	---	---	---	5.5
	02/08/12	---	480	---	---	---	---	---	---	---	---
	05/03/12	---	490	---	---	---	---	---	---	---	---
	08/09/12	---	440	---	---	---	---	---	---	---	---

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-5

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS ON INDIAN RESERVATIONS

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3*	NO3
Pechanga Indian Reservation											
8S/2W-28M03	08/26/99	562	319	38	13	52	0.77	68	15	---	2.59 as N
	08/12/03	534	344	40.7	14.7	53.5	0.86	58.9	14.1	---	4.21 as N
	08/19/04	708	440	61.4	22.5	51	0.93	87.6	52	---	6.16 as N
	08/02/05	746	459	69.7	26.9	44.3	1.01	87.8	61.8	---	5.09 as N
	08/02/06	678	413	55.9	21	42.6	0.85	74.9	43.1	153	8.25 as N
	09/04/07	663	392	53.7	19.5	51.1	0.92	70.1	32.1	158	8.32 as N
8S/2W-28M05	09/01/09	457	253	10.7	0.483	77.7	0.53	65.6	17.4	91	0.08 as N
	07/26/10	---	261	11	0.942	83.3	0.53	78.3	17.1	---	E 0.048
	08/31/11	482	272	10.7	0.999	86.0	0.49	77.8	16.9	88	0.052
8S/2W-28Q02	10/05/89	629	378	48	19	49	0.7	76	14	169	4.2 as N
	07/26/90	613	383	48	18	47	0.6	75	12	171	3.9 as N
	07/18/91	618	379	49	18	49	0.7	83	14	172	3.0 as N
	07/28/93	620	400	51	20	47	0.7	63	15	174	9.6 as N
	08/17/94	641	396	51	21	50	0.8	60	17	179	11.0 as N
	08/31/95	653	396	53	21	48	0.7	60	19	184	12.0 as N
	08/28/96	---	---	---	---	---	---	---	---	---	11.0 as N
	08/12/97	614	411	47	19	47	0.7	63	15	176	8.9 as N
	08/19/98	625	402	47	20	47	0.7	60	14	---	9.85 as N
	08/21/02	598	394	47	19	46	0.7	64	15	---	8.5 as N
	08/12/03	604	405	48.8	19.8	47.8	0.7	69.1	14.0	---	7.1 as N
	08/18/04	615	386	51.6	20.2	45.6	0.9	78.8	16.5	---	4.03 as N
	08/02/05	822	514	76.8	30.2	54	0.8	93.7	30.9	---	14.7 as N
8S/2W-28R01	08/03/89	495	286	41	4.0	60	0.9	37	13	177	1.1 as N
	07/26/90	525	296	48	4.8	54	1.0	45	14	191	1.5 as N
	07/17/91	462	261	31	3.2	66	0.8	44	12	155	.8 as N
	07/27/93	445	269	44	4.4	43	0.5	28	14	170	1.9 as N
	08/15/94	421	232	32	3.3	55	0.9	28	11	156	1.5 as N
	08/30/95	375	200	21	2.2	55	0.6	31	11	129	.7 as N
	08/27/96	---	---	---	---	---	---	---	---	---	1.5 as N
	08/13/97	398	241	20	2.1	59	0.62	37	11	130	.572 as N
	08/20/98	481	282	36	3.9	60	0.85	38	14	167	1.1 as N
	08/25/99	446	252	28	3.1	59	0.66	41	12	---	.758 as N
	08/22/00	456	265	29	3.3	61	0.73	39	14	---	.759 as N
	08/21/01	522	320	51	5.9	48	1.0	42	16	---	1.73 as N
	08/21/02	457	284	33	3.7	61	0.87	41	13	---	1.09 as N
	08/12/03	518	330	55	6.5	50.4	1.1	39.7	14.3	---	1.94 as N
	08/18/04	516	317	56.8	6.2	47.9	1.4	42.6	14.2	---	1.64 as N

* - Alkalinity as CaCO3

E - estimated

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-5

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS ON INDIAN RESERVATIONS

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l								
				Ca	Mg	Na	K	Cl	SO4	HCO3*	NO3	
Pechanga Indian Reservation (Continued)												
8S/2W-28R01 (Cont)	08/03/05	541	333	60.5	6.5	45.3	1.2	40.2	14.1	---	2.23 as N	
	09/10/08	480	278	37.2	4.67	62.4	1.14	41.2	11.4	160	---	
	08/04/09	543	329	50	5.49	55.5	1.12	38.7	18.4	194	1.78 as N	
	07/26/10	564	335	58.3	6.57	49.9	1.12	41.9	18.7	203	9.89	
	08/22/11	548	357	55.0	6.75	52.9	1.07	41.3	18.8	187	10.5	
	08/21/12	507	287	44.7	5.19	60.5	0.95	39.2	17.4	178	8.33	
8S/2W-29A01	08/02/89	346	207	31	11	24	0.4	18	7.0	131	2.0 as N	
	07/24/90	354	193	32	11	25	0.4	24	6.7	133	2.0 as N	
	07/18/91	361	194	32	10	26	0.4	25	6.0	134	1.8 as N	
	08/15/94	363	216	33	12	25	0.5	24	7.7	132	2.6 as N	
	08/31/95	363	208	32	11	23	0.4	21	8.1	137	2.6 as N	
	08/28/96	---	---	---	---	---	---	---	---	---	2.9 as N	
	08/12/97	368	238	32	12	24	0.44	22	7.4	138	3.05 as N	
	08/19/98	411	246	36	11	31	0.45	25	8.2	153	2.94 as N	
	08/25/99	375	222	33	12	23	0.39	20	6.7	---	3.81 as N	
	08/22/00	374	237	33	12	24	0.42	18	7.3	---	3.48 as N	
	08/21/01	374	236	34	12	24	0.46	20	7.3	---	3.56 as N	
	08/02/05	382	243	38.7	11.6	27.1	0.53	27.6	7.7	---	2.79 as N	
	8S/2W-29A02	08/02/06	392	242	36.2	10.9	26.6	0.43	29.4	7.94	139	2.64 as N
		08/04/09	394	245	29.8	11.3	32.2	0.64	34.5	7.38	133	0.81 as N
07/26/10		---	268	37.5	11.9	32.5	0.55	38.5	12.9	---	E 10.8	
08/22/11		434	299	35.9	12.0	35.7	0.59	41.9	12.7	132	9.30	
08/21/12		465	298	42.0	13.2	38.1	0.55	42.4	15.8	148	11.8	
8S/2W-29B02	03/01/90	456	257	5.5	0.14	89	0.8	66	22	100	---	
	03/06/90	456	256	5.9	0.13	90	0.7	66	20	99	<0.1 as N	
8S/2W-29B03	03/06/90	478	275	14	1.9	84	0.8	65	16	123	<0.1 as N	
8S/2W-29B05	03/02/90	397	229	29	9.5	43	1.2	35	4.9	141	1.8 as N	
8S/2W-29B06	03/02/90	406	259	34	11	38	0.8	38	10	143	---	
	03/06/90	427	240	32	11	40	1.0	40	8.1	148	1.2 as N	
8S/2W-29B07	03/07/90	396	230	8.6	2.5	71	0.9	51	11	102	<0.1 as N	
	08/16/90	371	199	8.4	1.8	69	0.8	50	14	106	<0.1 as N	

* - Alkalinity as CaCO3

E - estimated

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-5

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS ON INDIAN RESERVATIONS

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3*	NO3
Pechanga Indian Reservation (Continued)											
8S/2W-29B08	03/07/90	464	272	31	9.4	52	1.2	58	12	134	0.45 as N
	08/16/90	458	261	34	9.1	48	1.1	59	17	135	0.4 as N
8S/2W-29B09	03/07/90	343	210	21	9.2	39	1.0	24	6.7	131	1.3 as N
	08/17/90	317	197	26	10	26	1.1	22	3.4	130	1.6 as N
8S/2W-29B10	08/19/98	367	223	12	0.64	75	0.62	50	10	121	<.05 as N
	08/26/99	393	219	12	0.72	68	0.56	46	11	—	<.05 as N
	08/22/00	393	228	12	0.76	69	0.58	43	11	—	<.05 as N
	08/21/01	398	231	11	0.62	72	0.57	49	15	—	.04 as N
	08/12/03	387	239	11.3	0.65	75.1	0.57	47.2	18.4	—	2.41as N
	08/18/04	390	232	11.2	0.64	72.6	0.64	48	20.8	—	<.06 as N
	08/02/05	404	242	12.5	0.67	69.9	0.65	47.2	23.2	—	<.06 as N
	08/03/06	381	222	12.3	0.77	62.8	0.54	40.3	17.3	110	<.06 as N
	09/04/07	430	237	12.1	0.70	78.3	0.65	47.2	27.5	107	<.06 as N
	09/15/08	420	242	11.2	0.664	77.3	0.59	45.3	29.6	106	E .03 as N
	08/04/09	381	217	12.1	0.76	66	0.64	39.9	23.7	108	E .03 as N
	07/26/10	394	220	11.4	0.67	71.6	0.64	42.2	26	107	E 0.079
	08/22/11	421	265	11.5	0.697	75.5	0.58	45.5	31.0	99	0.115
	08/21/12	432	245	12.8	0.734	82.4	0.62	47.1	34.9	106	<.177
8S/2W-29B11	08/02/06	483	285	30.1	7.84	51.5	0.93	57.1	11.8	138	1.44 as N
	08/04/09	497	281	33	8.51	51	0.98	52.6	16.6	140	2.33 as N
	07/26/10	---	287	34.7	9.09	53.4	1.05	56.8	15.3	---	E 10.3
	08/22/11	482	308	32.7	9.52	53.0	1.00	54.2	16.0	131	10.9
	08/21/12	492	300	35.9	10.0	55.9	1.03	54.3	17.9	142	11.9
8S/2W-29F3	08/03/06	378	251	21.9	7.67	38.9	1.9	47.2	10.4	104	0.46 as N
8S/2W-29J02	08/26/99	565	329	39	15	47	1.6	66	14	---	2.67 as N
	08/22/00	562	337	39	15	47	1.5	65	14	---	2.70 as N
	08/21/01	574	351	40	15	50	1.6	70	15	---	2.63 as N
	08/21/02	554	345	41	16	50	1.8	68	14	---	2.93 as N
	08/12/03	592	372	45.4	16.6	54.2	1.65	78.2	15.4	---	2.41 as N
	08/19/04	598	362	48.8	16.9	---	1.88	80	17	---	3.06 as N
8S/2W-29J03	08/02/06	532	337	40.3	13.2	43.1	1.34	44.8	17.5	152	8.48 as N

* - Alkalinity as CaCO3

E - estimated

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-5

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS ON INDIAN RESERVATIONS

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3*	NO3
Pechanga Indian Reservation (Continued)											
8S/2W-34B04	10/05/89	617	371	51	8.2	67	1	58	30	192	.47 as N
	07/26/90	605	341	50	8	65	1	61	31	194	.50 as N
	07/18/91	564	339	46	7.4	67	1	53	27	185	.87 as N
	07/27/93	267	170	18	2.8	34	0.5	14	9.7	96	1.10 as N
8S/2W-35D01	08/03/89	660	358	43	5.5	87	1.2	78	35	169	.35 as N
	07/26/90	669	384	41	4.9	92	1.5	82	36	176	.40 as N
	07/17/91	641	371	40	4.4	98	1.7	81	36	175	.39 as N
	07/27/93	638	374	49	5.9	79	1.8	71	27	199	.34 as N
	08/16/94	601	334	30	3.2	95	1.5	71	29	163	.16 as N
	08/30/95	587	322	33	4	81	1.5	68	25	178	.11 as N
	08/27/96	596	352	28	3.3	92	1.4	72	29	167	.10 as N

* - Alkalinity as CaCO3

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-5

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS ON INDIAN RESERVATIONS

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3*	NO3
Cahuilla Indian Reservation											
7S/2E14M01	12/14/83	1220	708	130	40	45	11	53	390	98	0.04 as N
7S/2E-23H01	05/18/06	428	288	39.6	5.7	33.7	3.1	31	14	---	8.26 as N
7S/2E-23Q01	05/18/06	245	160	15.6	2.55	26.6	2.5	29.5	5.4	---	1.07 as N
7S/2E-26B03	07/11/07	296	197	23.7	3.04	31	2.94	33.9	7.64	76	1.79 as N
7S/2E-33N1	08/02/89	355	206	16	2.1	53	3.5	48	15	78	.73 as N
7S/2E-36J01	02/03/84	---	252	43	4.4	36	4.8	32	5.4	---	3.40 as N
7S-3E-14P03	08/10/05	1080	741	113	42.4	70	9.7	66.8	296	---	.15 as N
7S-3E-20J05	08/23/07	753	466	49.4	7.09	89.2	3.19	87.9	83.6	110	6.88 as N
7S/3E-21L01	05/27/53	750	---	66	20	70	---	67	76	---	---
	08/02/89	1050	675	90	19	100	3.5	84	190	216	3.1 as N
	08/01/90	1020	610	87	18	100	3.4	85	180	217	3.0 as N
	07/17/91	995	636	93	18	100	3.7	95	180	206	2.5 as N
	08/23/07	1040	677	96.1	20.2	90.9	3.67	96.2	169	190	3.42 as N
7S/3E-31L02	02/03/84	---	184	23	4.8	24	2.9	24	0	---	2.0 as N
7S/3E-31N01	07/27/84	684	412	69	12	37	---	75	12	---	---
7S/3E-34E01	07/07/76	---	---	25	4.6	21	4.2	26	7.3	---	4.0 as N
	09/22/77	---	---	25	4.9	23	4.4	25	6.9	---	---
	07/19/78	---	---	26	5.1	22	4.5	24	6.5	---	3.7 as N
	06/28/79	---	190	26	5	22	4.3	24	6	---	---
	07/02/80	---	---	26	4.9	23	4.7	28	6.9	---	3.7 as N
	07/08/81	309	---	27	5	23	4.7	26	7.7	81	4.1 as N
	06/29/82	311	---	27	5.3	27	4.9	27	10	88	4.0 as N
	08/10/83	306	---	27	5	23	4.8	29	7.7	90	3.8 as N
	08/21/84	319	---	30	5.3	24	4.3	29	7.2	92	3.7 as N
	08/01/85	321	---	28	5.2	24	4.6	29	7.0	86	3.5 as N

* - Alkalinity as CaCO3

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-5

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS ON INDIAN RESERVATIONS

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3*	NO3
Cahuilla Indian Reservation (Continued)											
7S/3E-34E01	08/14/87	332	207	29	5.6	25	4.8	28	8.0	96	3.5 as N
	07/20/89	338	204	30	5.6	26	5.0	29	7.0	98	3.3 as N
	07/31/91	337	109	31	5.5	25	4.5	31	6.3	99	3.5 as N
	07/16/91	335	209	31	5.9	26	4.7	32	6.3	99	3.5 as N
8S/2E-4P01	01/21/86	1870	---	190	54	64	7.9	480	13	136	4.0 as N
	05/18/06	794	441	59.8	19.3	44.1	4.44	101	10.4	---	5.45 as N
8S/3E-2A01	02/05/86	591	---	54	11	43	3.2	93	21	103	3.4 as N
8S/3E-2D01	07/08/81	293	---	17	2.2	39	1.7	30	8.8	68	2.5 as N
	07/24/85	279	---	11	1.2	42	1.5	28	8	71	2.1 as N
8S/3E-2E01	12/07/50	---	---	30	10	53	---	50	14	---	---
	11/15/51	---	---	38	8	43	---	50	6	---	---
	05/27/76	---	---	39	9.4	32	2.2	49	12	---	4.9 as N
	09/22/77	---	280	39	9.6	33	2.6	42	8.4	---	---
	07/19/78	---	---	42	10	36	2.4	57	13	---	5.7 as N
	06/28/79	---	284	40	9	32	2.8	42	9	---	---
	07/02/80	---	---	34	6.5	22	2.4	27	7.4	---	0
	07/08/81	296	---	33	4.8	19	1.9	36	1	61	2.0 as N
	06/29/82	494	---	43	9.7	41	3	54	14	127	5.7 as N
	07/26/83	427	---	40	9.6	32	3	42	9.7	131	4.8 as N
	08/21/84	428	---	42	9.3	32	2.9	39	9.6	129	4.7 as N
	08/13/87	428	276	39	9.4	32	3.2	37	9.6	129	4.6 as N
	08/10/05	424	283	42.4	10.2	33.6	3.4	39.9	9.14	---	4.88 as N
8S/3E-2K01	09/22/77	---	---	43	10	48	3.2	65	18	---	---
	07/19/78	---	---	42	9.8	48	3.4	68	17	---	3.7 as N
	06/28/79	---	342	46	10	46	3.1	69	19	---	---
	07/02/80	---	---	64	12	92	2.7	140	48	---	4.1 as N
	06/29/82	454	---	41	10	38	3.7	46	13	129	3.6 as N
	08/10/83	435	---	39	9.5	32	3.6	43	13	133	3.6 as N
	08/21/84	561	---	50	11	48	3.1	68	27	139	4.0 as N
	08/01/85	472	---	41	9.7	34	3.4	48	15	125	3.7 as N
	08/13/87	451	282	40	9.9	31	3.4	41	16	133	3.6 as N
	07/20/89	531	323	46	11	41	3.4	60	22	136	3.6 as N
	08/01/90	508	310	46	11	38	3.3	60	19	134	3.8 as N
	07/16/91	522	306	50	10	39	3.3	61	21	139	3.7 as N

* - Alkalinity as CaCO3

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-6
SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA
WELLS ON CAMP PENDLETON

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
10S/5W-26C1 (Bldg 220001)	10/60	1060	639	66.5	24.0	116.0	4.5	160	110.0	264.0	trace
	06/62	1190	718	60.0	33.2	123.0	3.8	190	124.0	232.0	1.4
	07/64	1217	734	79.2	27.8	144.0	1.6	180	150.0	248.9	---
	05/65	1485	896	75.2	30.3	158.0	2.4	180	120.0	253.8	0
	01/66	---	808	76.8	33.2	157.0	3.4	170	180.0	292.8	0.62
	06/66	---	684	75.2	26.8	112.0	2.4	128	148.0	263.5	3.9
	01/67	---	856	81.6	26.3	138.0	3.5	162	140.0	310.0	3
	08/67	---	880	99.2	38.1	156.0	3.6	160	230.0	322.1	5.3
	02/68	---	768	65.6	25.4	156.0	3.4	160	164.0	236.7	0
	04/69	---	852	66.0	32.0	162.0	3.2	166	210.0	249.0	0
	11/69	---	844	87.0	31.0	140.0	3.6	164	180.0	262.0	0
	07/70	---	672	99.0	32.0	139.0	3.0	158	205.0	259.0	2.7
	12/70	1180	712	83.0	28.0	138.0	3.0	166	170.0	266.0	0
	09/71	1062	640	83.0	27.0	128.0	2.8	136	175.0	278.0	0.4
	05/72	1130	681	56.0	24.0	140.0	2.8	136	165.0	220.0	0
	10/72	1165	703	64.0	27.0	159.0	3.6	132	180.0	293.0	1.8
	10/73	1140	688	72.0	27.0	131.0	3.8	144	190.0	200.0	0.3 as N
	02/76	1140	688	70.4	28.3	143.0	3.1	132	182.0	273.3	1.8 as N
	09/76	1100	663	67.0	25.0	152.0	2.5	152	131.0	327.0	2.8 as N
	03/77	1080	651	67.0	28.0	173.0	3.1	128	160.0	254.0	4.4 as N
	10/78	1150	694	70.0	25.0	120.0	3.5	139	145.0	253.8	<1 as N
	06/79	1100	663	72.0	27.3	125.0	3.0	134	142.0	258.6	<1 as N
	10/80	1200	693	78.8	23.7	136.0	3.3	172	136.0	273.3	0.2 as N
	04/81	1160	737	82.4	22.4	126.0	3.6	140	134.0	268.4	<0.5 as N
	11/81	1300	863	97.6	31.5	169.0	2.2	204	209.0	248.9	0.8 as N
	11/81	950	573	74.0	18.3	120.0	2.1	144	130.0	224.5	0.3 as N
	05/82	1100	663	80.8	26.6	140.0	1.5	181	138.0	268.4	<0.5 as N
	03/83	1000	603	84.0	20.5	144.0	3.2	152	143.0	273.3	<0.5 as N
	05/84	1150	694	80.0	27.6	126.0	3.1	133	150.0	283.0	0.2 as N
	06/85	1100	680	89.0	26.0	140.0	3.0	150	64.0	440.0	<0.4
	09/85	1242	724	78.0	28.0	122.0	6.0	154	149.1	244.4	<0.4
	05/86	1387	750	85.2	29.1	130.7	4.3	166	130.8	242.6	<1
	06/89	1302	734	78.1	23.0	85.9	---	136	145.0	212.0	<0.4
	01/91	1271	---	81.0	36.1	152.0	---	166	---	---	<0.04
	06/91	1290	752	99.0	32.4	133.0	---	167	136.0	237.0	<0.4
	03/92	1210	792	91.0	29.8	146.0	---	159	135.0	279.0	<0.4
	06/93	1290	764	68.3	27.5	149.0	---	168	130.0	265.0	<0.4
	03/94	1210	783	100.0	37.1	100.0	---	145	167.0	---	2.2
	08/94	1160	741	87.5	35.5	96.1	---	141	187.0	---	4.23
	06/95	1330	806	97.7	37.4	142.0	---	207	166.0	---	<0.04
	01/96	1300	764	91.0	33.0	140.0	---	177	142.0	363.0	---
	06/96	1300	751	93.0	30.0	130.0	---	164	156.0	252.0	---
	06/97	1215	758	88.0	29.0	130.0	<2.0	151	148.0	292.0	<2 as N
	12/97	1200	690	81.0	29.0	140.0	3.0	155	150.0	250.0	ND
	04/98	1200	790	83.0	31.0	101.0	3.0	165	156.0	240.0	ND
	06/98	1230	714	85.0	30.0	136.0	3.0	163	158.0	293.0	ND
	02/99	1250	731	84.0	29.0	127.0	3.0	160	140.0	281.0	ND
	04/99	1220	769	88.0	30.0	127.0	3.0	168	160.0	317.0	ND
	05/01	1300	794	98.0	36.0	130.0	3.0	173	179.0	317.0	ND

ND - None Detected

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-6
SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA
WELLS ON CAMP PENDLETON

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
10S/5W-18M5 (Bldg 23073) (Previously reported as 10S/4W-18M4)	06/89	1156	688	74.6	24.4	67.9	---	130	138.0	197.0	8.9
	01/90	1120	630	86.4	32.3	101.0	---	156	166.0	210.0	<0.05
	04/90	1160	720	98.8	34.8	107.0	---	152	146.0	218.0	1.4
	01/91	1202	---	84.1	40.5	117.0	---	162	153.0	---	<0.04
	06/91	1180	736	102.0	37.1	106.0	---	163	138.0	197.0	<0.4
	03/94	1020	658	69.6	27.8	104.0	---	135	140.0	---	0.89
	08/94	1110	684	81.4	32.2	178.0	---	144	157.0	---	<0.44
	06/95	1170	679	95.3	35.2	113.0	---	145	116.0	---	13.8
	06/96	1100	682	86.0	32.0	95.0	---	155	261.0	210.0	<0.0
	02/97	1180	640	79.0	32.0	110.0	---	142	162.0	190.0	<2 as N
	06/97	1117	709	85.0	33.0	110.0	<5.0	150	164.0	223.0	<2 as N
	12/97	1100	700	82.0	33.0	110.0	3.0	141	157.0	220.0	ND
	03/98	1100	710	83.0	33.0	100.0	3.0	182	158.0	150.0	ND
	06/98	1200	720	85.0	34.0	119.0	4.0	159	154.0	281.0	ND
	02/99	1020	613	70.0	30.0	85.0	4.0	130	85.0	179.0	8
	05/00	1020	709	81.0	33.0	94.0	4.0	146	149.0	220.0	ND
	08/00	1160	728	83.0	33.0	89.0	4.0	161	178.0	232.0	ND
	02/01	1200	736	85.0	35.0	116.0	4.0	164	180.0	244.0	0.7
	04/01	1200	606	85.0	34.0	112.0	4.0	154	177.0	232.0	ND
	09/01	1250	761	90.0	37.0	115.0	4.0	166	188.0	232.0	ND
	11/01	1290	737	91.0	37.0	118.0	3.0	181	207.0	256.0	0
	02/02	1260	781	89.0	36.0	123.0	4.6	170	189.0	255.0	1.3
	04/02	1250	755	90.0	37.0	116.0	4.1	175	195.0	200.0	1
	05/02	1290	750	92.0	38.0	110.0	4.0	157	194.0	180.0	0.6
	07/02	1260	753	90.0	37.0	114.0	4.0	171	196.0	200.0	0
	01/03	1350	816	96.0	40.0	131.0	4.6	160	201.0	193.0	0
	04/03	1210	738	95.0	27.0	118.0	3.9	175	210.0	192.0	0
	10/03	1290	752	91.0	37.0	134.0	5.0	167	193.0	199.0	0
	01/04	1230	717	93.0	38.0	111.0	6.0	159	194.0	173.0	0
	04/04	1280	722	82.0	36.0	112.0	6.0	168	213.0	180.0	2.2
	07/04	1080	739	88.0	37.0	92.0	7.0	156	198.0	190.0	0
	11/04	1230	563	91.0	38.0	124.0	4.8	172	215.0	175.0	0
	01/05	1240	687	96.0	39.0	124.0	4.0	172	215.0	190.0	0
	04/07	1240	770	98.0	40.0	100.0	3.8	160	220.0	240.0	0
	04/08	1370	908	100	42	110	3.7	180	240	234	<2
	04/09	1300	800	97	39	120	3.7	140	200	220	8.7
	8/11/10	1300	780	97	39	110	3.6	180	220	220	<2
	4/22/11	1300	810	90	37	110	3.6	170	230	220	<2
	4/20/12	1200	810	94	38	120	3.8	160	220	240	2.0

ND - None Detected

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-6
SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS ON CAMP PENDLETON

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
10S/5W-23J1 (Bldg 23001)	05/56	1090	685	61.5	24.3	142.0	---	142	110.0	293.0	0.06
	12/56	1060	666	67.0	27.0	96.0	---	124	85.0	274.0	---
	12/57	---	780	66.3	23.9	159.0	---	138	155.0	308.0	10.6
	05/59	1100	691	75.2	25.3	112.0	---	136	152.0	297.7	---
	01/60	1120	704	72.7	27.3	116.5	---	112	144.0	291.0	---
	10/60	1045	657	63.2	21.4	99.0	3.6	140	112.0	242.0	0
	05/61	1280	770	76.0	36.5	136.0	3.0	124	195.0	299.6	0
	05/62	1133	712	68.8	30.3	136.0	2.0	128	175.0	275.7	---
	01/63	1111	698	72.0	35.1	127.0	2.8	128	199.0	268.4	---
	06/63	1108	696	78.4	25.4	118.0	2.9	148	130.0	258.6	0 as N
	07/64	1165	732	74.4	27.8	128.0	1.2	139	160.0	268.4	---
	05/65	1130	710	80.0	26.4	145.0	2.1	148	120.0	268.4	0.14
	01/66	---	736	88.0	18.1	142.0	2.8	124	155.0	263.5	1.8
	06/66	---	736	75.2	29.3	138.0	2.7	145	175.0	295.2	4.8
	01/67	---	744	76.8	25.9	118.0	3.0	136	125.0	287.9	2.2
	08/67	---	680	70.4	28.3	128.0	2.3	140	100.0	292.8	8.4
	02/68	---	660	48.0	19.5	130.0	2.8	124	119.0	234.0	6.1
	04/69	---	708	70.0	28.0	126.0	2.5	128	170.0	278.0	0
	11/69	---	684	73.0	28.0	126.0	2.8	138	165.0	273.0	0
	05/70	---	716	74.0	25.0	122.0	0.1	134	170.0	210.0	4.4
	12/70	1090	385	78.0	25.0	126.0	2.6	142	170.0	250.0	3.1
	09/71	1025	644	75.0	38.0	120.0	2.7	124	190.0	229.0	0.9
	05/72	1050	660	75.0	21.0	124.0	2.3	124	155.0	244.0	2.2
	10/73	1140	716	74.0	22.0	128.0	2.8	136	160.0	220.0	0.5 as N
	06/74	1060	680	74.0	13.0	131.0	2.9	158	138.0	220.0	0.01 as N
	02/76	1050	660	73.6	25.4	136.0	2.9	119	170.0	248.9	2.0 as N
	09/76	1100	691	58.0	32.0	146.0	2.6	140	148.0	321.8	2.6 as N
	03/77	1080	679	69.0	29.0	110.0	3.0	128	155.0	259.0	4.3 as N
	01/78	1100	691	70.0	23.0	147.0	3.0	140	135.0	259.0	4.4 as N
	10/78	1150	723	74.0	22.0	120.0	2.9	134	149.0	248.9	<1 as N
	04/79	1000	628	70.4	22.4	118.0	2.6	122	138.0	239.1	<1 as N
	10/80	1150	745	74.0	22.5	128.0	3.0	152	138.0	239.1	0.2 as N
	05/81	1020	580	67.2	17.3	116.0	3.1	132	111.0	205.0	<0.5 as N
	03/83	900	599	65.6	19.5	129.0	2.8	136	129.0	234.2	<0.5 as N
	12/83	1000	628	72.4	22.4	127.0	2.6	140	150.0	249.0	<0.1 as N
	05/84	1100	691	78.8	25.9	120.0	2.8	130	150.0	254.0	0.2 as N
	06/85	1100	691	59.0	26.0	130.0	3.0	140	70.0	440.0	3.5
	09/85	1203	705	66.0	26.0	110.0	6.0	150	144.0	226.6	<0.4
	06/89	1139	662	71.5	21.7	80.8	---	117	128.0	209.0	<0.4
	01/90	1150	632	90.6	32.4	102.0	---	160	170.0	214.0	<0.5
	01/91	1112	---	73.7	32.0	128.0	---	136	136.0	---	<0.04
	06/91	1090	662	87.4	29.7	117.0	---	140	121.0	204.0	<0.4
	03/92	1080	644	74.2	25.8	133.0	---	127	118.0	282.0	1.3
	03/93	1210	674	72.8	24.5	117.0	---	127	124.0	261.0	<0.4
	06/93	1090	670	63.9	25.7	119.0	---	117	128.0	237.0	<0.4
	03/94	1120	683	73.9	27.0	121.0	---	141	130.0	---	<0.4

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-6
SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS ON CAMP PENDLETON

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
10S/5W-23J1 (Bldg 23001) (Cont)	08/94	1160	707	78.9	28.2	129.0	—	139	153.0	—	<0.44
	06/95	1160	742	88.2	28.8	131.0	—	165	147.0	—	<0.04
	01/96	1300	690	79.0	29.0	140.0	—	147	131.0	292.0	—
	06/96	1020	674	82.0	29.0	120.0	—	134	129.0	204.0	—
	02/97	1100	650	74.0	27.0	150.0	—	126	172.0	245.0	<2 as N
	03/97	1073	630	77.0	28.0	130.0	—	142	134.0	254.0	<2 as N
	02/99	1180	647	75.0	27.0	125.0	3.0	150	130.0	272.0	ND
	04/99	1240	722	81.0	30.0	124.0	3.0	157	150.0	293.0	ND
	08/99	1180	735	79.0	29.0	120.0	3.0	190	183.0	281.0	ND
	12/99	1190	699	83.0	30.0	118.0	3.0	100	158.0	278.0	ND
	02/00	1110	723	81.0	30.0	116.0	3.0	90	163.0	293.0	ND
	05/00	1070	714	81.0	29.0	115.0	3.0	170	152.0	273.0	ND
	08/00	1200	735	80.0	29.0	117.0	3.0	150	118.0	275.0	ND
	02/01	1230	730	84.0	31.0	132.0	—	158	158.0	293.0	ND
	04/01	1190	636	81.0	30.0	123.0	3.0	146	148.0	287.0	ND
	09/01	1300	751	88.0	32.0	132.0	3.0	155	160.0	293.0	ND
	10/01	1380	757	88.0	33.0	133.0	3.0	152	159.0	311.0	ND
	02/02	1220	724	86.0	31.0	124.0	2.6	146	156.0	293.0	ND
	04/02	1210	726	89.0	32.0	124.0	2.8	151	162.0	240.0	—
	07/02	1280	735	85.0	31.0	129.0	3.1	155	165.0	236.0	ND
	10/02	1300	701	87.0	31.0	141.0	2.9	157	170.0	257.0	ND
	01/03	1260	760	88.0	32.0	139.0	3.5	146	162.0	239.0	ND
	02/03	—	—	68.0	32.0	139.0	3.5	—	—	—	—
	04/03	1200	708	87.0	32.0	127.0	2.8	158	175.0	245.0	ND
	10/03	1210	696	82.0	30.0	144.0	3.0	167	177.0	232.0	0 as N
	01/04	1170	678	87.0	31.0	121.0	4.0	151	175.0	227.0	0 as N
	04/04	1270	697	82.0	31.0	120.0	4.0	155	171.0	250.0	0 as N
	07/04	1030	702	87.0	31.0	98.0	5.0	138	151.0	245.0	0 as N
	10/04	1230	879	89.0	31.0	102.0	5.0	158	176.0	—	0 as N
	02/05	1170	704	88.0	31.0	134.0	3.1	157	171.0	235.0	0 as N
	04/05	1220	755	88.0	30.0	121.0	2.7	132	167.0	213.0	0 as N
	07/05	1190	725	83.0	29.0	117.0	2.8	153	—	206.0	0 as N
	04/07	1200	708	89.0	32.0	120.0	2.6	150	170.0	270.0	0
	04/08	1210	718	90	32	100	2.5	150	170	274	<2
	04/09	1200	720	90	32	110	2.6	130	160	250	<2
	04/14/10	1200	740	92	33	120	2.6	150	180	260	<2
	04/22/11	1200	770	90	32	110	2.6	160	190	260	<2
	04/20/12	1200	790	96	34	120	2.9	160	190	250	<2
10S/4W-18E3 (Bldg 230093)	06/89	1166	758	80.5	28.1	67.4	—	132	157	198.0	9.5
	01/90	1230	748	97.4	39.7	106.0	—	178	179	226.0	<0.05
	04/90	1190	733	99.6	37.5	112.0	—	159	156	207.0	2.5
	06/91	1130	680	97.6	37.6	100.0	—	139	142	166.0	2.7
	02/94	1180	731	83.3	35.5	104.0	—	142	159	—	11.1
	08/94	1150	725	84.3	35.2	102.0	—	147	164	—	1
	06/95	932	636	75.4	29.1	86.6	—	102	140	—	14

ND - None Detected

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-6
SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS ON CAMP PENDLETON

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
10S/4W-18E3 (Bldg 230093) (Cont)	06/96	1117	710	92.0	36.0	93.0	---	180	297	206.0	---
	02/97	1100	686	89.0	38.0	110.0	---	157	166	220.0	<2 as N
	03/97	1116	673	87.0	36.0	110.0	---	147	113	213.0	<2 as N
	06/97	1131	779	90.0	37.0	99.0	<5.0	151	177	199.0	<2 as N
	09/98	1160	727	83.0	36.0	90.0	3.0	160	181	232.0	ND
	10/99	1200	325	88.0	39.0	117.0	4.0	130	180	268.0	ND
	02/00	1100	739	84.0	37.0	100.0	4.0	130	180	281.0	ND
	05/00	1030	717	80.0	35.0	96.0	4.0	168	183	229.0	2
	02/01	1360	798	97.0	44.0	111.0	4.0	184	212	244.0	ND
	04/01	1310	728	94.0	42.0	114.0	4.0	168	208	232.0	ND
	09/01	1330	791	96.0	42.0	115.0	4.0	173	209	224.0	1
	03/02	1320	778	102.0	44.0	123.0	4.4	196	229	242.0	1
	04/02	1300	808	101.0	44.0	117.0	4.0	183	220	200.0	1.1
	07/02	1390	778	96.0	42.0	114.0	3.7	180	214	209.0	ND
	10/02	1360	763	97.0	41.0	126.0	4.0	180	207	214.0	ND
	01/03	1290	749	96.0	40.0	116.0	3.7	172	200	200.0	ND
	04/03	1210	783	99.0	42.0	129.0	3.9	176	229	191.0	1.3
	10/03	1320	775	97.0	41.0	126.0	5.0	168	231	174.0	0
	01/04	1270	763	101.0	42.0	106.0	6.0	162	220	180.0	0
	04/04	1320	781	96.0	43.0	105.0	6.0	179	250	195.0	0
	07/04	1370	784	100.0	43.0	89.0	6.0	169	219	203.0	0
	10/04	1300	857	99.0	42.0	88.0	6.0	188	245	210.0	0
	01/05	1270	760	99.0	42.0	115.0	4.3	170	234	185.0	2.7
	07/05	1120	724	89.0	36.0	91.0	3.5	133	---	203.0	0 as N
	11/05	1230	815	101.0	40.0	113.0	4.1	153	213	174.0	0 as N
	04/06	1350	832	110.0	44.0	120.0	3.8	180	250	220.0	0 as N
	04/07	1298	806	100.0	45.0	110.0	3.7	180	247	230.0	0
	04/08	1270	816	92	40	100	3.4	150	220	202	4.7
	04/09	1300	840	100	43	120	3.8	150	220	230	<2
	04/28/10	1200	700	83	36	99	3.4	140	200	190	2.8
	07/27/11	1200	810	88	39	98	3.4	160	230	190	4.3
	04/25/12	1200	830	95	42	100	4.0	170	240	190	<2
10S/4W-7R2 (Bldg 260003)	06/89	1281	765	76.5	25.1	82.4	---	149	153	209.0	10.3
	04/89	1270	788	104.0	36.5	126.0	---	173	161	215.0	2.6
	06/91	1400	836	111.0	41.1	130.0	---	195	155	215.0	0.04
	02/94	1260	738	83.3	32.0	131.0	---	169	155	---	<0.04
	08/94	1260	738	84.3	33.7	129.0	---	166	149	---	<0.44
	06/95	1290	897	93.6	35.2	129.0	---	202	164	---	0.69
	02/97	1200	720	84	36	130	---	150	152	240	<1 as N
	03/97	1143	708	83	35	130	---	152	137	240	<2 as N
	06/97	1227	831	94	34	120	<5.0	185	147	247	<2 as N
	12/97	1200	700	84	36	120	3.0	150	173	240	ND
	12/97	1200	700	84	36	120	3.0	150	173	240	ND
	03/98	1200	780	85	36	110	3.0	187	162	180	ND
	06/98	1190	734	83	35	110	3.0	160	167	275	ND
	02/99	1160	663	76	32	102	3.0	150	150	214	ND

ND - None Detected

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-6
SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA
WELLS ON CAMP PENDLETON

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
10S/4W-7R2 (Bldg 260003) (Cont)	08/99	1120	727	76	33	99	3.0	156	230	281	ND
	10/99	1130	660	78	33	120	3.0	110	160	262	ND
	02/00	1030	592	79	35	96	3.0	120	160	244	ND
	05/00	1010	699	76	33	96	3.0	129	127	229	ND
	08/00	1140	720	77	33	87	3.0	---	157	232	ND
	12/02	1120	617	73	32	102	3.6	132	164	174	0.4
	01/03	1150	689	76	34	113	3.6	135	165	185	ND
	04/03	1190	717	82	37	122	4.0	164	182	209	ND
	05/03	1190	---	---	---	---	---	156	182	---	---
	10/03	1250	737	81	37	130	5.0	163	201	192	0
	01/04	1240	694	86	39	107	6.0	153	182	185	0
	04/04	1320	750	84	40	108	6.0	170	210	220	0
	07/04	1100	761	92	41	88	7.0	172	204	205	0
	10/04	1280	893	93	41	88	6.0	179	222	---	0
	02/05	1270	839	99	44	121	5.2	180	215	198	0
	04/05	1300	880	98	41	109	3.8	158	216	183	0 as N
	07/05	1380	870	101	43	109	4.0	430	540	176	0 as N
	11/05	1310	865	104	43	115	3.8	164	221	181	0 as N
	04/06	1220	810	100	43	110	3.8	170	240	206	0 as N
	04/07	1400	856	99	44	110	3.6	170	250	210	0
	04/08	1290	888	91	39	100	3.4	160	230	207	2.6
10S/4W-7R3 (Bldg 260002)	04/09	1300	830	100	45	110	4.5	170	240	220	<2
	04/13/10	1300	800	100	43	100	3.6	160	240	200	<2
	04/13/11	1300	870	96	42	98	3.7	160	240	200	<2
	04/25/12	1300	860	100	44	110	3.6	170	260	200	<2
10S/4W-7H2 (Bldg 260071)	08/56	1060	882	78.0	30.0	112.0	---	150	82	326.0	---
	01/60	820	500	55.2	14.7	85.0	---	76	98	224.0	---
	10/60	1300	793	74.5	20.5	126.0	4.3	182	116	320.0	---
	05/61	1390	840	100.0	29.2	170.0	3.3	170	135	362.0	---
	05/62	1220	744	70.4	39.0	142.0	2.4	184	86	312.3	---
	01/63	1300	740	65.6	26.4	162.0	2.4	166	153	259.0	0.7
	07/63	1100	671	64.0	25.4	118.0	2.7	148	97	280.6	0.0 as N
	01/64	1020	622	70.4	33.2	117.0	2.7	172	98	302.6	3.3
	07/64	1400	854	83.2	27.3	134.0	1.4	164	98	322.1	---
	04/65	1490	909	97.6	23.4	152.0	4.7	196	110	346.5	0.9
	01/66	---	832	102.0	28.0	166.0	3.1	194	88	414.8	6.6
	06/66	---	768	86.4	26.3	150.0	3.1	184	110	331.8	6.9
	01/67	---	768	72.0	29.3	128.0	3.1	174	72	324.5	6.9
	08/67	---	608	57.6	24.4	116.0	2.4	132	70	251.3	10.2
	02/68	---	572	67.2	17.6	105.0	2.4	118	94	251.0	0
	09/68	---	636	74.0	19.0	112.0	3.0	144	96	268.0	0.4
	04/69	---	820	72.0	33.0	138.0	2.8	180	140	285.0	0.9
	11/69	---	604	66.0	24.0	116.0	2.8	140	110	259.0	1.8
	05/70	---	640	65.0	26.0	115.0	2.4	142	120	183.0	3.1
	09/71	1075	656	77.0	24.0	120.0	2.8	144	125	273.0	1.3

ND - None Detected

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-6
SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS ON CAMP PENDLETON

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
10S/4W-7H2 (Bldg 260071) (Cont)	05/72	1000	610	46.0	24.0	117.0	2.4	140	130	141.0	0
	10/72	1110	677	88.0	26.0	105.0	3.6	144	126	283.0	3.5
	10/73	1120	683	75.0	23.0	118.0	2.7	132	130	200.0	0.6 as N
	06/74	1210	712	72.0	19.0	150.0	3.1	208	112	195.0	0.01 as N
	01/75	850	519	61.0	21.0	93.0	2.4	102	95	212.0	2.3 as N
	02/76	1200	732	91.2	20.5	126.0	3.2	176	130	244.0	2.6 as N
	09/76	1200	732	48.0	29.0	180.0	2.4	192	123	336.7	4.2 as N
	03/77	1400	854	94.0	33.0	158.0	2.8	216	140	342.0	2.8 as N
	01/78	1000	610	66.0	23.0	100.0	2.7	128	123	205.0	4.4 as N
	10/78	1300	793	82.0	31.0	134.0	2.7	160	157	258.6	<1 as N
	04/79	1200	732	84.8	28.3	144.0	3.1	164	116	312.3	<1 as N
	01/80	1450	885	93.0	30.0	163.0	3.0	196	200	273.0	<1 as N
	10/80	1050	591	70.4	21.7	104.0	3.7	140	125	219.6	2.0 as N
	05/81	1000	645	72.4	21.7	105.0	3.5	128	123	209.8	<0.5 as N
	05/82	1330	811	100.8	35.9	176.0	1.6	269	198	263.5	<0.5 as N
	03/83	890	669	77.2	23.7	95.0	3.4	132	136	209.8	0.65 as N
	12/83	1000	610	70.4	23.7	123.0	2.6	136	150	224.0	0.5 as N
	05/84	1100	671	77.2	24.6	116.0	2.7	133	155	244.0	0.2 as N
	09/84	1300	650	6.6	29.0	120.0	2.6	200	170	250.0	12
	11/84	1100	671	81.6	23.4	124.0	2.7	149	175	249.0	1.2 as N
	05/86	1592	994	104.7	39.7	167.3	4.4	232	167	301.8	<1 as N
	06/89	1137	826	79.1	28.5	85.5	---	157	158	246.0	12.6
	01/90	1290	772	96.3	38.6	116.0	---	184	179	252.0	0.9/1.2
	04/90	1320	817	109.0	42.1	128.0	---	177	167	249.0	5.4
	01/91	401	---	87.3	44.4	103.1	---	205	179	---	1.1
	03/93	1500	824	92.6	33.1	136.0	---	194	154	277.0	1.8
	03/94	1370	827	103.0	36.4	135.0	---	163	145	---	0.9
	08/94	1270	762	91.1	35.5	129.0	---	162	172	---	5.64
	06/95	1260	771	100.0	35.8	127.0	---	197	178	---	2.8
	06/96	1300	751	96.0	36.0	120.0	---	162	174	247.0	1.1
	02/97	1300	830	100.0	41.0	150.0	---	186	161	186.0	<2 as N
	06/97	1323	831	94.0	36.0	140.0	<5.0	158	149	271.0	2 as N
	12/97	1200	670	91.0	36.0	120.0	3.0	150	169	220.0	ND
	12/97	1200	710	87.0	35.0	120.0	2.0	152	182	220.0	1.5
	03/98	1200	810	89.0	36.0	120.0	3.0	201	168	240.0	ND
	06/98	1390	830	91.0	36.0	140.0	2.0	185	150	366.0	ND
	02/99	1130	663	75.0	31.0	106.0	3.0	150	150	238.0	5
	05/99	1170	711	75.0	32.0	85.0	4.0	---	180	268.0	ND
	08/99	1040	692	74.0	30.0	94.0	2.0	100	400	207.0	ND
	10/99	1210	757	86.0	35.0	120.0	3.0	154	100	295.0	3
	08/00	1290	766	83.0	33.0	89.0	2.0	184	150	323.0	ND
	02/01	1140	707	85.0	35.0	107.0	2.0	152	179	232.0	4.9
	04/01	1190	718	88.0	37.0	112.0	3.0	153	193	218.0	5
	09/01	1200	729	89.0	38.0	106.0	3.0	158	192	201.0	4.6
	11/01	1210	693	90.0	38.0	106.0	3.0	169	209	214.0	5.4

ND - None Detected

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-6
SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA
WELLS ON CAMP PENDLETON

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
10S/4W-7H2 (Bldg 260071) (Cont)	02/02	1190	726	94.0	39.0	106.0	2.7	147	184	218.0	5.9
	04/02	1190	724	91.0	38.0	107.0	2.9	153	204	173.0	6.6
	07/02	1200	755	88.0	37.0	107.0	3.1	162	201	180.0	6
	10/02	1250	722	91.0	38.0	99.0	2.6	150	197	177	6.2
	01/03	1260	781	95.0	39.0	119.0	3.2	144	204	169	4.5
	04/03	1310	776	93.0	38.0	125.0	3.0	178	217	185	4.1
	04/04	1660	890	112.0	47.0	143.0	4.0	208	162	370	ND
	07/04	1460	785	98.0	38.0	109.0	4.0	186	191	275	3.4
	05/06	1380	870	100.0	41.0	110.0	2.3	180	240	210	3.0
	04/07	1300	812	99.0	41.0	110.0	2.5	160	230	220	5.2
	04/09	1300	830	100	43	110	2.9	170	260	190	4.7
	04/22/10	1300	790	100	42	110	2.7	170	230	210	4.2
	04/20/11	1400	860	97	42	110	3.2	180	250	210	2.4
	04/20/12	1200	840	93	40	110	3.3	160	220	200	5.1
10S/4W-7A2 (Bldg 260073)	05/56	920	651	59.0	22.0	100.0	---	104	94	213.0	---
	05/59	---	745	52.8	16.5	60.3	---	84	41	207.4	---
	01/60	---	840	51.2	17.6	95.0	---	98	92	210.0	---
	10/60	870	566	62.0	23.0	80.0	4.2	110	104	234.0	0
	05/61	1180	710	72.0	34.0	114.0	3.3	104	150	227.0	---
	05/62	797	518	63.2	23.4	75.0	2.0	100	96	214.7	---
	01/63	1195	730	64.0	24.9	157.0	3.1	162	183	220.0	0
	07/63	574	610	57.6	19.5	85.0	2.7	102	100	244.0	0.3 as N
	01/64	760	494	59.2	19.3	82.0	3.3	100	85	253.7	0.5 as N
	07/64	980	637	64.0	21.5	94.0	1.4	100	95	241.6	---
	04/65	1230	800	73.3	22.5	106.0	4.5	120	110	248.9	1.3
	01/66	---	448	---	---	86.0	2.5	82	75	190.3	9.7
	06/66	---	540	60.8	21.0	81.0	2.5	102	95	222.0	9.1
	01/67	---	544	60.8	19.5	88.0	2.9	106	69	229.4	6.9
	08/67	---	504	54.4	20.0	79.0	2.1	96	58	214.7	8
	02/68	---	456	60.8	17.6	86.0	2.7	94	78	222.0	0
	09/68	---	600	67.0	18.0	90.0	3.0	110	96	232.0	0
	04/69	---	428	46.0	18.0	73.0	---	76	90	183.0	3.1
	11/69	---	476	59.0	18.0	88.0	2.7	98	110	198.0	0.9
	05/70	---	416	54.0	18.0	79.0	2.6	92	90	151.0	2.9
	12/70	780	507	64.0	16.0	89.0	2.7	100	90	222.0	10.1
	05/72	990	644	77.0	24.0	86.0	2.8	116	135	207.0	0
	10/72	965	627	77.0	27.0	94.0	2.9	104	145	239.0	5.3
	10/73	960	624	72.0	19.0	105.0	2.8	112	140	195.0	0.9 as N
	06/74	950	548	68.0	19.0	101.0	3.1	138	102	207.0	0.35 as N
	01/75	840	546	58.0	22.0	87.0	2.7	98	95	217.0	2.2 as N
	02/76	820	533	68.8	20.5	76.0	3.0	106	88	214.7	2.2 as N
	09/76	900	585	48.0	45.0	98.0	2.3	116	112	258.6	3.0 as N
	03/77	900	585	70.0	23.0	76.0	2.8	123	113	195.0	2.6 as N
	01/78	950	618	64.0	24.0	100.0	2.7	124	108	200.0	4.3 as N
	10/78	1050	683	74.0	20.0	80.0	3.0	113	128	205.0	<1 as N
	04/79	950	618	65.6	19.5	98.0	3.1	109	118	190.3	<1 as N

ND - None Detected

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-6
SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS ON CAMP PENDLETON

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
10S/4W-7A2 (Bldg 260073) (Cont)	01/80	1000	650	67.0	23.0	99.0	3.1	128	111	187.0	<1 as N
	10/80	900	546	67.2	20.5	86.0	3.4	108	86	205.0	2.3 as N
	05/81	810	585	57.2	14.4	83.0	3.4	92	84	180.6	0.7 as N
	11/81	800	451	57.2	16.3	85.0	2.0	92	110	185.4	0.5 as N
	05/82	930	605	68.8	21.5	97.0	1.6	115	96	205.0	<0.5 as N
	03/83	900	663	78.8	23.7	95.0	3.4	132	135	209.8	0.7 as N
	09/84	1000	530	51.0	23.0	80.0	2.9	110	110	200.0	4.2
	11/84	850	553	67.2	28.3	73.0	2.9	111	137	190.0	1.7 as N
	09/85	1007	593	66.0	26.0	64.0	5.8	124	139	180.6	6
	05/86	1051	623	72.6	26.5	79.5	3.5	131	124	153.6	8.8
	06/89	1073	688	72.1	23.9	59.6	---	120	140	184	15.9
	01/89	1080	572	91.2	34.2	80.2	---	151	178	174	1.4
	04/90	1130	718	111.0	42.1	91.0	---	148	167	175	9.1
	06/91	1190	718	113.0	40.3	93.8	---	173	180	160	7.5
	03/93	1370	708	86.9	32.8	93.3	---	147	93.3	200	4.9
	03/94	1210	783	100.0	37.1	100.0	---	145	167	---	2.2
	08/94	1160	741	87.5	35.5	96.1	---	141	184	---	4.23
	06/95	1200	788	99.4	37.5	101.0	---	173	200	---	2.9
	06/96	1129	739	91.0	37.0	90.0	---	188	312	206	---
	02/97	1100	690	82.0	35.0	140.0	---	127	131	180	<2 as N
	03/97	1109	695	91.0	39.0	93.0	---	137	191	166	2.2 as N
	06/97	1096	749	89.0	36.0	90.0	<5.0	138	178	187	2 as N
	12/97	1100	690	84.0	36.0	83.0	4.0	140	181	160	<2 as N
	05/99	1050	648	78.0	32.0	111.0	3.0	171	---	207	ND
	08/99	1040	696	78.0	33.0	84.0	4.0	120	390	146	ND
	10/99	1070	663	78.0	34.0	90.0	4.0	132	120	195	6 as N
	02/00	1010	559	83.0	36.0	82.0	4.0	140	190	220	4 as N
	05/00	972	688	80.0	34.0	79.0	4.0	144	167	190	4 as N
	02/01	1200	753	92.0	40.0	100.0	3.0	164	212	195	ND
	04/01	1210	736	91.0	40.0	103.0	5.0	159	217	183	4.2
	09/01	1200	741	93.0	41.0	98.0	4.0	153	202	183	7.6
	11/01	1220	750	92.0	41.0	106.0	4.0	170	228	189	8.0
	02/02	1230	769	99.0	43.0	101.0	4.2	173	218	195	7.9
	04/02	1260	793	101.0	45.0	102.0	4.5	170	229	160	8.5
	07/02	1350	784	98.0	43.0	103.0	4.3	183	239	159	4.8
	10/02	1370	788	102.0	45.0	104.0	4.3	175	241	167	3.4
	01/03	1330	825	108.0	45.0	121.0	5.4	180	231	168	2.4
	04/03	1260	721	90.0	40.0	102.0	4.3	170	228	153	9.9
	10/03	1340	791	94.0	41.0	121.0	6.0	180	268	144	3
	01/04	1390	800	99.0	46.0	105.0	7.0	173	264	136	4.1
	04/04	1270	739	86.0	42.0	98.0	6.0	160	252	160	5.1
	07/04	1390	764	97.0	45.0	87.0	7.0	176	262	163	3.7
	10/04	1290	943	95.0	44.0	84.0	7.0	178	267	---	3.6
	01/05	1030	610	76.0	35.0	93.0	3.8	136	194	155	6.9
	04/05	1060	630	77.0	34.0	82.0	3.2	125	174	139	2.71
	07/05	1120	750	81.0	35.0	84.0	3.4	129	---	129	0 as N

ND - None Detected

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-6
SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA
WELLS ON CAMP PENDLETON

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
10S/4W-7A2 (Bldg 260073) (Cont)	11/05	1170	790	94.7	41.2	97.9	3.7	138	199	156	7.53
	04/06	1140	704	91.0	39.0	98.0	4.5	150	220	180	7.3
	04/07	1200	716	97	44	97	3.7	160	240	190	4.2
	04/08	1270	900	98	45	97	3.8	180	260	170	14
	04/09	1200	780	94	42	100	3.7	130	230	180	22
	04/13/10	1300	770	93	42	100	3.8	160	240	180	8.7
	04/13/11	1200	780	83	38	93	3.5	150	220	170	3.9
	04/19/12	1300	790	92	42	94	3.8	160	240	260	6.2
10S/5W-23G3 (Bldg 33926)	06/91	1160	684	83.4	28.3	125.0	---	145	124	223	<0.04
	03/92	1060	674	75.9	24.1	127.0	---	139	111	269	<0.4
	03/93	1182	584	67.8	21.1	110.0	---	135	101	274	<0.4
	06/93	1020	623	60.5	22.4	116.0	---	125	107	225	<0.4
	03/94	1120	665	80.0	25.0	122.0	---	129	117	---	1.8
	08/94	1150	699	78.7	26.4	125.0	---	141	118	---	<0.44
	06/95	1060	673	75.9	23.1	118.0	---	158	114	---	<0.04
	01/96	1200	619	71.0	24.0	120.0	---	139	107	262	---
	07/96	---	---	---	---	---	---	---	---	---	---
10S/5W-23K2 (Bldg 33924)	06/89	1207	698	75.6	22.8	84.0	---	138	137	231	<0.4
	04/89	1240	728	100.0	32.9	129.0	---	158	148	245	1.3
	01/91	1193	---	80.6	35.2	131.0	---	21	146	---	<0.04
	06/91	1160	676	88.1	29.6	118.0	---	141	129	224	<0.04
	03/92	1130	705	76.7	26.0	126.0	---	149	125	279	<0.4
	06/92	1130	717	66.8	26.7	124.0	---	146	140	232	<0.4
	03/93	1285	331	72.1	23.8	115.0	---	131	122	273	<0.4
	02/97	1200	780	89.0	32.0	130.0	---	166	165	250	<2 as N
	03/97	1230	700	94.0	34.0	140.0	---	187	162	264	<2 as N
	06/97	1231	778	91.0	31.0	130.0	<2.0	171	165	264	<2 as N
	12/97	1200	710	82.0	30.0	130.0	2.0	156	162	230	ND
	03/98	1200	710	82.0	30.0	110.0	2.0	191	146	240	ND
	06/98	1170	658	79.0	28.0	123.0	2.0	157	151	293	ND
	02/99	1170	698	75.0	27.0	123.0	3.0	160	130	259	ND
	04/99	1210	667	76.0	27.0	118.0	3.0	148	140	268	ND
	08/99	1140	714	79.0	27.0	116.0	3.0	180	165	268	ND
	10/99	1150	721	80.0	28.0	131.0	3.0	110	150	281	ND
	02/00	1050	619	82.0	28.0	108.0	3.0	100	140	293	ND
	05/00	1060	716	80.0	29.0	112.0	3.0	173	141	268	ND
	08/00	1210	722	82.0	29.0	105.0	3.0	162	156	268	ND
	04/01	1210	705	85.0	30.0	130.0	3.0	163	157	281	ND
	09/01	1190	672	81.0	30.0	125.0	3.0	152	149	275	ND
	10/01	1200	680	81.0	29.0	143.0	3.0	162	159	281	ND
	02/02	1160	675	80.0	29.0	129.0	3.5	143	152	268	ND
	04/02	1180	682	84.0	31.0	124.0	2.9	151	155	230	ND
	07/02	1210	706	80.0	29.0	127.0	2.9	156	156	221	ND
	10/02	1210	669	83.0	30.0	122.0	2.9	151	162	206	8
	01/03	1320	801	97.0	34.0	140.0	2.8	154	180	245	ND

ND - None Detected

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-6
SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS ON CAMP PENDLETON

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
10S/5W-23K2 (Bldg 33924) (Cont)	04/03	1330	743	89.0	32.0	133.0	2.8	165	183	234	ND
	10/03	1210	712	87.0	31.0	135.0	4.0	155	177	204	ND
	04/04	1320	713	85.0	32.0	121.0	5.0	165	167	228	ND
	07/04	1070	703	89.0	32.0	101.0	5.0	147	173	230	ND
	10/04	1230	806	91.0	33.0	102.0	5.0	166	183	—	ND
	02/05	1310	837	104.0	37.0	136.0	4.2	175	191	253	0 as N
	07/05	1170	750	83.0	29.0	114.0	2.7	139	—	210	ND
	11/05	1260	750	91.9	29.6	119.0	3.1	144	171	225	ND
	04/06	1220	774	92.0	32.0	120.0	2.8	160	180	284	ND
	04/07	1010	706	86.0	29.0	120.0	2.7	150	170	260	0
	04/08	1270	792	91	30	110	2.6	160	190	175	<2
	04/09	1300	800	100	34	120	2.7	160	200	260	<2
	04/15/10	1200	740	95	34	120	2.8	150	180	260	<2
	04/27/11	1200	740	87	29	110	2.7	160	170	230	<2
	04/30/12	1200	800	92	32	110	2.6	170	190	220	<2
10S/5W-13R2 (Bldg 230063)	01/90	1030	540	96.0	26.6	94.8	—	141	130	200	0.7
	06/91	1150	702	98.7	32.0	109.0	—	149	125	288	1.3
	06/93	1130	705	72.0	28.4	107.0	—	140	139	262	0.9
	03/94	1020	658	69.6	27.8	104.0	—	135	140	—	0.89
	06/95	1140	636	92.5	30.7	115.0	—	149	151	—	14.2
	06/96	1103	680	91.0	31.0	100.0	—	148	251	233	—
	06/97	1082	708	85.0	29.0	110.0	<5.0	135	145	244	<2 as N
	12/97	1000	640	81.0	28.0	100.0	2.0	119	128	250	ND
	03/98	1100	620	85.0	31.0	110.0	2.0	161	144	220	ND
	06/98	1100	680	83.0	30.0	109.0	3.0	137	140	275	0.68
	09/98	1160	662	81.0	28.0	90.0	3.0	144	90	256	ND
	04/01	1100	612	83.0	29.0	106.0	3.0	131	146	238	3.5
	09/01	1150	679	89.0	31.0	103.0	2.0	142	156	241	3.2
	11/01	1130	658	87.0	30.0	104.0	2.0	148	169	262	3.4
	02/02	1120	674	85.0	30.0	112.0	3.2	140	160	257	3.1
	04/02	1120	682	89.0	32.0	106.0	2.7	142	167	205	2.8
	07/02	1150	676	83.0	30.0	111.0	2.7	145	64	205	2.3
	10/02	1220	711	87.0	31.0	110.0	2.7	149	175	203	ND
	01/03	1210	713	91.0	33.0	106.0	2.7	138	165	197	2
	05/03	1230	728	93.0	33.0	112.0	2.9	155	183	181	2.2
	10/03	1190	741	93.0	33.0	123.0	3.0	188	212	179	0 as N
	04/04	1270	701	87.0	32.0	103.0	4.0	163	186	220	ND
	07/04	1270	701	220.0	32.0	103.0	4.0	163	186	220	0 as N
	4/25/12	1200	790	100	37	120	2.8	160	220	220	<2
10S/4W-7D1 (Previously reported as 10S/4W-7A3 (Bldg 260072))	03/99	1280	765	91.0	34.0	127.0	2.0	190	160	272	ND
	06/99	1080	706	76.0	31.0	88.0	2.2	163	118	220	ND
	08/99	1080	690	76.0	32.0	93.0	3.0	160	191	244	ND
	10/99	1070	660	76.0	32.0	100.0	3.0	131	120	232	4
	05/00	1010	702	79.0	34.0	94.0	3.0	177	164	254	ND
	08/00	1170	732	84.0	36.0	89.0	3.0	155	188	201	5
ND - None Detected											

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-6
SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS ON CAMP PENDLETON

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
10S/4W-7D1 (Previously reported as 10S/4W-7A3 (Bldg 260072) (Cont)	02/01	1230	753	89.0	39.0	113.0	2.0	170	198	220	2.7
	04/01	1230	726	89.0	39.0	115.0	4.0	160	191	243	2.9
	09/01	1210	735	89.0	39.0	107.0	4.0	153	185	217	5.3
	11/01	1240	725	89.0	39.0	117.0	3.0	168	205	220	5.6
	02/02	1250	765	97.0	43.0	109.0	3.4	155	198	234	4.7
	04/02	1290	790	98.0	44.0	109.0	3.4	158	208	200	3.9
	07/02	1320	809	96.0	43.0	117.0	3.7	182	217	200	ND
	10/02	1380	787	99.0	43.0	113.0	3.7	170	216	203	2.8
	01/03	1370	810	101.0	44.0	134.0	4.0	155	194	217	ND
	04/03	1440	789	93.0	40.0	125.0	3.6	177	205	216	2.1
	10/03	1370	820	91.0	40.0	130.0	4.0	175	235	180	4.3
	01/04	1350	747	97.0	42.0	114.0	6.0	168	226	184	2.1
	04/04	1400	766	92.0	42.0	112.0	6.0	162	228	198	2
	07/04	1410	784	98.0	43.0	92.0	6.0	171	231	200	3.8
	11/04	1290	831	100.0	43.0	134.0	4.2	176	224	203	ND
	01/05	1310	804	102.0	44.0	125.0	3.7	184	241	200	2.7
	04/05	1100	690	78.0	34.0	84.0	3.2	128	177	162	2.6
	07/05	1160	716	84.0	35.0	96.0	3.0	136	---	166	0 as N
	11/05	1180	785	92.5	40.4	97.1	3.8	138	202	174	5.93 as N
	04/06	1280	786	98.0	43.0	110.0	3.3	160	220	233	7.1
	04/07	1400	784	98.0	43.0	110.0	3.4	165	230	230	5
	04/08	1230	840	88	40	98	3.4	160	250	169	7.1
	11/09	---	---	---	---	---	---	---	---	---	<2
	04/13/10	1300	820	96	42	120	3.5	170	240	220	4.5
	07/27/11	1200	800	89	39	110	3.2	150	200	220	5.0
	04/19/12	1200	860	97	42	120	3.8	180	210	160	<2
10S/5W-23G4 (Bldg 330925)	06/99	1070	668	69	23	106	1.7	163	144	305	ND
	08/99	1090	657	72	25	115	2.0	180	153	317	ND
	10/99	1150	716	79	27	140	2.0	120	140	305	ND
	02/00	956	522	67	23	117	2.0	90	120	268	ND
	05/00	1040	686	77	27	116	2.0	181	141	307	ND
	08/00	1180	722	80	28	105	2.0	155	143	232	ND
	02/01	1100	706	73	25	125	2.0	149	164	268	ND
	04/01	1170	701	81	29	128	2.0	154	149	282	ND
	09/01	1180	671	80	28	126	2.0	149	142	271	ND
	10/01	1180	678	81	28	132	2.0	161	156	281	ND
	02/02	1170	685	80	28	134	2.8	143	144	279	ND
	04/02	1200	711	87	31	127	2.3	150	204	235	ND
	07/02	1180	730	83	29	130	2.5	158	151	230	ND
	10/02	1180	649	78	27	115	2.1	135	138	217	ND
	01/03	1210	740	87	30	129	2.2	145	154	225	ND
	04/03	1200	681	79	27	128	2.5	150	152	215	ND
	10/03	1160	647	80	27	136	3.0	152	155	216	ND
	04/04	1140	604	66	24	117	3.0	147	133	215	ND
	08/04	1180	657	68	24	99	4.0	140	114	245	ND
	10/04	1170	712	85	29	97	5.0	160	172	---	ND
ND - None Detected	02/05	1070	661	84	29	125	3.3	154	148	185	ND
	07/05	1050	655	72	23	118	2.0	127	---	202	ND

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-6
SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS ON CAMP PENDLETON

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
10S/5W-23G4 (Bldg 330925) (Cont)	11/05	1080	665	76	23	121	2.0	135	125	227	ND
	05/06	1110	650	71	24	120	1.9	140	130	217	ND
	04/07	950	632	72	25	120	1.9	140	130	260	0
	04/08	1150	672	73	25	120	1.8	150	130	250	<2
	04/09	1100	670	76	26	120	2.1	150	140	250	<2
	04/22/10	1100	660	71	24	120	1.8	140	120	250	<2
	04/20/11	1200	720	83	29	110	2.1	150	170	240	<2
	04/30/12	1100	720	83	29	120	2.0	150	160	230	<2
10S/5W-23K3 (Bldg 330923)	06/99	1150	700	75.0	27.0	106.0	2.2	163	155	317	ND
	08/99	1170	722	79.0	28.0	114.0	3.0	330	161	342	ND
	10/99	1170	723	78.0	28.0	140.0	3.0	120	140	293	ND
	02/00	1120	712	83.0	30.0	117.0	3.0	120	157	293	ND
	02/01	1240	758	85.0	31.0	136.0	3.0	167	152	305	ND
	04/01	1220	735	85.0	31.0	135.0	3.0	162	154	293	ND
	09/01	1240	682	81.0	29.0	132.0	3.0	162	144	281	ND
	10/01	1330	746	87.0	32.0	134.0	3.0	166	156	293	ND
	02/02	1190	720	83.0	29.0	140.0	3.5	150	155	281	ND
	04/02	1210	691	82.0	29.0	127.0	2.7	145	142	231	ND
	07/02	1230	738	81.0	29.0	134.0	3.1	167	151	240	ND
	10/02	1270	716	85.0	30.0	137.0	2.9	150	162	221	ND
	01/03	1340	826	100.0	35.0	141.0	2.6	156	185	252	0.4
	04/03	1350	733	85.0	30.0	129.0	2.6	162	171	235	ND
	10/03	887	800	84.0	30.0	141.0	3.0	160	173	224	ND
	02/04	1250	698	83.0	29.0	120.0	4.0	154	172	233	ND
	04/04	1240	706	78.0	28.0	121.0	4.0	163	170	220	ND
	07/04	1040	729	84.0	30.0	99.0	5.0	158	169	240	ND
	10/04	1180	857	86.0	30.0	97.0	5.0	159	172	235	ND
	02/05	1160	685	87.0	31.0	125.0	3.7	159	168	210	ND
	04/05	1230	760	91.0	30.0	122.0	2.6	149	148	213	ND
	07/05	1170	755	83.0	29.0	115.0	2.6	135	—	210	ND
	11/05	1230	735	92.8	29.5	123.0	3.0	141	165	332	ND
	04/06	1190	720	89.0	31.0	120.0	2.7	160	170	233	ND
	04/07	1010	718	87.0	30.0	120.0	2.6	160	170	250	0
	04/08	1250	754	91	32	110	2.5	160	180	184	ND
	04/09	1200	760	92	33	120	2.7	160	180	250	<2
	04/15/10	1200	760	98	34	120	2.6	160	180	240	<2
	04/13/11	1300	760	88	30	110	2.6	160	180	240	<2
	04/16/12	1200	760	98	34	120	2.9	170	190	230	<2
10S/5W-26C3 (Bldg 220002)	09/01	1410	819	101.0	38.0	138.0	3.0	173	175	296	ND
	10/01	1370	814	104.0	38.0	131.0	3.0	199	198	317	ND
	02/02	1380	834	99.0	36.0	128.0	3.0	172	183	318	ND
	04/02	1370	808	104.0	39.0	124.0	3.2	180	184	258	ND
	07/02	1450	829	101.0	37.0	137.0	3.3	187	193	260	ND
	10/02	1400	793	98.0	35.0	143.0	3.4	179	195	248	ND
	01/03	1300	806	94.0	33.0	144.0	2.0	163	180	235	ND
	04/03	1290	759	94.0	33.0	137.0	3.1	182	198	230	ND
ND - None Detected	04/03	1290	759	94.0	32.0	137.0	3.1	182	198	230	ND

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-6
SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

WELLS ON CAMP PENDLETON

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
10S/5W-26C3 (Bldg 220002) (Cont)	10/03	1340	761	90.0	31.0	146.0	4.0	162	188	210	ND
	01/04	1320	743	94.0	32.0	124.0	5.0	182	212	203	ND
	04/04	1350	731	90.0	32.0	127.0	5.0	184	197	235	ND
	07/04	1100	773	91.0	32.0	98.0	5.0	167	197	215	ND
	10/04	1290	826	93.0	32.0	106.0	5.0	187	185	---	ND
	02/05	1260	735	101.0	35.0	127.0	3.7	175	188	215	ND
	04/05	1300	760	98.0	33.0	122.0	2.8	160	184	200	ND
	07/05	1450	1260	97.0	33.0	119.0	2.9	154	---	200	ND
	11/05	1240	795	99.0	32.0	122.0	2.9	159	169	202	ND
	06/06	1300	796	95.0	34.0	140.0	2.9	180	170	250	ND
	04/07	1080	764	91.0	31.0	130.0	2.9	190	190	250	0
	04/08	1260	694	80	29	140	2.7	180	150	286	<2
10S/5W-18B1 (Bldg 260018)	04/01/10	1400	840	100	42	110	3.6	170	230	240	<2
	04/20/11	1400	880	100	41	100	3.4	180	250	220	<2
	04/25/12	1300	910	100	44	120	3.8	180	---	230	<2

ND - None Detected

WATERMASTER
SANTA MARGARITA RIVER WATERSHED

TABLE D-12

SANTA MARGARITA RIVER WATERSHED
WATER QUALITY DATA

SURFACE STREAMS SAMPLED BY USGS ON CAHUILLA CREEK

Site Location	Date Tested	Specific Conductance umhos	Total Dissolved Solids (mg/l)	Chemical Constituents - mg/l							
				Ca	Mg	Na	K	Cl	SO4	HCO3	NO3
Cahuilla Creek	02/28/05	644	446	41.90	11.20	76.90	10.10	---	---	---	.23 @N
Cahuilla Creek Below Highway 371	02/28/05	476	337	34.20	10.10	51.90	3.69	36.9	---	---	.64 @N
Unnamed Tributary to Cahuilla Creek	02/14/05	783	529	64.00	17.50	80.70	8.94	35.2	---	---	3.05 @N

SANTA MARGARITA RIVER WATERSHED

ANNUAL WATERMASTER REPORT

WATER YEAR 2011-12

APPENDIX E

**COOPERATIVE WATER RESOURCE
MANAGEMENT AGREEMENT
REQUIRED FLOWS AND ACCOUNTS
CALENDAR YEAR 2012**

July 2013

APPENDIX E

COOPERATIVE WATER RESOURCE MANAGEMENT AGREEMENT REQUIRED FLOWS AND ACCOUNTS SANTA MARGARITA RIVER NEAR TEMECULA SANTA MARGARITA RIVER WATERSHED

JANUARY 2012 - CRITICALLY DRY YEAR

CAMP PENDLETON GROUNDWATER ACCOUNT BALANCE														
DAY	10-Day Running				Running Average Less Required Flow cfs	WR-34 Make-Up Discharge cfs	Climatic Credits Earned 2/ AF		Input 3/ cfs	Input AF	Output cfs	Output AF	Cumulative GW Account Balance AF	
	USGS Official Discharge cfs	USGS Daily Website Discharge cfs	Average of Website Discharge cfs	Minimum Flow Maintenance Requirement 1/ cfs										
1	11.0	11.0	11.0			10.9	21.7	7.1	14.0	0.6	1.2	0.0	5,000.0	
2	11.0	11.0	11.0			10.9	21.7	7.1	14.0	0.6	1.2	0.0	5,000.0	
3	11.0	11.0	11.0			10.8	21.5	7.0	13.8	0.6	1.2	0.0	5,000.0	
4	11.0	11.0	11.0			10.7	21.2	6.8	13.5	0.6	1.2	0.0	5,000.0	
5	11.0	11.0	11.0			10.5	20.9	6.7	13.2	0.6	1.2	0.0	5,000.0	
6	11.0	11.0	11.0			10.4	20.7	6.6	13.0	0.6	1.2	0.0	5,000.0	
7	11.0	11.0	11.0			10.3	20.4	6.4	12.7	0.6	1.2	0.0	5,000.0	
8	11.0	11.0	11.0			10.3	20.5	6.5	12.8	0.6	1.2	0.0	5,000.0	
9	11.0	11.0	11.0			10.4	20.6	6.5	12.9	0.6	1.2	0.0	5,000.0	
10	11.0	11.0	11.0			10.4	20.7	6.6	13.0	0.6	1.2	0.0	5,000.0	
11	11.0	11.0	11.0		10.9	10.4	20.6	6.5	12.9	0.6	1.2	0.0	5,000.0	
12	11.0	11.0	11.0		10.9	10.3	20.5	6.5	12.8	0.6	1.2	0.0	5,000.0	
13	11.0	11.0	11.0		10.9	10.4	20.6	6.5	12.9	0.6	1.2	0.0	5,000.0	
14	11.0	11.0	11.0		10.9	10.4	20.6	6.5	12.9	0.6	1.2	0.0	5,000.0	
15	11.0	11.0	11.0		10.9	10.4	20.6	6.5	12.9	0.6	1.2	0.0	5,000.0	
16	11.0	11.0	11.0		10.9	10.1	20.0	6.2	12.3	0.6	1.2	0.0	5,000.0	
17	11.0	11.0	11.0		10.9	10.1	20.1	6.2	12.4	0.6	1.2	0.0	5,000.0	
18	11.0	11.0	11.0		10.9	10.1	19.7	6.0	12.0	0.6	1.2	0.0	5,000.0	
19	11.0	11.0	11.0		10.9	10.1	20.0	6.2	12.3	0.6	1.2	0.0	5,000.0	
20	11.0	11.0	11.0		10.9	10.1	20.1	6.2	12.4	0.6	1.2	0.0	5,000.0	
21	11.0	11.0	11.0		10.9	10.1	19.5	5.6	11.1	0.6	1.2	0.0	5,000.0	
22	11.0	11.0	11.0		10.9	0.1	8.5	4.6	9.2	0.6	1.2	0.0	5,000.0	
23	12.0	12.0	11.1		10.9	0.2	9.4	5.5	10.9	0.6	1.2	0.0	5,000.0	
24	16.0	16.0	11.6		10.9	0.7	2.6	0.0	0.0	0.6	1.2	0.0	5,000.0	
25	11.0	11.0	11.6		10.9	0.7	8.9	5.0	10.0	0.6	1.2	0.0	5,000.0	
26	11.0	11.0	11.6		10.9	10.0	19.8	6.1	12.1	0.6	1.2	0.0	5,000.0	
27	11.0	11.0	11.6		10.9	10.0	19.9	6.1	12.2	0.6	1.2	0.0	5,000.0	
28	10.0	10.0	11.5		10.9	0.6	9.6	5.7	11.4	0.6	1.2	0.0	5,000.0	
29	11.0	11.0	11.5		10.9	0.6	9.9	6.0	12.0	0.6	1.2	0.0	5,000.0	
30	11.0	11.0	11.5		10.9	0.6	10.1	6.2	12.3	0.6	1.2	0.0	5,000.0	
31	11.0	11.0	11.5		10.9	0.6	10.2	6.3	12.5	0.6	1.2	0.0	5,000.0	
TOTAL SFD	346.0	346.0	235.5	228.9	6.6	306.8	187.7		19.1		0.0			
TOTAL AF	686.3	686.3	467.1	454.0	13.1	608.6	372.3		37.9		0.0			

Monthly totals are rounded to the nearest tenth of an acre foot.

1 - Minimum Flow Maintenance Requirement equals 11.5 cfs less 0.6 cfs CAP Credit carried over from 2011.

2 - Climatic Credits equal the WR-34 Discharge less the Actual Flow Maintenance Requirement which is the Flow indicated in Section 5 of the CWRMA less applicable credits, but not less than 3.0 cfs.

3 - Art. 17 - Camp Pendleton rights to groundwater equal the Flow indicated in Section 5 of the CWRMA minus the Actual Flow Maintenance Requirement which cannot be less than 3.0 cfs.

Input to groundwater account shown but cumulative balance did not increase due to account balance maximum of 5,000 AF.

APPENDIX E

SANTA MARGARITA RIVER WATERSHED COOPERATIVE WATER RESOURCE MANAGEMENT AGREEMENT REQUIRED FLOWS AND ACCOUNTS SANTA MARGARITA RIVER NEAR TEMECULA

FEBRUARY 2012 - CRITICALLY DRY YEAR

DAY	10-Day Running										CAMP PENDLETON GROUNDWATER ACCOUNT BALANCE				
	USGS Daily		Average of		Minimum Flow		Running		WR-34 Make-Up		Climatic Credits		Input 3/		Cumulative GW Account Balance AF
	USGS Official Discharge cfs	USGS Daily Website Discharge cfs	Website Discharge cfs	Average of Website Discharge cfs	Maintenance Requirement 1/ cfs	Average Less Required Flow cfs	Discharge cfs	AF	Earned 2/ cfs	AF	Input cfs	Output cfs	Output AF	AF	
1	11.0	11.0	11.5	10.9	10.9	0.6	10.1	20.1	6.2	12.4	0.6	1.2	0.0	0.0	5,000.0
2	11.0	11.0	11.4	10.9	10.9	0.5	10.1	20.1	6.2	12.4	0.6	1.2	0.0	0.0	5,000.0
3	11.0	11.0	10.9	10.9	10.9	0.0	10.1	20.1	6.2	12.4	0.6	1.2	0.0	0.0	5,000.0
4	11.0	11.0	10.9	10.9	10.9	0.0	10.1	20.1	6.2	12.4	0.6	1.2	0.0	0.0	5,000.0
5	11.0	11.0	10.9	10.9	10.9	0.0	10.1	20.1	6.2	12.4	0.6	1.2	0.0	0.0	5,000.0
6	11.0	11.0	10.9	10.9	10.9	0.0	10.1	20.1	6.2	12.4	0.6	1.2	0.0	0.0	5,000.0
7	10.0	10.0	10.9	10.9	10.9	0.0	9.4	18.7	5.5	11.0	0.6	1.2	0.0	0.0	5,000.0
8	11.0	11.0	10.9	10.9	10.9	0.0	9.8	19.4	5.9	11.7	0.6	1.2	0.0	0.0	5,000.0
9	11.0	11.0	10.9	10.9	10.9	0.0	9.8	19.4	5.9	11.7	0.6	1.2	0.0	0.0	5,000.0
10	11.0	11.0	10.9	10.9	10.9	0.0	9.8	19.4	5.9	11.7	0.6	1.2	0.0	0.0	5,000.0
11	11.0	11.0	10.9	10.9	10.9	0.0	9.8	19.4	5.9	11.7	0.6	1.2	0.0	0.0	5,000.0
12	11.0	11.0	10.9	10.9	10.9	0.0	9.8	19.4	5.9	11.7	0.6	1.2	0.0	0.0	5,000.0
13	11.0	11.0	10.9	10.9	10.9	0.0	9.8	19.4	5.9	11.7	0.6	1.2	0.0	0.0	5,000.0
14	11.0	11.0	10.9	10.9	10.9	0.0	9.7	19.3	5.8	11.6	0.6	1.2	0.0	0.0	5,000.0
15	35.0	35.0	13.3	10.9	10.9	2.4	7.8	15.5	3.9	7.8	0.6	1.2	0.0	0.0	5,000.0
16	69.0	69.0	19.1	10.9	10.9	8.2	0.0	0.0	0.0	0.0	0.6	1.2	0.0	0.0	5,000.0
17	15.0	15.0	19.6	10.9	10.9	8.7	0.0	0.0	0.0	0.0	0.6	1.2	0.0	0.0	5,000.0
18	9.8	9.8	19.5	10.9	10.9	8.6	6.8	13.5	2.9	5.8	0.6	1.2	0.0	0.0	5,000.0
19	11.0	11.0	19.5	10.9	10.9	8.6	10.0	19.9	6.1	12.2	0.6	1.2	0.0	0.0	5,000.0
20	11.0	11.0	19.5	10.9	10.9	8.6	10.0	19.8	6.1	12.1	0.6	1.2	0.0	0.0	5,000.0
21	11.0	11.0	19.5	10.9	10.9	8.6	9.9	19.7	6.0	12.0	0.6	1.2	0.0	0.0	5,000.0
22	11.0	11.0	19.5	10.9	10.9	8.6	10.0	19.8	6.1	12.1	0.6	1.2	0.0	0.0	5,000.0
23	11.0	11.0	19.5	10.9	10.9	8.6	10.0	19.8	6.1	12.1	0.6	1.2	0.0	0.0	5,000.0
24	11.0	11.0	19.5	10.9	10.9	8.6	10.0	19.9	6.1	12.2	0.6	1.2	0.0	0.0	5,000.0
25	11.0	11.0	17.1	10.9	10.9	6.2	10.0	19.9	6.1	12.2	0.6	1.2	0.0	0.0	5,000.0
26	11.0	11.0	11.3	10.9	10.9	0.4	10.0	19.9	6.1	12.2	0.6	1.2	0.0	0.0	5,000.0
27	19.0	19.0	11.7	10.9	10.9	0.8	7.6	15.0	3.7	7.3	0.6	1.2	0.0	0.0	5,000.0
28	54.0	54.0	16.1	10.9	10.9	5.2	0.0	0.0	0.0	0.0	0.6	1.2	0.0	0.0	5,000.0
29	11.0	11.0	16.1	10.9	10.9	5.2	0.0	0.0	0.0	0.0	0.6	1.2	0.0	0.0	5,000.0
30	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
31	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
TOTAL SFD	453.8	453.8	414.3	316.1	316.1	98.2	240.8		143.1		17.9	0.0			
TOTAL AF	900.1	900.1	821.8	627.0	627.0	194.8	477.7		285.1		35.4			0.0	

Monthly totals are rounded to the nearest tenth of an acre foot.

1 - Minimum Flow Maintenance Requirement equals 11.5 cfs less 0.6 cfs CAP Credit carried over from 2011.

2 - Climatic Credits equal the WR-34 Discharge less the Actual Flow Maintenance Requirement which is the Flow indicated in Section 5 of the CWRMA less applicable credits, but not less than 3.0 cfs.

3 - Art. 17 - Camp Pendleton rights to groundwater equal the Flow indicated in Section 5 of the CWRMA minus the Actual Flow Maintenance Requirement which cannot be less than 3.0 cfs.

Input to groundwater account shown but cumulative balance did not increase due to account balance maximum of 5,000 AF.

APPENDIX E

SANTA MARGARITA RIVER WATERSHED COOPERATIVE WATER RESOURCE MANAGEMENT AGREEMENT REQUIRED FLOWS AND ACCOUNTS SANTA MARGARITA RIVER NEAR TEMECULA

MARCH 2012 - CRITICALLY DRY YEAR

DAY	10-Day										CAMP PENDLETON			
	USGS Daily		Minimum Flow		Running		WR-34 Make-Up		Climatic Credits		GROUNDWATER ACCOUNT BALANCE		CAMP PENDLETON	
	USGS Official	USGS Daily	Average of	Running	Minimum Flow	Average Less	Discharge	AF	Earned 2/	AF	Input 3/	Output	Output	Cumulative
	Discharge	Discharge	Website	Website	Requirement 1/	Required Flow	cfs	cfs	cfs	AF	AF	cfs	AF	GW Account
	cfs	cfs	cfs	cfs	cfs	cfs	cfs	AF	cfs	AF	cfs	cfs	AF	Balance
														AF
1	10.0	10.0	16.0	10.9	10.9	5.1	6.9	13.6	3.0	5.9	0.6	1.2	0.0	5,000.0
2	11.0	11.0	16.0	10.9	10.9	5.1	9.8	19.4	5.9	11.7	0.6	1.2	0.0	5,000.0
3	11.0	11.0	16.0	10.9	10.9	5.1	9.7	19.3	5.8	11.6	0.6	1.2	0.0	5,000.0
4	11.0	11.0	16.0	10.9	10.9	5.1	9.6	19.1	5.7	11.4	0.6	1.2	0.0	5,000.0
5	11.0	11.0	16.0	10.9	10.9	5.1	9.8	19.5	5.9	11.8	0.6	1.2	0.0	5,000.0
6	11.0	11.0	16.0	10.9	10.9	5.1	9.9	19.6	6.0	11.9	0.6	1.2	0.0	5,000.0
7	11.0	11.0	16.0	10.9	10.9	5.1	9.9	19.7	6.0	12.0	0.6	1.2	0.0	5,000.0
8	11.0	11.0	15.2	10.9	10.9	4.3	9.9	19.7	6.0	12.0	0.6	1.2	0.0	5,000.0
9	11.0	11.0	10.9	10.9	10.9	0.0	9.9	19.7	6.0	12.0	0.6	1.2	0.0	5,000.0
10	11.0	11.0	10.9	10.9	10.9	0.0	9.9	19.6	6.0	11.9	0.6	1.2	0.0	5,000.0
11	10.0	10.0	10.9	10.9	10.9	0.0	9.2	18.2	5.3	10.5	0.6	1.2	0.0	5,000.0
12	11.0	11.0	10.9	10.9	10.9	0.0	10.0	19.8	6.1	12.1	0.6	1.2	0.0	5,000.0
13	11.0	11.0	10.9	10.9	10.9	0.0	9.9	19.7	6.0	12.0	0.6	1.2	0.0	5,000.0
14	11.0	11.0	10.9	10.9	10.9	0.0	9.9	19.6	6.0	11.9	0.6	1.2	0.0	5,000.0
15	11.0	11.0	10.9	10.9	10.9	0.0	9.9	19.6	6.0	11.9	0.6	1.2	0.0	5,000.0
16	11.0	11.0	10.9	10.9	10.9	0.0	9.9	19.6	6.0	11.9	0.6	1.2	0.0	5,000.0
17	117.0	117.0	21.5	10.9	10.9	10.6	6.1	12.0	2.2	4.3	0.6	1.2	0.0	5,000.0
18	152.0	152.0	35.6	10.9	10.9	24.7	0.0	0.0	0.0	0.0	0.6	1.2	0.0	5,000.0
19	44.0	44.0	38.9	10.9	10.9	28.0	0.0	0.0	0.0	0.0	0.6	1.2	0.0	5,000.0
20	12.0	12.0	39.0	10.9	10.9	28.1	0.0	0.0	0.0	0.0	0.6	1.2	0.0	5,000.0
21	11.0	11.0	39.1	10.9	10.9	28.2	6.6	13.0	2.7	5.3	0.6	1.2	0.0	5,000.0
22	14.0	14.0	39.4	10.9	10.9	28.5	8.6	17.0	4.7	9.3	0.6	1.2	0.0	5,000.0
23	12.0	12.0	39.5	10.9	10.9	28.6	10.0	19.8	6.1	12.0	0.6	1.2	0.0	5,000.0
24	11.0	11.0	39.5	10.9	10.9	28.6	9.0	17.8	5.1	10.1	0.6	1.2	0.0	5,000.0
25	34.0	34.0	41.8	10.9	10.9	30.9	6.8	13.5	2.9	5.8	0.6	1.2	0.0	5,000.0
26	185.0	185.0	59.2	10.9	10.9	48.3	0.0	0.0	0.0	0.0	0.6	1.2	0.0	5,000.0
27	34.0	34.0	50.9	10.9	10.9	40.0	0.0	0.0	0.0	0.0	0.6	1.2	0.0	5,000.0
28	10.0	10.0	36.7	10.9	10.9	25.8	0.0	0.0	0.0	0.0	0.6	1.2	0.0	5,000.0
29	11.0	11.0	33.4	10.9	10.9	22.5	6.9	13.7	3.0	6.0	0.6	1.2	0.0	5,000.0
30	11.0	11.0	33.3	10.9	10.9	22.4	9.0	17.8	5.1	10.1	0.6	1.2	0.0	5,000.0
31	11.0	11.0	33.3	10.9	10.9	22.4	9.0	17.8	5.1	10.1	0.6	1.2	0.0	5,000.0
TOTAL SFD	843.0	843.0	795.5	337.9	337.9	457.6	225.9		128.8		19.1	0.0		
TOTAL AF	1,672.1	1,672.1	1,577.9	670.2	670.2	907.6		448.2	255.5		37.9			0.0

Monthly totals are rounded to the nearest tenth of an acre foot.

1 - Minimum Flow Maintenance Requirement equals 11.5 cfs less 0.6 cfs CAP Credit carried over from 2011.

2 - Climatic Credits equal the WR-34 Discharge less the Actual Flow Maintenance Requirement which is the Flow indicated in Section 5 of the CWRMA less applicable credits, but not less than 3.0 cfs.

3 - Art. 17 - Camp Pendleton rights to groundwater equal the Flow indicated in Section 5 of the CWRMA minus the Actual Flow Maintenance Requirement which cannot be less than 3.0 cfs.

Input to groundwater account shown but cumulative balance did not increase due to account balance maximum of 5,000 AF.

* 8.2 AF supplied from WR-34 and 11.5 AF supplied from potable connection to WR-34 because of MWD operational shutdown.

** Discharge supplied from potable connection to WR-34 because of MWD operational shutdown.

*** 7.5 AF supplied from WR-34 and 12.3 AF supplied from potable connection to WR-34 because of MWD operational shutdown. Total supplied from potable connection for Mar. 16-23 was 65.8 AF.

APPENDIX E

SANTA MARGARITA RIVER WATERSHED COOPERATIVE WATER RESOURCE MANAGEMENT AGREEMENT REQUIRED FLOWS AND ACCOUNTS SANTA MARGARITA RIVER NEAR TEMECULA

APRIL 2012 - CRITICALLY DRY YEAR

DAY	GROUNDWATER ACCOUNT BALANCE										CAMP PENDLETON																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																				
	USGS Daily Website Discharge					10-Day Running Average of Website Discharge					WR-34 Make-Up Discharge					Climatic Credits Earned 3/																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																															
	USGS Official Discharge	USGS Daily Website Discharge	Minimum Flow Maintenance Requirement 1/ 2/	Running Average Less Required Flow	WR-34 Make-Up Discharge	Climatic Credits Earned 3/	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF	AF

APPENDIX E

SANTA MARGARITA RIVER WATERSHED COOPERATIVE WATER RESOURCE MANAGEMENT AGREEMENT REQUIRED FLOWS AND ACCOUNTS SANTA MARGARITA RIVER NEAR TEMECULA

MAY 2012 - CRITICALLY DRY YEAR

DAY	10-Day Running					Running			Climatic Credits			CAMP PENDLETON			
	USGS Daily		Minimum Flow		Average of Website Discharge	Average Less Required Flow	WR-34 Make-Up Discharge	Climatic Credits Earned 3/	Input 4/	Output	Output	GROUNDWATER ACCOUNT BALANCE		Cumulative GW Account Balance	AF
	USGS Official Discharge	USGS Daily Website Discharge	USGS Daily Website Discharge	Minimum Flow Requirement 1/ 2/								Input	Output		
	cfs	cfs	cfs	cfs	cfs	cfs	cfs	cfs	cfs	AF	cfs	AF	cfs	AF	AF
1	3.3	3.9	3.9	3.3			2.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
2	4.1	3.9	3.9	3.3			3.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
3	4.0	4.0	4.0	3.8			3.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
4	3.8	3.8	3.8	3.8			3.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
5	3.8	3.8	3.8	3.8			3.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
6	3.9	3.9	3.9	3.9			3.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
7	3.8	3.8	3.8	3.8			3.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
8	3.8	3.8	3.8	3.8			3.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
9	3.8	3.8	3.8	3.8			3.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
10	3.8	3.8	3.8	3.8			3.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
11	3.8	3.8	3.8	3.8	3.8	0.0	3.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
12	3.8	3.8	3.8	3.8	3.8	0.0	3.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
13	3.9	3.9	3.9	3.8	3.8	0.0	3.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
14	3.8	3.8	3.8	3.8	3.8	0.0	3.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
15	3.8	3.8	3.8	3.8	3.8	0.0	3.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
16	3.9	3.9	3.9	3.8	3.8	0.0	3.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
17	3.8	3.8	3.8	3.8	3.8	0.0	3.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
18	3.9	3.9	3.9	3.8	3.8	0.0	3.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
19	3.8	3.8	3.8	3.8	3.8	0.0	3.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
20	3.8	3.8	3.8	3.8	3.8	0.0	3.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
21	5.8	5.8	5.8	4.0	4.0	(3.8)	5.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
22	7.9	7.9	7.9	4.2	4.2	(3.6)	5.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
23	7.9	7.9	7.9	4.6	4.6	(3.2)	7.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
24	8.0	8.0	8.0	5.1	5.1	(2.8)	7.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
25	7.9	7.9	7.9	5.5	5.5	(2.3)	7.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
26	7.8	7.8	7.8	5.9	5.9	(2.0)	7.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
27	7.7	7.7	7.7	6.2	6.2	(1.6)	7.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
28	7.8	7.8	7.8	6.6	6.6	(1.2)	7.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
29	7.7	7.7	7.7	7.0	7.0	(0.8)	7.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
30	7.7	7.7	7.7	7.4	7.4	(0.4)	7.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
31	7.8	7.8	7.8	7.6	7.6	(0.2)	7.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
TOTAL SFD	158.3	158.7	158.7	102.4	102.4	(21.4)	143.8	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
TOTAL AF	314.0	314.8	314.8	203.1	203.1	(42.4)	285.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Monthly totals are rounded to the nearest tenth of an acre foot.

1 - Minimum Flow Maintenance Requirement equals 11.5 cfs less 0.6 cfs CAP Credit carried over from 2011.

2 - In April 2012, Camp Pendleton requested that the District reduce remaining winter-time releases and postpone that portion of the winter-time releases until May and June. For April 12-23, 2012, the Flow Requirement was reduced from 10.9 cfs to 5.0 cfs; for April 24-30, the requirement was further reduced to 3.8 cfs. For April, the District has been credited with Climatic Credit as if they had released according to the original schedule. Flow Requirements in May and June were increased as follows: 7.8 cfs for May 21-31 and 7.3 cfs for June 1-18.

3 - Art. 7(b) not applicable for months of May through December.

4 - Art. 17 - Camp Pendleton rights to groundwater equal the Flow indicated in Section 5 of the CWRMA minus the Actual Flow Maintenance Requirement which cannot be less than 3.0 cfs. Input to groundwater account shown but cumulative balance did not increase due to account balance maximum of 5,000 AF.

APPENDIX E

SANTA MARGARITA RIVER WATERSHED COOPERATIVE WATER RESOURCE MANAGEMENT AGREEMENT REQUIRED FLOWS AND ACCOUNTS SANTA MARGARITA RIVER NEAR TEMECULA

JUNE 2012 - CRITICALLY DRY YEAR

DAY	USGS Daily				10-Day Running		Minimum Flow		Running		WR-34 Make-Up		Climatic Credits		GROUNDWATER ACCOUNT BALANCE			
	USGS Official	USGS Daily	Average of	Website	Discharge	Website	Requirement	1/1, 2/	Average Less	Required Flow	Discharge	AF	Earned 3/	AF	Input 4/	Output	Output	Cumulative
	Discharge	Discharge	Discharge	Discharge	cfs	Discharge	cfs	cfs	cfs	cfs	cfs	AF	cfs	AF	AF	cfs	AF	GW Account Balance
1	7.3	7.3	7.3	7.3	7.3	7.3	7.3				7.1	14.1	0.0	0.0	0.0	0.0	0.0	5,000.0
2	7.4	7.4	7.4	7.4	7.4	7.4	7.4				7.1	14.0	0.0	0.0	0.0	0.0	0.0	5,000.0
3	7.3	7.3	7.3	7.3	7.3	7.3	7.3				7.0	13.9	0.0	0.0	0.0	0.0	0.0	5,000.0
4	7.3	7.3	7.3	7.3	7.3	7.3	7.3				7.0	13.8	0.0	0.0	0.0	0.0	0.0	5,000.0
5	7.3	7.3	7.3	7.3	7.3	7.3	7.3				7.0	13.8	0.0	0.0	0.0	0.0	0.0	5,000.0
6	7.2	7.2	7.2	7.2	7.2	7.2	7.2				6.9	13.6	0.0	0.0	0.0	0.0	0.0	5,000.0
7	7.3	7.3	7.3	7.3	7.3	7.3	7.3				7.1	14.0	0.0	0.0	0.0	0.0	0.0	5,000.0
8	7.3	7.3	7.3	7.3	7.3	7.3	7.3				7.0	13.9	0.0	0.0	0.0	0.0	0.0	5,000.0
9	7.3	7.3	7.3	7.3	7.3	7.3	7.3				7.0	13.9	0.0	0.0	0.0	0.0	0.0	5,000.0
10	7.3	7.3	7.3	7.3	7.3	7.3	7.3				7.0	13.9	0.0	0.0	0.0	0.0	0.0	5,000.0
11	7.3	7.3	7.3	7.3	7.3	7.3	7.3			0.0	7.0	13.8	0.0	0.0	0.0	0.0	0.0	5,000.0
12	7.4	7.4	7.4	7.4	7.4	7.4	7.4			0.0	7.0	13.9	0.0	0.0	0.0	0.0	0.0	5,000.0
13	7.2	7.2	7.2	7.2	7.2	7.2	7.2			(0.0)	7.0	13.8	0.0	0.0	0.0	0.0	0.0	5,000.0
14	7.3	7.3	7.3	7.3	7.3	7.3	7.3			(0.0)	7.0	13.9	0.0	0.0	0.0	0.0	0.0	5,000.0
15	7.3	7.3	7.3	7.3	7.3	7.3	7.3			(0.0)	7.0	13.8	0.0	0.0	0.0	0.0	0.0	5,000.0
16	7.3	7.3	7.3	7.3	7.3	7.3	7.3			0.0	6.9	13.7	0.0	0.0	0.0	0.0	0.0	5,000.0
17	5.4	5.4	5.4	5.4	5.4	5.4	5.4			(0.2)	5.0	9.9	0.0	0.0	0.0	0.0	0.0	5,000.0
18	5.3	5.3	5.3	5.3	5.3	5.3	5.3			(0.4)	4.9	9.8	0.0	0.0	0.0	0.0	0.0	5,000.0
19	3.3	3.3	3.3	3.3	3.3	3.3	3.3			3.2	3.0	6.0	0.0	0.0	0.0	0.0	0.0	5,000.0
20	3.3	3.3	3.3	3.3	3.3	3.3	3.3			2.8	3.0	6.0	0.0	0.0	0.0	0.0	0.0	5,000.0
21	3.4	3.4	3.4	3.4	3.4	3.4	3.4			2.4	3.1	6.1	0.0	0.0	0.0	0.0	0.0	5,000.0
22	3.3	3.3	3.3	3.3	3.3	3.3	3.3			2.0	3.1	6.1	0.0	0.0	0.0	0.0	0.0	5,000.0
23	3.3	3.3	3.3	3.3	3.3	3.3	3.3			1.6	3.1	6.1	0.0	0.0	0.0	0.0	0.0	5,000.0
24	3.3	3.3	3.3	3.3	3.3	3.3	3.3			1.2	3.1	6.1	0.0	0.0	0.0	0.0	0.0	5,000.0
25	3.3	3.3	3.3	3.3	3.3	3.3	3.3			0.8	3.1	6.1	0.0	0.0	0.0	0.0	0.0	5,000.0
26	3.3	3.3	3.3	3.3	3.3	3.3	3.3			0.4	3.1	6.2	0.0	0.0	0.0	0.0	0.0	5,000.0
27	3.3	3.3	3.3	3.3	3.3	3.3	3.3			0.2	3.1	6.1	0.0	0.0	0.0	0.0	0.0	5,000.0
28	3.3	3.3	3.3	3.3	3.3	3.3	3.3			0.0	3.1	6.2	0.0	0.0	0.0	0.0	0.0	5,000.0
29	3.3	3.3	3.3	3.3	3.3	3.3	3.3			0.0	3.1	6.1	0.0	0.0	0.0	0.0	0.0	5,000.0
30	3.3	3.3	3.3	3.3	3.3	3.3	3.3			0.0	2.9	5.8	0.0	0.0	0.0	0.0	0.0	5,000.0
31	—	—	—	—	—	—	—			—	—	—	—	—	—	—	—	—
TOTAL SFD	167.2	167.2	112.2	167.2	98.0	14.2	158.5			0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	—
TOTAL AF	331.6	331.6	222.5	331.6	194.4	28.1	314.4			0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Monthly totals are rounded to the nearest tenth of an acre foot.

1 - Minimum Flow Maintenance Requirement equals 11.5 cfs less 0.6 cfs CAP Credit carried over from 2011.

2 - In April 2012, Camp Pendleton requested that the District reduce remaining winter-time releases and postpone that portion of the winter-time releases until May and June. For April 12-23, 2012, the Flow Requirement was reduced from 10.9 cfs to 5.0 cfs; for April 24-30, the requirement was further reduced to 3.8 cfs. For April, the District has been credited with Climatic Credit as if they had released according to the original schedule. Flow Requirements in May and June were increased as follows: 7.8 cfs for May 21-31 and 7.3 cfs for June 1-18.

3 - Art. 7(b) not applicable for months of May through December.

4 - Art. 17 - Camp Pendleton rights to groundwater equal the Flow indicated in Section 5 of the CWRMA minus the Actual Flow Maintenance Requirement which cannot be less than 3.0 cfs. Input to groundwater account shown but cumulative balance did not increase due to account balance maximum of 5,000 AF.

APPENDIX E

SANTA MARGARITA RIVER WATERSHED COOPERATIVE WATER RESOURCE MANAGEMENT AGREEMENT REQUIRED FLOWS AND ACCOUNTS SANTA MARGARITA RIVER NEAR TEMECULA

JULY 2012 - CRITICALLY DRY YEAR

DAY	10-Day Running										CAMP PENDLETON GROUNDWATER ACCOUNT BALANCE			
	USGS Official Discharge	USGS Daily Website Discharge	Average of Website Discharge	Minimum Flow Maintenance Requirement	Running Average Less Required Flow	WR-34 Make-Up Discharge	Climatic Credits Earned 1/	Input 2/ cfs	Input AF	Output cfs	Output AF	Cumulative GW Account Balance AF		
	cfs	cfs	cfs	cfs	cfs	cfs	cfs	AF	AF	AF	AF	AF		
1	3.0	3.0	3.0			2.8	0.0	0.0	0.0	0.0	0.0	5,000.0		
2	3.0	3.0	3.0			2.7	0.0	0.0	0.0	0.0	0.0	5,000.0		
3	3.0	3.0	3.0			2.7	0.0	0.0	0.0	0.0	0.0	5,000.0		
4	3.0	3.0	3.0			2.7	0.0	0.0	0.0	0.0	0.0	5,000.0		
5	3.0	3.0	3.0			2.7	0.0	0.0	0.0	0.0	0.0	5,000.0		
6	3.0	3.0	3.0			2.7	0.0	0.0	0.0	0.0	0.0	5,000.0		
7	3.0	3.0	3.0			2.7	0.0	0.0	0.0	0.0	0.0	5,000.0		
8	3.0	3.0	3.0			2.7	0.0	0.0	0.0	0.0	0.0	5,000.0		
9	3.0	3.0	3.0			2.8	0.0	0.0	0.0	0.0	0.0	5,000.0		
10	3.0	3.0	3.0			2.8	0.0	0.0	0.0	0.0	0.0	5,000.0		
11	3.0	3.0	3.0	3.0	0.0	2.9	0.0	0.0	0.0	0.0	0.0	5,000.0		
12	3.0	3.0	3.0	3.0	0.0	2.9	0.0	0.0	0.0	0.0	0.0	5,000.0		
13	3.1	3.1	3.0	3.0	0.0	2.9	0.0	0.0	0.0	0.0	0.0	5,000.0		
14	3.0	3.0	3.0	3.0	0.0	2.8	0.0	0.0	0.0	0.0	0.0	5,000.0		
15	3.0	3.0	3.0	3.0	0.0	2.8	0.0	0.0	0.0	0.0	0.0	5,000.0		
16	3.0	3.0	3.0	3.0	0.0	2.7	0.0	0.0	0.0	0.0	0.0	5,000.0		
17	3.5	3.5	3.1	3.0	0.1	3.1	0.0	0.0	0.0	0.0	0.0	5,000.0		
18	5.6	5.6	3.3	3.0	0.3	5.5	0.0	0.0	0.0	0.0	0.0	5,000.0		
19	2.0	2.0	3.2	3.0	0.2	2.0	0.0	0.0	0.0	0.0	0.0	5,000.0		
20	3.0	3.0	3.2	3.0	0.2	2.9	0.0	0.0	0.0	0.0	0.0	5,000.0		
21	3.0	3.0	3.2	3.0	0.2	2.9	0.0	0.0	0.0	0.0	0.0	5,000.0		
22	3.1	3.1	3.2	3.0	0.2	2.9	0.0	0.0	0.0	0.0	0.0	5,000.0		
23	3.1	3.1	3.2	3.0	0.2	2.9	0.0	0.0	0.0	0.0	0.0	5,000.0		
24	3.1	3.1	3.2	3.0	0.2	3.0	0.0	0.0	0.0	0.0	0.0	5,000.0		
25	3.2	3.2	3.3	3.0	0.3	3.0	0.0	0.0	0.0	0.0	0.0	5,000.0		
26	3.1	3.1	3.3	3.0	0.3	2.9	0.0	0.0	0.0	0.0	0.0	5,000.0		
27	3.0	3.0	3.2	3.0	0.2	2.9	0.0	0.0	0.0	0.0	0.0	5,000.0		
28	3.0	3.0	3.0	3.0	(0.0)	2.9	0.0	0.0	0.0	0.0	0.0	5,000.0		
29	3.1	3.1	3.1	3.0	0.1	2.9	0.0	0.0	0.0	0.0	0.0	5,000.0		
30	3.0	3.0	3.1	3.0	0.1	2.9	0.0	0.0	0.0	0.0	0.0	5,000.0		
31	3.0	3.0	3.1	3.0	0.1	2.9	0.0	0.0	0.0	0.0	0.0	5,000.0		
TOTAL SFD	95.9	95.9	65.7	63.0	2.7	89.7	0.0	0.0	0.0	0.0	0.0			
TOTAL AF	190.2	190.2	130.3	125.0	5.4	178.0	0.0	0.0	0.0	0.0	0.0			

Monthly totals are rounded to the nearest tenth of an acre foot.

1 - Art. 7(b) not applicable for months of May through December.

2 - Art. 17 - Camp Pendleton rights to groundwater equal the Flow indicated in Section 5 of the CWRMA minus the Actual Flow Maintenance Requirement which cannot be less than 3.0 cfs.
Input to groundwater account shown but cumulative balance did not increase due to account balance maximum of 5,000 AF.

APPENDIX E

SANTA MARGARITA RIVER WATERSHED COOPERATIVE WATER RESOURCE MANAGEMENT AGREEMENT REQUIRED FLOWS AND ACCOUNTS SANTA MARGARITA RIVER NEAR TEMECULA

AUGUST 2012 - CRITICALLY DRY YEAR

DAY	10-Day Running					CAMP PENDLETON					GROUNDWATER ACCOUNT BALANCE		
	USGS Official Discharge cfs	USGS Daily Website Discharge cfs	Average of Website Discharge cfs	Minimum Flow Maintenance Requirement cfs	Running Average Less Required Flow cfs	WR-34 Make-Up Discharge 1/ cfs	Climatic Credits Earned 2/ cfs	AF	Input 3/ cfs	Input AF	Output cfs	Output AF	Cumulative GW Account Balance AF
1	3.0	3.0	3.0			2.9	5.7	0.0	0.0	0.0	0.0	0.0	5,000.0
2	3.0	3.0	3.0			2.9	5.7	0.0	0.0	0.0	0.0	0.0	5,000.0
3	3.0	3.0	3.0			2.9	5.8	0.0	0.0	0.0	0.0	0.0	5,000.0
4	3.0	3.0	3.0			2.9	5.8	0.0	0.0	0.0	0.0	0.0	5,000.0
5	3.0	3.0	3.0			2.8	5.6	0.0	0.0	0.0	0.0	0.0	5,000.0
6	3.1	3.1	3.1			2.9	5.7	0.0	0.0	0.0	0.0	0.0	5,000.0
7	3.1	3.1	3.1			2.9	5.8	0.0	0.0	0.0	0.0	0.0	5,000.0
8	3.0	3.0	3.0			2.8	5.5	0.0	0.0	0.0	0.0	0.0	5,000.0
9	3.0	3.0	3.0			2.8	5.5	0.0	0.0	0.0	0.0	0.0	5,000.0
10	3.0	3.0	3.0			2.8	5.5	0.0	0.0	0.0	0.0	0.0	5,000.0
11	3.0	3.0	3.0	3.0	0.0	2.8	5.5	0.0	0.0	0.0	0.0	0.0	5,000.0
12	2.9	2.9	2.9	3.0	0.0	2.8	5.5	0.0	0.0	0.0	0.0	0.0	5,000.0
13	2.9	2.9	2.9	3.0	0.0	2.8	5.5	0.0	0.0	0.0	0.0	0.0	5,000.0
14	3.0	3.0	3.0	3.0	0.0	2.9	5.8	0.0	0.0	0.0	0.0	0.0	5,000.0
15	3.0	3.0	3.0	3.0	0.0	2.9	5.8	0.0	0.0	0.0	0.0	0.0	5,000.0
16	3.0	3.0	3.0	3.0	0.0	2.9	5.8	0.0	0.0	0.0	0.0	0.0	5,000.0
17	3.1	3.1	3.1	3.0	0.0	2.9	5.8	0.0	0.0	0.0	0.0	0.0	5,000.0
18	3.1	3.1	3.1	3.0	0.0	2.9	5.8	0.0	0.0	0.0	0.0	0.0	5,000.0
19	3.1	3.1	3.1	3.0	0.0	3.0	5.9	0.0	0.0	0.0	0.0	0.0	5,000.0
20	3.0	3.0	3.0	3.0	0.0	3.0	5.9	0.0	0.0	0.0	0.0	0.0	5,000.0
21	3.0	3.0	3.0	3.0	0.0	3.0	6.0	0.0	0.0	0.0	0.0	0.0	5,000.0
22	3.1	3.1	3.1	3.0	0.0	3.0	5.9	0.0	0.0	0.0	0.0	0.0	5,000.0
23	3.1	3.1	3.1	3.1	0.1	2.9	5.8	0.0	0.0	0.0	0.0	0.0	5,000.0
24	3.0	3.0	3.0	3.1	0.0	2.8	5.6	0.0	0.0	0.0	0.0	0.0	5,000.0
25	3.0	3.0	3.0	3.1	0.0	2.8	5.6	0.0	0.0	0.0	0.0	0.0	5,000.0
26	3.0	3.0	3.0	3.1	0.1	2.8	5.6	0.0	0.0	0.0	0.0	0.0	5,000.0
27	3.0	3.0	3.0	3.0	0.0	3.1	6.1	0.0	0.0	0.0	0.0	0.0	5,000.0
28	3.1	3.1	3.1	3.0	0.0	3.4	6.8	0.0	0.0	0.0	0.0	0.0	5,000.0
29	3.0	3.0	3.0	3.0	0.0	3.3	6.6	0.0	0.0	0.0	0.0	0.0	5,000.0
30	2.9	2.9	2.9	3.0	0.0	2.8	5.6	0.0	0.0	0.0	0.0	0.0	5,000.0
31	3.0	3.0	3.0	3.0	0.0	2.8	5.6	0.0	0.0	0.0	0.0	0.0	5,000.0
TOTAL SFD	93.5	93.5	63.4	63.0	0.4	90.3		0.0	0.0		0.0		
TOTAL AF	185.5	185.5	125.8	125.0	0.8	179.1		0.0	0.0		0.0		

Monthly totals are rounded to the nearest tenth of an acre foot.

1 - From August 6-19, 2012, and from November 19-December 12, 2012, the District conducted flow tests in which the instantaneous release rate at WR-34 varied from 0 to 13 cfs throughout the day. However, the average daily release rate remained at 3.0 cfs.

2 - Art. 7(b) not applicable for months of May through December.

3 - Art. 17 - Camp Pendleton rights to groundwater equal the Flow indicated in Section 5 of the CWRMA minus the Actual Flow Maintenance Requirement which cannot be less than 3.0 cfs. Input to groundwater account shown but cumulative balance did not increase due to account balance maximum of 5,000 AF.

APPENDIX E

COOPERATIVE WATER RESOURCE MANAGEMENT AGREEMENT REQUIRED FLOWS AND ACCOUNTS SANTA MARGARITA RIVER NEAR TEMECULA SANTA MARGARITA RIVER WATERSHED

SEPTEMBER 2012 - CRITICALLY DRY YEAR

DAY	10-Day Running										CAMP PENDLETON			
	USGS Official		USGS Daily		Average of		Minimum Flow		Running		WR-34 Make-Up		Climatic Credits	
	Discharge	cfs	Website	cfs	Website	cfs	Requirement	cfs	Average Less	cfs	Discharge	AF	Earned 1/	AF
1	3.0		3.0		3.0						2.9	5.7	0.0	0.0
2	3.0		3.0		3.0						2.9	5.8	0.0	0.0
3	3.0		3.0		3.0						2.9	5.8	0.0	0.0
4	3.0		3.0		3.0						3.0	5.9	0.0	0.0
5	3.0		3.0		3.0						3.1	6.1	0.0	0.0
6	3.0		3.0		3.0						3.0	6.0	0.0	0.0
7	3.0		3.0		3.0						3.1	6.1	0.0	0.0
8	3.0		3.0		3.0						3.0	6.0	0.0	0.0
9	3.0		3.0		3.0						3.0	5.9	0.0	0.0
10	3.0		3.0		3.0						3.0	6.0	0.0	0.0
11	3.0		3.0		3.0						3.0	6.0	0.0	0.0
12	3.0		3.0		3.0						2.9	5.8	0.0	0.0
13	3.0		3.0		3.0						2.9	5.8	0.0	0.0
14	3.0		3.0		3.0						3.0	5.9	0.0	0.0
15	2.9		2.9		2.9						3.0	5.9	0.0	0.0
16	3.0		3.0		3.0						3.1	6.1	0.0	0.0
17	3.0		3.0		3.0						3.1	6.1	0.0	0.0
18	3.0		3.0		3.0						3.1	6.1	0.0	0.0
19	3.0		3.0		3.0						3.0	6.0	0.0	0.0
20	3.0		3.0		3.0						3.1	6.2	0.0	0.0
21	3.0		3.0		3.0						3.1	6.1	0.0	0.0
22	3.0		3.0		3.0						3.1	6.1	0.0	0.0
23	3.0		3.0		3.0						3.1	6.1	0.0	0.0
24	3.0		3.0		3.0						3.1	6.2	0.0	0.0
25	3.1		3.1		3.1						3.1	6.1	0.0	0.0
26	3.0		3.0		3.0						3.1	6.1	0.0	0.0
27	3.0		3.0		3.0						3.1	6.2	0.0	0.0
28	3.0		3.0		3.0						3.1	6.2	0.0	0.0
29	3.0		3.0		3.0						3.1	6.2	0.0	0.0
30	3.0		3.0		3.0						3.1	6.2	0.0	0.0
31	—		—		—						—	—	—	—
TOTAL SFD	90.0		90.0		60.0		60.0		(0.0)		91.1		0.0	0.0
TOTAL AF	178.5		178.5		118.9		119.0		(0.1)		180.6		0.0	0.0

Monthly totals are rounded to the nearest tenth of an acre foot.

1 - Art. 7(b) not applicable for months of May through December.

2 - Art. 17 - Camp Pendleton rights to groundwater equal the Flow indicated in Section 5 of the CWRMA minus the Actual Flow Maintenance Requirement which cannot be less than 3.0 cfs. Input to groundwater account shown but cumulative balance did not increase due to account balance maximum of 5,000 AF.

APPENDIX E

SANTA MARGARITA RIVER WATERSHED COOPERATIVE WATER RESOURCE MANAGEMENT AGREEMENT REQUIRED FLOWS AND ACCOUNTS SANTA MARGARITA RIVER NEAR TEMECULA

OCTOBER 2012 - CRITICALLY DRY YEAR

DAY	10-Day Running					CAMP PENDLETON					GROUNDWATER ACCOUNT BALANCE				
	USGS Official Discharge cfs	USGS Daily Website Discharge cfs	Average of Website Discharge cfs	Minimum Flow Maintenance Requirement cfs	Running Average Less Required Flow cfs	WR-34 Make-Up Discharge cfs	Climatic Credits Earned 1/ cfs	Input 2/ cfs	Input AF	Output cfs	Output AF	Cumulative GW Account Balance AF			
1	3.0	3.0	3.0			3.1	6.2	0.0	0.0	0.0	0.0	5,000.0			
2	3.0	3.0	3.0			3.1	6.1	0.0	0.0	0.0	0.0	5,000.0			
3	3.0	3.0	3.0			3.1	6.2	0.0	0.0	0.0	0.0	5,000.0			
4	3.0	3.0	3.0			3.1	6.2	0.0	0.0	0.0	0.0	5,000.0			
5	3.1	3.1	3.1			3.1	6.1	0.0	0.0	0.0	0.0	5,000.0			
6	3.1	3.1	3.1			3.1	6.1	0.0	0.0	0.0	0.0	5,000.0			
7	3.1	3.1	3.1			3.1	6.1	0.0	0.0	0.0	0.0	5,000.0			
8	3.1	3.1	3.1			3.0	6.0	0.0	0.0	0.0	0.0	5,000.0			
9	3.0	3.0	3.0			3.0	5.9	0.0	0.0	0.0	0.0	5,000.0			
10	3.2	3.2	3.2			2.9	5.8	0.0	0.0	0.0	0.0	5,000.0			
11	3.4	3.4	3.4			2.4	4.7	0.0	0.0	0.0	0.0	5,000.0			
12	3.0	3.0	3.0	3.0	0.1	2.7	5.4	0.0	0.0	0.0	0.0	5,000.0			
13	3.0	3.0	3.0	3.0	0.1	2.8	5.5	0.0	0.0	0.0	0.0	5,000.0			
14	3.0	3.0	3.0	3.0	0.1	2.8	5.6	0.0	0.0	0.0	0.0	5,000.0			
15	3.0	3.0	3.0	3.0	0.1	2.8	5.6	0.0	0.0	0.0	0.0	5,000.0			
16	3.0	3.0	3.0	3.0	0.1	2.8	5.6	0.0	0.0	0.0	0.0	5,000.0			
17	3.0	3.0	3.0	3.0	0.1	2.8	5.6	0.0	0.0	0.0	0.0	5,000.0			
18	3.0	3.0	3.0	3.0	0.1	2.8	5.5	0.0	0.0	0.0	0.0	5,000.0			
19	3.3	3.3	3.3	3.0	0.1	3.0	5.9 *	0.0	0.0	0.0	0.0	5,000.0			
20	3.7	3.7	3.7	3.0	0.1	3.0	6.0 **	0.0	0.0	0.0	0.0	5,000.0			
21	3.2	3.2	3.2	3.0	0.2	3.0	6.0 **	0.0	0.0	0.0	0.0	5,000.0			
22	3.0	3.0	3.0	3.0	0.2	2.8	5.6 **	0.0	0.0	0.0	0.0	5,000.0			
23	3.0	3.0	3.0	3.0	0.2	2.8	5.6 **	0.0	0.0	0.0	0.0	5,000.0			
24	3.0	3.0	3.0	3.0	0.2	2.8	5.6 **	0.0	0.0	0.0	0.0	5,000.0			
25	3.0	3.0	3.0	3.0	0.2	2.8	5.6 **	0.0	0.0	0.0	0.0	5,000.0			
26	3.0	3.0	3.0	3.0	0.2	2.8	5.6 **	0.0	0.0	0.0	0.0	5,000.0			
27	3.0	3.0	3.0	3.0	0.2	2.8	5.6 ***	0.0	0.0	0.0	0.0	5,000.0			
28	2.9	2.9	2.9	3.0	0.2	2.8	5.6	0.0	0.0	0.0	0.0	5,000.0			
29	3.0	3.0	3.0	3.0	0.1	2.8	5.6	0.0	0.0	0.0	0.0	5,000.0			
30	3.0	3.0	3.0	3.0	0.1	2.8	5.6	0.0	0.0	0.0	0.0	5,000.0			
31	3.0	3.0	3.0	3.0	(0.0)	2.8	5.6	0.0	0.0	0.0	0.0	5,000.0			
TOTAL SFD	95.6	95.6	65.5	63.0	2.5	89.8	0.0	0.0	0.0	0.0	0.0				
TOTAL AF	189.6	189.6	129.8	125.0	4.9	178.1	0.0	0.0	0.0	0.0	0.0				

Monthly totals are rounded to the nearest tenth of an acre foot.

1 - Art. 7(b) not applicable for months of May through December.

2 - Art. 17 - Camp Pendleton rights to groundwater equal the Flow indicated in Section 5 of the CWRMA minus the Actual Flow Maintenance Requirement which cannot be less than 3.0 cfs.

* Input to groundwater account shown but cumulative balance did not increase due to account balance maximum of 5,000 AF.

** 3.4 AF supplied from WR-34 and 2.5 AF supplied from potable connection to WR-34 because of MWD operational shutdown.

*** Discharge supplied from potable connection to WR-34 because of MWD operational shutdown.

*** 3.1 AF supplied from potable connection to WR-34 because of MWD operational shutdown. Total supplied from potable connection for Oct. 19-27 was 45.0 AF.

APPENDIX E

SANTA MARGARITA RIVER WATERSHED COOPERATIVE WATER RESOURCE MANAGEMENT AGREEMENT REQUIRED FLOWS AND ACCOUNTS SANTA MARGARITA RIVER NEAR TEMECULA

NOVEMBER 2012 - CRITICALLY DRY YEAR

DAY	GROUNDWATER ACCOUNT BALANCE										CAMP PENDLETON GROUNDWATER ACCOUNT BALANCE									
	USGS					10-Day Running					Input 3/					Output				
	Official	Discharge	USGS Daily	Average of	Minimum Flow	Running	WR-34 Make-Up	Climatic Credits	Input 3/		Output		Input 3/		Output		Input 3/		Output	
	cfs	cfs	Website	Website	Requirement	Average Less	Discharge 1/	Earned 2/	cfs	AF	cfs	AF	cfs	AF	cfs	AF	cfs	AF	cfs	AF
1	3.0	3.0	3.0	3.0			2.8	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
2	3.0	3.0	3.0	3.0			2.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
3	3.0	3.0	3.0	3.0			2.8	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
4	3.0	3.0	3.0	3.0			2.8	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
5	2.9	2.9	3.0	2.9			2.8	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
6	3.0	3.0	3.0	3.0			2.9	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
7	3.0	3.0	3.0	3.0			2.9	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
8	3.1	3.1	3.0	3.1			2.8	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
9	3.0	3.0	3.0	3.0			2.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
10	3.0	3.0	3.0	3.0			2.8	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
11	3.0	3.0	3.0	3.0		0.0	2.8	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
12	3.0	3.0	3.0	3.0		0.0	2.8	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
13	3.0	3.0	3.0	3.0		0.0	2.8	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
14	3.0	3.0	3.0	3.0		0.0	2.8	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
15	3.1	3.1	3.0	3.1		0.0	2.8	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
16	3.0	3.0	3.0	3.0		0.0	2.8	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
17	3.0	3.0	3.0	3.0		0.0	2.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
18	3.0	3.0	3.0	3.0		0.0	2.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
19	3.1	3.1	3.0	3.1		0.0	2.8	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
20	3.0	3.0	3.0	3.0		0.0	2.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
21	2.9	2.9	2.9	2.9		0.0	2.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
22	2.9	2.9	2.9	2.9		0.0	2.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
23	3.2	3.2	3.0	3.2		0.0	2.9	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
24	3.2	3.2	3.0	3.2		0.0	2.9	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
25	2.9	2.9	2.9	2.9		0.0	2.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
26	2.9	2.9	2.9	2.9		0.0	2.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
27	3.0	3.0	3.0	3.0		0.0	2.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
28	3.1	3.1	3.0	3.1		0.0	2.8	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
29	3.0	3.0	3.0	3.0		0.0	2.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
30	3.0	3.0	3.0	3.0		0.0	2.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0
31	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---
TOTAL SFD	90.3	90.3	60.3	60.3	60.0	0.3	82.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	---
TOTAL AF	179.1	179.1	119.5	119.5	119.0	0.5	163.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	---

Monthly totals are rounded to the nearest tenth of an acre foot.

1 - From August 6-19, 2012, and from November 19-December 12, 2012, the District conducted flow tests in which the instantaneous release rate at WR-34 varied from 0 to 13 cfs throughout the day. However, the average daily release rate remained at 3.0 cfs.

2 - Art. 7(b) not applicable for months of May through December.

3 - Art. 17 - Camp Pendleton rights to groundwater equal the Flow indicated in Section 5 of the CWRMA minus the Actual Flow Maintenance Requirement which cannot be less than 3.0 cfs. Input to groundwater account shown but cumulative balance did not increase due to account balance maximum of 5,000 AF.

APPENDIX E

SANTA MARGARITA RIVER WATERSHED COOPERATIVE WATER RESOURCE MANAGEMENT AGREEMENT REQUIRED FLOWS AND ACCOUNTS SANTA MARGARITA RIVER NEAR TEMECULA

DECEMBER 2012 - CRITICALLY DRY YEAR

CAMP PENDLETON GROUNDWATER ACCOUNT BALANCE														
DAY	10-Day Running					WR-34 Make-Up Discharge 1/ cfs	Climatic Credits Earned 2/ AF	Input 3/ cfs	Input AF	Output cfs	Output AF	Cumulative GW Account Balance AF		
	USGS Official Discharge cfs	USGS Daily Website Discharge cfs	Average of Website Discharge cfs	Minimum Flow Maintenance Requirement cfs	Running Average Less Required Flow cfs									
1	3.6	3.6	3.6			3.2	6.3	0.0	0.0	0.0	0.0	5,000.0		
2	3.1	3.1	3.1			2.8	5.5	0.0	0.0	0.0	0.0	5,000.0		
3	3.4	3.4	3.4			3.0	6.0	0.0	0.0	0.0	0.0	5,000.0		
4	3.4	3.4	3.4			3.1	6.1	0.0	0.0	0.0	0.0	5,000.0		
5	3.2	3.2	3.2			2.9	5.8	0.0	0.0	0.0	0.0	5,000.0		
6	3.3	3.3	3.3			2.9	5.8	0.0	0.0	0.0	0.0	5,000.0		
7	3.4	3.4	3.4			3.0	6.0	0.0	0.0	0.0	0.0	5,000.0		
8	3.2	3.2	3.2			2.9	5.8	0.0	0.0	0.0	0.0	5,000.0		
9	3.3	3.3	3.3			3.0	6.0	0.0	0.0	0.0	0.0	5,000.0		
10	3.3	3.3	3.3			3.0	6.0	0.0	0.0	0.0	0.0	5,000.0		
11	3.4	3.4	3.4	3.3	0.0	3.0	6.0	0.0	0.0	0.0	0.0	5,000.0		
12	3.3	3.3	3.3	3.3	0.0	3.1	6.1	0.0	0.0	0.0	0.0	5,000.0		
13	195.0	195.0	195.0	3.3	19.2	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0		
14	90.0	90.0	90.0	3.3	27.8	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0		
15	14.0	14.0	14.0	3.3	28.9	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0		
16	3.1	3.1	3.1	3.3	28.9	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0		
17	6.4	6.4	6.4	3.3	29.2	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0		
18	7.6	7.6	7.6	3.3	29.6	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0		
19	4.9	4.9	4.9	3.3	29.8	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0		
20	3.0	3.0	3.0	3.3	29.8	2.0	3.9	0.0	0.0	0.0	0.0	5,000.0		
21	3.6	3.6	3.6	3.3	29.8	2.8	5.6	0.0	0.0	0.0	0.0	5,000.0		
22	3.4	3.4	3.4	3.3	29.8	2.7	5.3	0.0	0.0	0.0	0.0	5,000.0		
23	3.4	3.4	3.4	3.3	10.6	2.7	5.4	0.0	0.0	0.0	0.0	5,000.0		
24	3.3	3.3	3.3	3.3	2.0	2.4	4.8	0.0	0.0	0.0	0.0	5,000.0		
25	3.3	3.3	3.3	3.3	0.9	2.5	5.0	0.0	0.0	0.0	0.0	5,000.0		
26	8.2	8.2	8.2	3.3	1.4	2.3	4.6	0.0	0.0	0.0	0.0	5,000.0		
27	8.7	8.7	8.7	3.3	1.6	0.7	1.3	0.0	0.0	0.0	0.0	5,000.0		
28	1.1	1.1	1.1	3.3	1.0	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0		
29	1.3	1.3	1.3	3.3	0.6	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0		
30	24.0	24.0	24.0	3.3	2.7	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0		
31	9.4	9.4	9.4	3.3	3.3	0.0	0.0	0.0	0.0	0.0	0.0	5,000.0		
TOTAL SFD	433.6	433.6	376.4	69.3	307.1	54.1		0.0		0.0				
TOTAL AF	860.0	860.0	746.5	137.5	609.1	107.3		0.0	0.0			0.0		

Monthly totals are rounded to the nearest tenth of an acre foot.

1 - From August 6-19, 2012, and from November 19-December 12, 2012, the District conducted flow tests in which the instantaneous release rate at WR-34 varied from 0 to 13 cfs throughout the day. However, the average daily release rate remained at 3.0 cfs.

2 - Art. 7(b) not applicable for months of May through December.

3 - Art. 17 - Camp Pendleton rights to groundwater equal the Flow indicated in Section 5 of the CWRMA minus the Actual Flow Maintenance Requirement which cannot be less than 3.0 cfs. Input to groundwater account shown but cumulative balance did not increase due to account balance maximum of 5,000 AF.

SANTA MARGARITA RIVER WATERSHED
ANNUAL WATERMASTER REPORT
WATER YEAR 2011-12

APPENDIX F

**ANNUAL REPORT ISSUES SUBORDINATED
DURING EFFECTIVE PERIOD OF THE
COOPERATIVE WATER RESOURCE
MANAGEMENT AGREEMENT**

July 2013

APPENDIX F

SANTA MARGARITA RIVER WATERSHED

ANNUAL REPORT ISSUES SUBORDINATED DURING EFFECTIVE PERIOD OF THE COOPERATIVE WATER RESOURCE MANAGEMENT AGREEMENT

Introduction

Prior to implementation of the Cooperative Water Resource Management Agreement (CWRMA) entered into by Rancho California Water District (RCWD) and the United States on behalf of Camp Pendleton, there were contentions raised by Camp Pendleton each year, with respect to various aspects of the Annual Watermaster Report. These contentions are settled so long as CWRMA is in effect. Accordingly, there is no need to raise those particular issues or publish them in the main text of the annual report or in related correspondence.

However, the respective positions on these issues need to be preserved and protected from any finding of waiver, and there is a need to continue to collect related data in the event of need in the future.

Therefore, the applicable textual material in the previous annual reports and related comments and responses have been gathered here for preservation and maintenance of rights, with the understanding that the previous annual exchange of applicable contentions in the process of preparing the annual report is no longer necessary.

Issues Reserved

Section 3, Surface Water Availability and Use: In the absence of CWRMA implementation, Camp Pendleton disputes the method of calculation used in the annual report in Subsection 3.2 (Surface Water Diversions) and Table 3.3 (Surface Water Diversions to Storage) for presentation of the information regarding Vail Lake and further asserts its belief that the Vail Dam impoundment fails to comply with the 1940 Stipulated Judgment.

Section 4, Subsurface Water Availability and Use: In the absence of CWRMA implementation, and with respect to Figure 4.1 (Water Level Elevations – Windmill Well) and to Subsections 4.3 (Water Levels) and 4.4 (Groundwater Storage), Camp Pendleton is concerned about the apparent excessive pumping in the Upper Basin, and further asserts its belief that the lengthy and significant drawdown and concomitant loss in storage adversely affect the water supply for adjacent and downstream users holding senior water rights.

Section 7, Water Production and Use: First, in the absence of CWRMA implementation, and with regard to the local production figures shown in Table 7.1 (Water Production and Use), Camp Pendleton is concerned about the high level of groundwater production from the Upper Basin, a level that Camp Pendleton believes to be substantially greater than the safe yield.

Second, in the absence of CWRMA implementation, and with regard to Footnote 4 of Table 7.1 (distinction between RCWD pumping of older alluvium water and of Vail recovery water), Camp Pendleton has serious reservations as to the accounting system that is being used as well as the legal and technical bases upon which such system has been formulated.


Third, in the absence of CWRMA implementation, and as to the RCWD part of Subsection 7.2 (Water Purveyors), Camp Pendleton has serious reservations as to the accounting system that is being used as well as the legal and technical bases upon which such system has been formulated. These reservations include the following:

1. As to the “Vail Appropriation” part: *Representatives of the United States contend that under the 1940 Stipulated Judgment storage of water in Vail Lake is limited to Rancho California Water District’s share of the flood waters of the Santa Margarita River system. However, to date, the parties have not agreed on a definition of “flood waters.”*
2. As to the “Division of Local Water” part: *In 1995 well logs and geophysical logs of all Rancho California WD wells were reviewed by representatives of the United States and Rancho California WD to determine the depths of the younger alluvium. There was general agreement between the parties about the depth of the younger alluvium in production wells, except for ten wells shown on Table 7.7 of the 1994-95 report. The remaining disagreements relate to differences about the magnitude of the clay layer needed to define the base of the younger alluvium, the importance of neighboring well logs, and general concepts about overall geologic setting.*

Section 8, Unauthorized Water Use: In the absence of CWRMA implementation, and with respect to water use by RCWD, Camp Pendleton asserts the following:

1. Such use is in violation of the 1940 Stipulated Judgment by reason of, among other things, Vail Lake operations in excess of entitlement and pumping from both younger and older alluvium in excess of entitlement, which contentions RCWD disputes;
2. Rediversion and use of water impounded by Vail Dam are not in accord with terms of Permit 7032;
3. Unauthorized pumping is being done, including pumping from the younger alluvium outside of Pauba Valley without a permit and pumping from the older alluvium in violation of Court adjudications.

Section 9, Threats to Water Supply: In the absence of CWRMA implementation, and with respect to Subsection 9.3 (Potential Overdraft Conditions) and as noted in the foregoing comments to Sections 4 and 7, Camp Pendleton is seriously concerned regarding the apparent excessive pumping in the Upper Basin.



Major Water Purveyors

Santa Margarita River Watershed Watermaster

