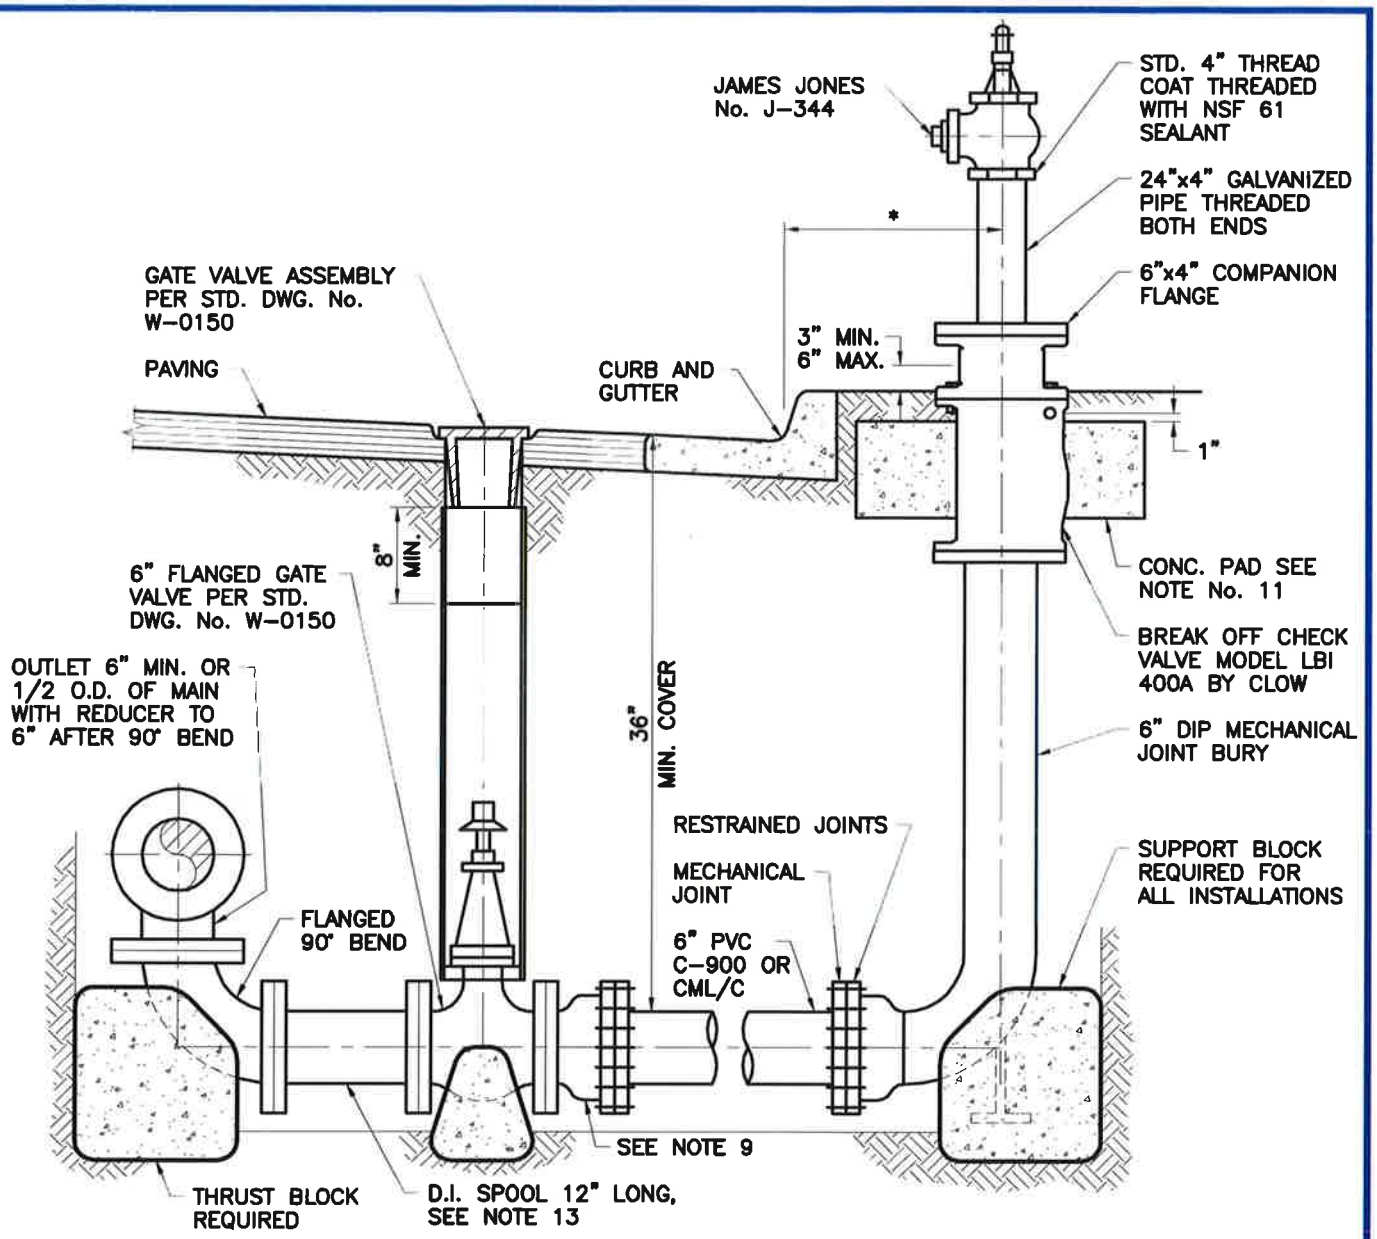

NOTES:

1. ALL MATERIALS SHALL BE CLASS 150 (MINIMUM).
2. NON-OXIDE GREASE AND POLY PLASTIC WRAP ALL FITTINGS AND VALVES.
3. REPAIR PIPE COATING WITH APPROVED MATERIAL OF SIMILAR NATURE.
4. IN UNPAVED AREAS, GATE VALVE RISER AND CAP SHALL BE INSTALLED 3" ABOVE GRADE.
5. HOSE THREADS TO BE NATIONAL STANDARD.
6. SET WARFHEAD OUTLET AT 90° TO CURB.
7. ALL SUPPORT BLOCKS TO BE POURED AGAINST UNDISTURBED EARTH. USE CONCRETE PER WESTERN STANDARD.
8. PAINT ALL MATERIAL ABOVE GRADE WITH PRIMER AND TWO COATS OF SAFETY YELLOW PER APPROVED MATERIALS LIST.
9. RESTRAINED FLANGE COUPLING ADAPTER.
10. FOR TEMPORARY ADD VALVE UP STREAM AND BLIND FLANGE DOWNSTREAM.
11. CONSTRUCT A 3'x3'x8" CONCRETE PAD 1" BELOW SET SCREWS ON CHECK VALVE.
12. BOLTS TO BE TRIPAK BLUE 2000.
13. MAIN GREATER THAN 12" REQUIRES 24" SPOOL. MAIN GREATER THAN 36" TO BE DETERMINED IN FIELD.

* PER LOCAL AGENCY OR JURISDICTION.

WESTERN MUNICIPAL WATER DISTRICT	APPROVED DATE: 1/15/2020 DIRECTOR OF ENGINEERING	STANDARD DRAWING 4" BLOWOFF ASSEMBLY (ABOVE GROUND)	STD. DWG. NO. W-0214