


NOTES:

1. ALL PIPE & FITTINGS BETWEEN AND INCLUDING THE STOPS SHALL:
 - A) BE MADE OF BRASS OR BRONZE.
 - B) BE DESIGNED FOR MORE THAN 175 P.S.I. (COLD) WATER WORKING PRESSURE.
2. ALL BARE STEEL OR IRON SHALL BE COATED AND PROTECTED AS PER SPECS. PRIOR TO PLACING BACKFILL.
3. PRESSURE TEST PRIOR TO WRAPPING OR BACKFILLING.
4. THE BACKFLOW DEVICE SHOULD BE AS CLOSE AS PRACTICAL TO THE METER WITH NO OUTLET CONNECTIONS OR TEES BETWEEN.
5. UPON INSTALLATION AND PRIOR TO WATER DELIVERY, THE BACKFLOW PREVENTION ASSEMBLY SHALL BE TESTED AND CERTIFIED BY A TESTER POSSESSING A CERTIFICATE OF COMPETENCY ISSUED BY COUNTY DEPT. OF HEALTH, AND APPROVED BY WMWD. COMPLETED TEST REPORTS SHALL BE FORWARDED TO WMWD BACKFLOW PREVENTION PROGRAM DEPARTMENT. BACKFLOW PREVENTION ASSEMBLY TESTING IS REQUIRED ANNUALLY. ACCESS TO DEVICE FOR TESTING MUST BE MAINTAINED.

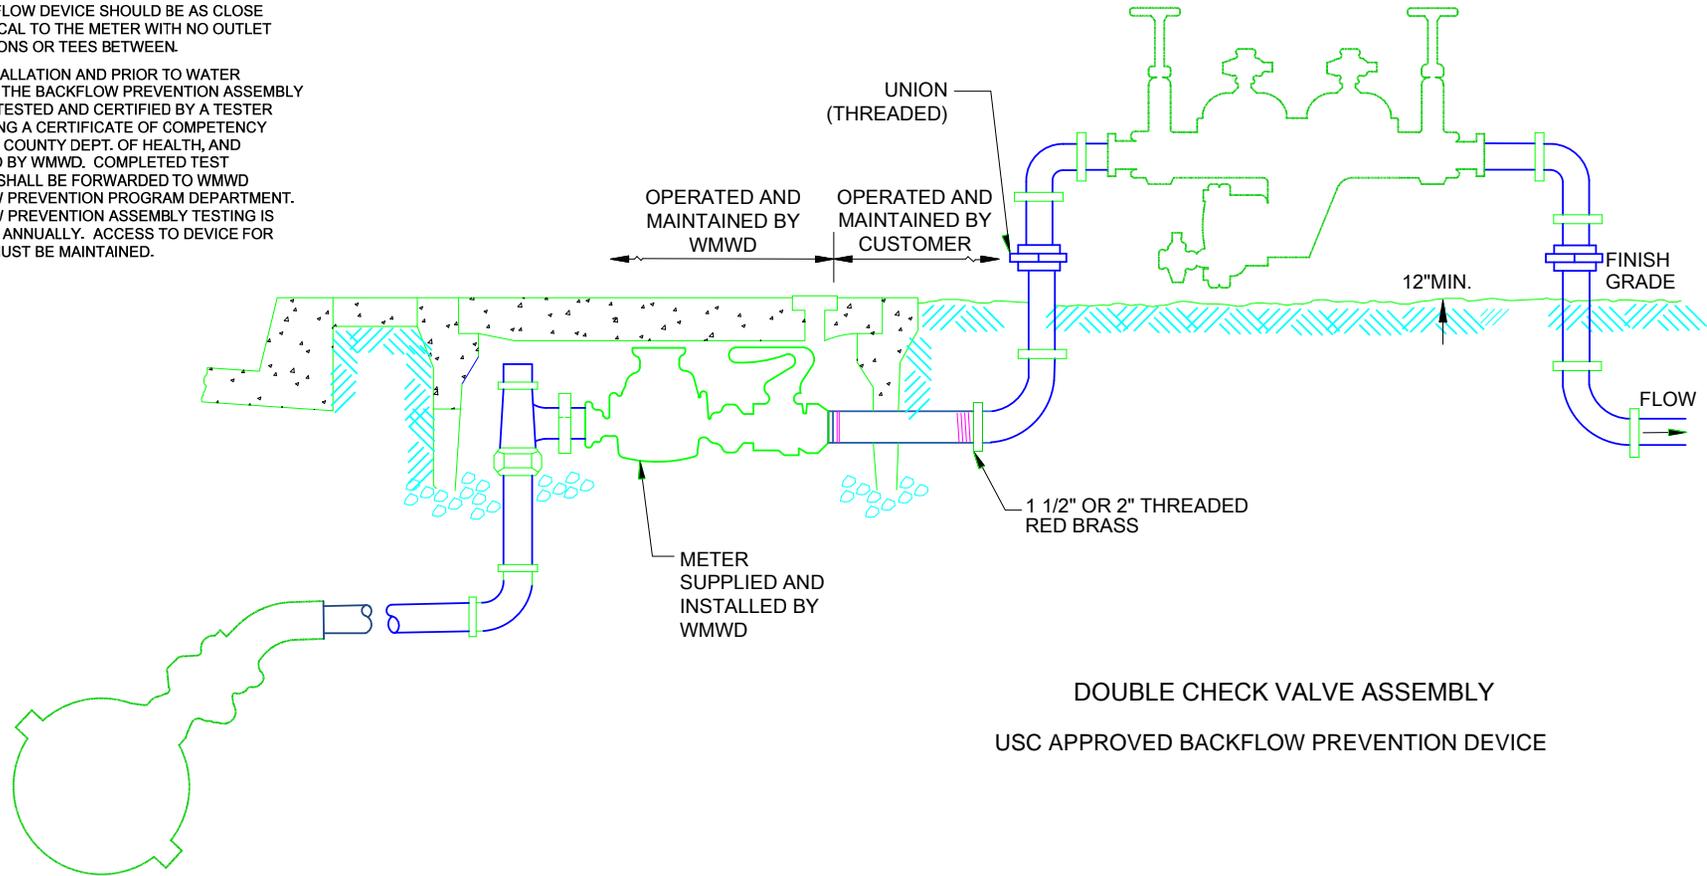

DO NOT USE

STANDARD DRAWING
2" METER AND SMALLER
BACKFLOW PREVENTION ASSY.

STD. DWG. NO.
W-0520

APPROVED DATE: January 1, 2011
Jay B. Beverly

DIRECTOR OF ENGINEERING

