


\* AGENCY OF LOCAL JURISDICTION



**NOTES:**

1. ALL STATIONS SHALL BE ENCLOSED IN A LOCKABLE, NONREMOVABLE, ALUMINUM-CAST HOUSING.
2. WHEN OPENED, THE STATION SHALL REQUIRE NO KEY FOR OPERATION, AND THE WATER WILL FLOW IN AN ALL BRASS WATERWAY.
3. ALL WORKING PARTS WILL BE OF BRASS AND SERVICEABLE FROM ABOVE GROUND WITH NO DIGGING.
4. A 1\"/>

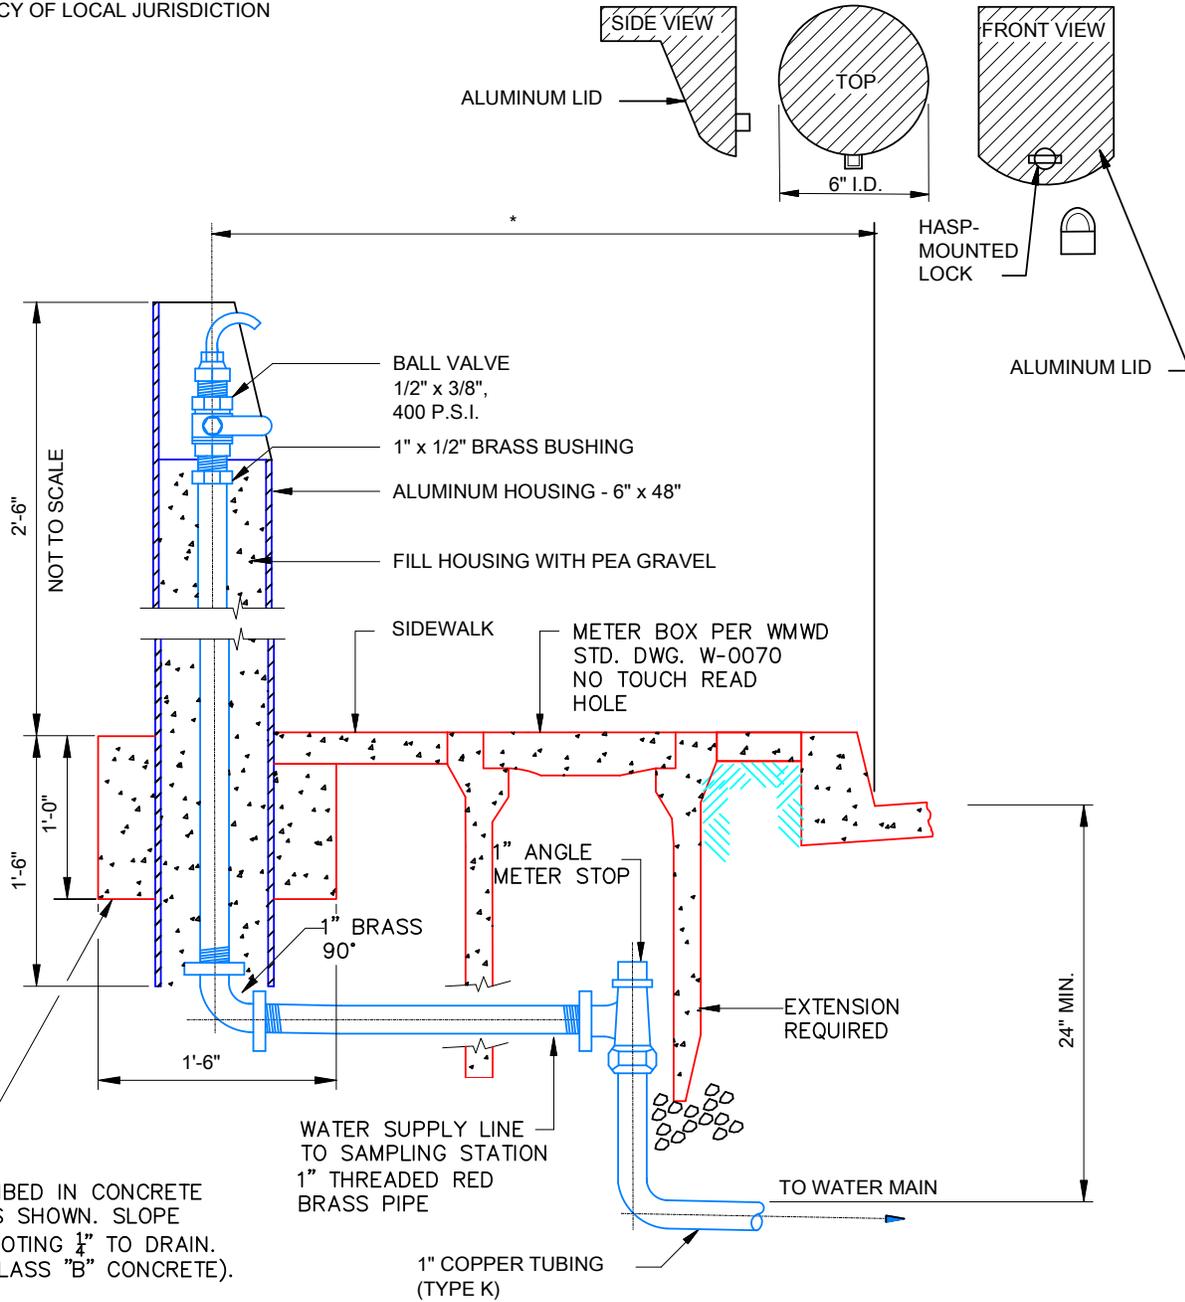

APPROVED DATE: January 1, 2011

*Joseph Brandy*  
 \_\_\_\_\_  
 DIRECTOR OF ENGINEERING

STANDARD DRAWING  
 WATER QUALITY  
 SAMPLING STATION

STD. DWG.  
 NO.

W-0680