


INSULATING FLANGE KIT



NOTE:

1. HARDWARE QUANTITIES IN INSULATING FLANGE KIT WILL VARY BASED ON GASKET PATTERN AND PIPE SIZE.
2. ISOLATION FLANGE MUST BE TESTED WITH ABOVE GROUND ISOLATER TESTER BY WESTERN INSPECTOR PRIOR TO BACKFILL.

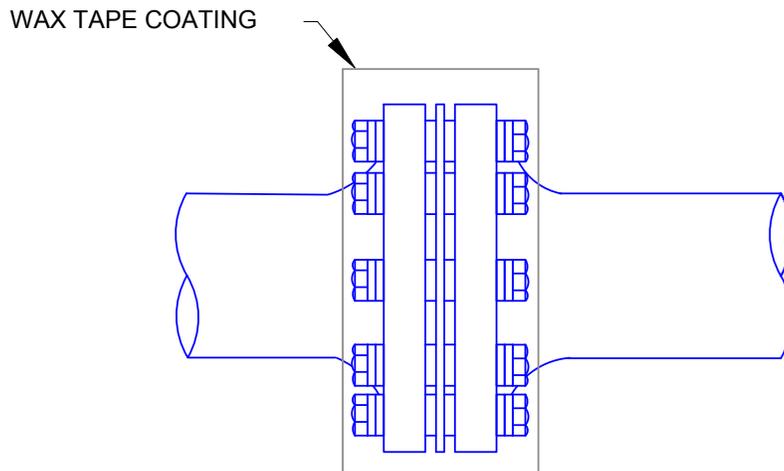

APPROVED DATE: January 1, 2011

Joseph Henrich

DIRECTOR OF ENGINEERING

STANDARD DRAWING
INSULATING FLANGE DETAIL

STD. DWG.
NO.

W-0820