


### MATERIALS LIST

ITEM	QTY	DESCRIPTION
①	1 ea	3" COMPOUND METER *
②	2 ea	4" GATE VALVES
③	1 ea	4" VICTAULIC COUPLING
④	1 ea	4"x 6" VICTAULIC NIP. w/3" METER FLANGE ***
⑤	1 ea	4"x 23" FLANGED x VICTAULIC NIPPLE
⑥	1 ea	4"x 22" FLG. SPOOL w/3" METER FLANGE ***
⑦	1 ea	4"x 24" FLANGED SPOOL
⑧	12 ft±	2" BRASS (RED)
⑨	2 ea	2" 90° BRASS THREADED
⑩	2 ea	4"x 2 1/2" SERVICE SADDLE w/2"x 2 1/2" REDUCING BRASS BUSHING
⑪	1 ea	4" BLIND FLANGE
⑫	1 ea	2" CURB STOP BRASS "Normally closed"
⑬	ft	4" C.M.L. & C. PIPE (Length to reach main line)
⑭	5 ea	4" FLANGE
⑮	1 ea	4'-0" x 4'-0" UTILITY BOX w/4" WALLS
⑯	1 ea **	TORSION SPRING ASSISTED TWO-PIECE STEEL PARKWAY COVER OR STEEL TRAFFIC COVER WITH MANUFACTURED TOUCH READ HOLE
⑰	1 ea	PRECAST CONCRETE BASE w/8" SUMP
⑱	5 ea	4" RING FLANGE GASKETS
⑲	56 ea	5/8"x 3" BOLTS w/NUTS
⑳	2 ea	VALVE RISER CAPS
㉑	8 ft±	6" DOUBLE DIPPED PIPE (valve riser can) A-492
㉒	2 ea	3" METER GASKETS

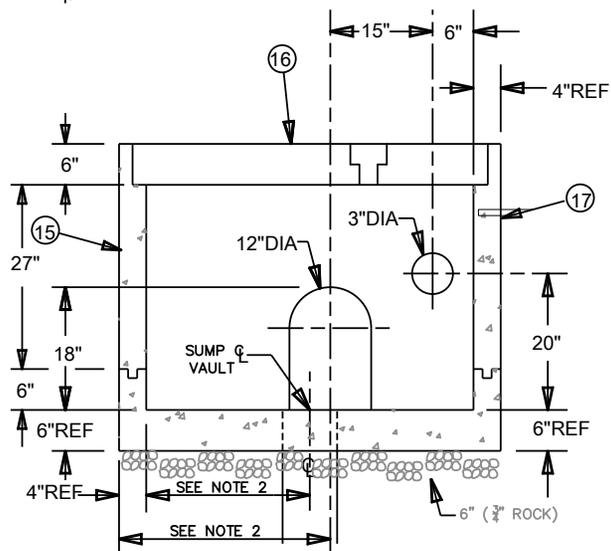

VIEW A-A

### NOTES:

- \* 1. METER SUPPORT AS REQUIRED.
- \*\* 2. METER DIMENSIONS MAY VARY. CONTRACTOR SHALL VERIFY METER DIMS AND SUPPLY UTILITY BOX WITH ADEQUATE CLEARANCE.
- \*\*\* 3. INSTALL A 3" COMPOUND METER W/3" METER FLANGE WHICH IS STD. 3" FLANGE W/4" +ID (3" OUT x 4" IN COMPANION FLANGE).
- 4. METER REGISTERS TO BE IN CUBIC FEET.
- \*\*\*\* 5. BASE IS INCLUDED W/VAULT.
- 6. READ HOLES ARE TO BE POSITIONED OVER METER REGISTERS AFTER METER IS INSTALLED.
- 7. VAULT LIDS TO BE ALUMINUM.
- 8. ALL MATERIALS PER WMWD APPROVED MATERIAL LIST.



APPROVED DATE: January 1, 2011

*Joseph P. ...*

DIRECTOR OF ENGINEERING

STANDARD DRAWING  
3" & 4" COMPOUND METER  
INSTALLATION

STD. DWG.  
NO.

W-0860