


NOTES:

1. SEWER NOTES PER WESTERN MUNICIPAL WATER DISTRICT (WMWD) STANDARDS.
 2. DRAWING SIZE TO BE SIZE 24"x36" AT FIRST PLAN CHECK.
 3. ALL MANHOLES SHALL BE NUMBERED AS SHOWN (FROM MOST DOWNSTREAM SIDE UP).
 4. MINIMUM CLEARANCE SHALL BE CONSISTENT WITH STATE WATER RESOURCES CONTROL BOARD - DIVISION OF DRINKING WATER.
 5. MINIMUM OUTSIDE DIAMETER TO OUTSIDE DIAMETER REQUIREMENTS: SEWER MUST BE 10-FOOT HORIZONTAL AND 1-FOOT VERTICALLY BELOW ANY POTABLE WATER.
 6. SURVEY STAKE TO FLOW LINE.
 7. LATERALS TO BE LOCATED 10'-0" MINIMUM FROM PL, DRIVEWAY CUTS, BCR, ECR, POWER POLES, STREET LIGHTS, SIGNAL POLES, TRANSFORMERS AND STREET TREES.
- * EXCEPTIONS MUST SEEK PRIOR APPROVAL FROM STATE OF CALIFORNIA.

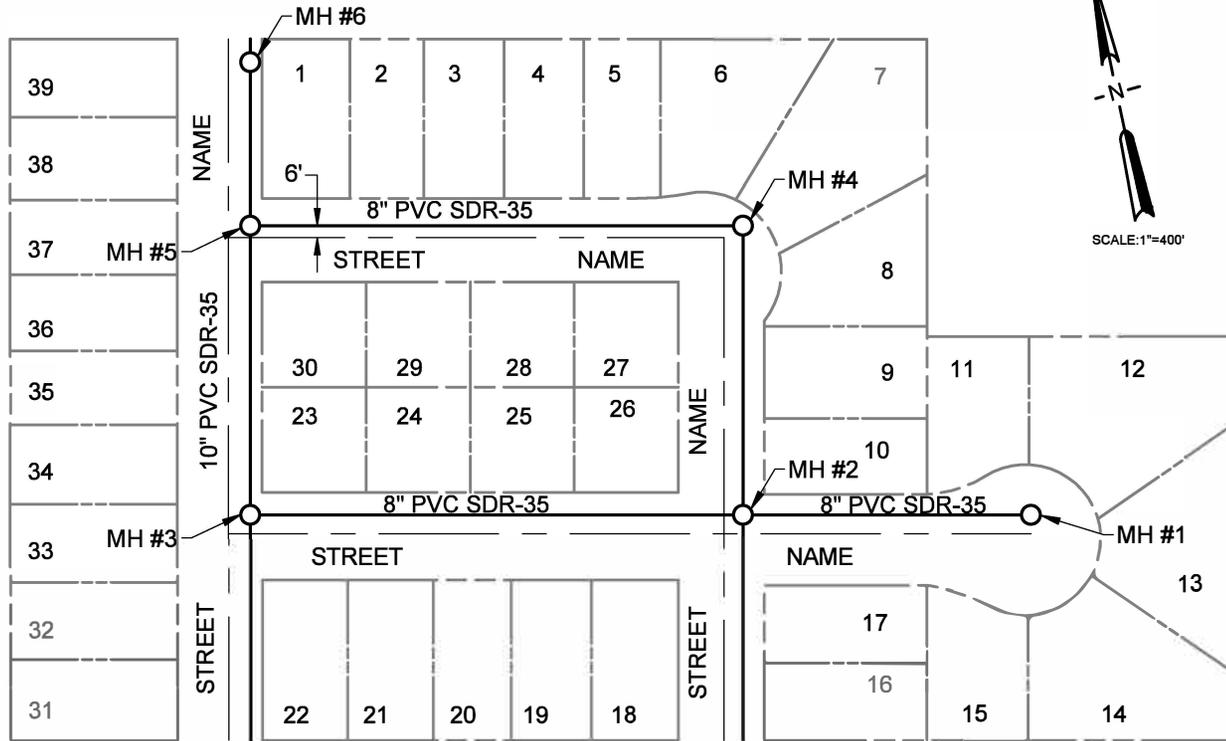


PLAN
SCALE: 1"=400'

QUANTITY ESTIMATE

- _____ FEET _____ INCH SDR-35 PVC
- _____ EACH _____ INCH VCP
- _____ EACH MANHOLES
- _____ EACH SERVICE LATERALS
- _____ EACH CLEANOUT

LEGEND

- MANHOLE
- PVC POLY VINYL CHLORIDE
- VCP VITRIFIED CLAY PIPE



LOCATION MAP