


NOTES:

1. USE CONCRETE ENCASEMENT NO. 2 UNLESS OTHERWISE APPROVED BY THE ENGINEER OR SHOWN ON THE CONTRACT DRAWINGS.
2. CONCRETE ENCASEMENT SHALL BE INSTALLED AS REQUIRED BY THE SPECIFICATIONS OR DIRECTED BY THE ENGINEER.
3. ALL CONCRETE SHALL BE CLASS "A" CONCRETE UNLESS MODIFIED BY THE DISTRICT.
4. STEEL REINFORCEMENT SHALL BE INSTALLED WHEN REQUIRED BY THE DISTRICT ENGINEER. RATION OF X-AREA OF STEEL TO AREA OF CONCRETE PER LINEAL FOOT OF PIPE $\geq 0.4\%$.
MAX. SPACING IS 8" C.C.
MIN. SPACING IS 6" C.C.

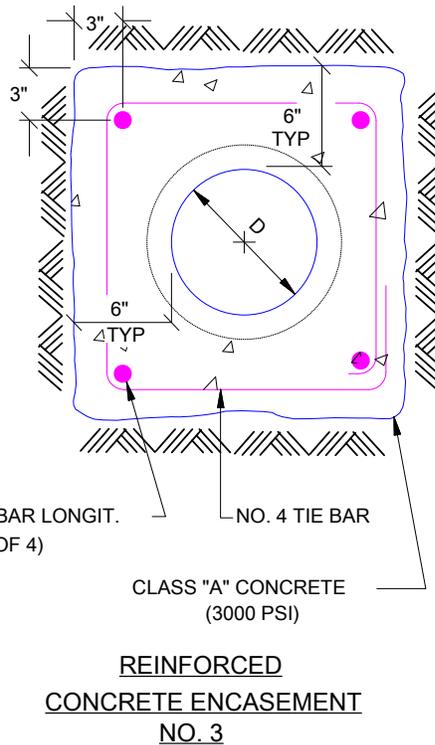

APPROVED DATE: January 1, 2011

Joseph Brandy

DIRECTOR OF ENGINEERING

STANDARD DRAWING
CONCRETE ENCASEMENT

STD. DWG.
NO.

W-1040

