



* WHERE UTILITY TRENCH IS PROPOSED BACK OF CURB, SEWER LATERAL SHALL HAVE 5'-0" COVER BELOW FINISHED GRADE AT GROUND SURFACE PROPERTY LINE.

** WHEN CLEARANCE IS LESS THAN SHOWN CONCRETE ENCASEMENT OF SEWER IS REQUIRED.

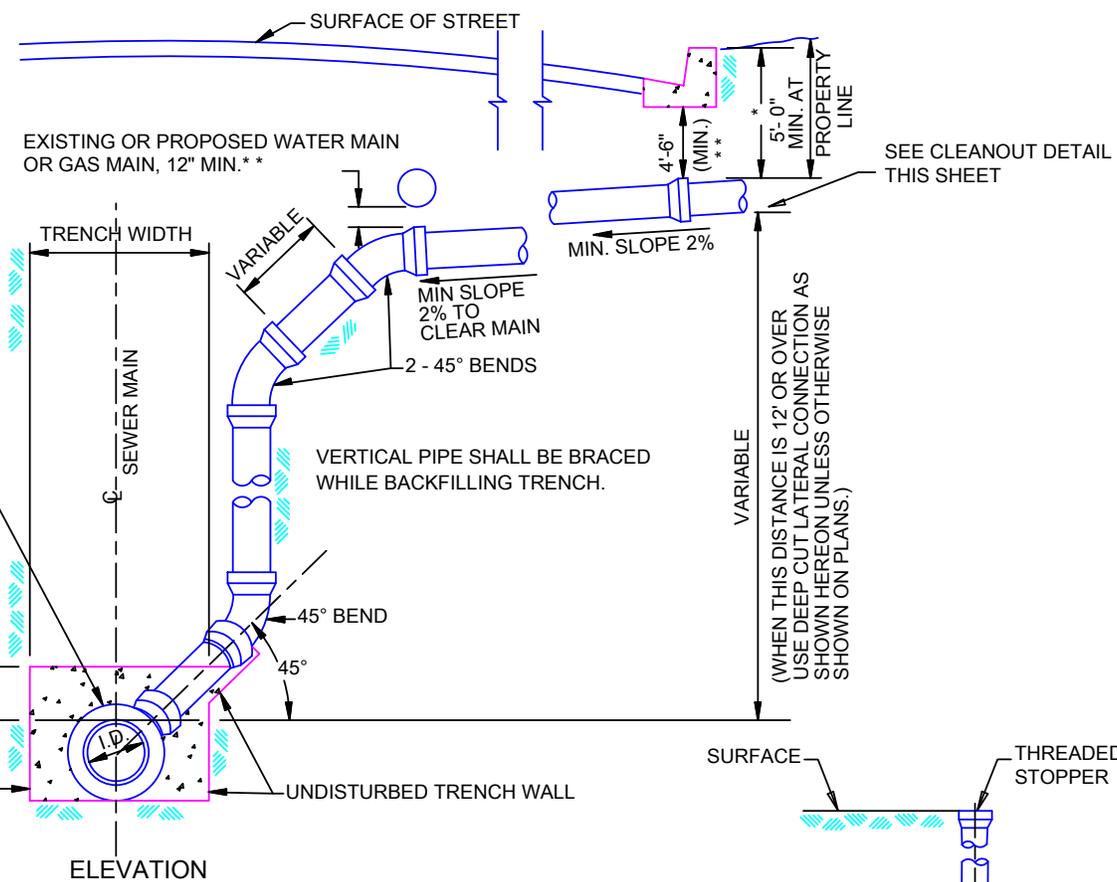

NOTES:

1. SEE DWG.W-1050 FOR DETAILS OF SEWER LATERAL TO PROPERTY LINE.
2. USE CLASS "A" CONCRETE WHERE SHOWN.
3. IN NO CASE SHALL A LATERAL CONNECT TO THE SEWER MAIN DIRECTLY ON TOP OF THE PIPE.
4. UNLESS WAIVED BY THE ENGINEER, 2" WIDE METALLIC DETECTABLE LOCATOR TAPE SHALL BE PLACE WITH EACH LATERAL APPROXIMATELY 6" ABOVE THE PIPE.
5. MINIMUM 5' SEPARATION BETWEEN SEWER LATERAL AND WATER SERVICE.
6. USE VCP OR PVC-SDR 23.5 (MIN.).
7. INSTALL CLEANOUT AT PROPERTY LINE.

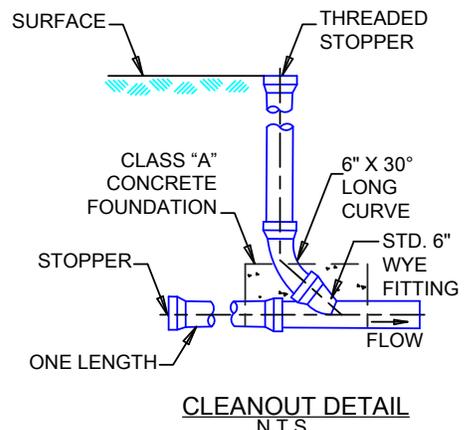

APPROVED DATE: January 1, 2011

Joseph H. ...

DIRECTOR OF ENGINEERING

STANDARD DRAWING
SEWER LATERAL
"DEEP CUT"

STD. DWG. NO.
W-1060