


**MATERIAL LIST:**

- ① BROOKS 1-RT VALVE BOX MARKED "SEWER", OR APPROVED EQUAL.
- ② THREADED CAP WITH SQUARE NUT.
- ③ 4" SEWER PIPE PER UNIFORM PLUMBING CODE.
- ④ WYE PER UNIFORM PLUMBING CODE.
- ⑤ MINIMUM 4" LATERAL, OR AS SHOWN ON PLANS. PER WMWD STANDARDS (SEE STD DWG W-1050 & W-1060)

**NOTES:**

- 1. PLACE CLEANOUT A MAXIMUM OF 3' BEHIND PROPERTY LINE OR EDGE OF EASEMENT.
- 2. LID MUST BE CAST IRON FOR LOCATING PURPOSES, MARKED "SEWER"

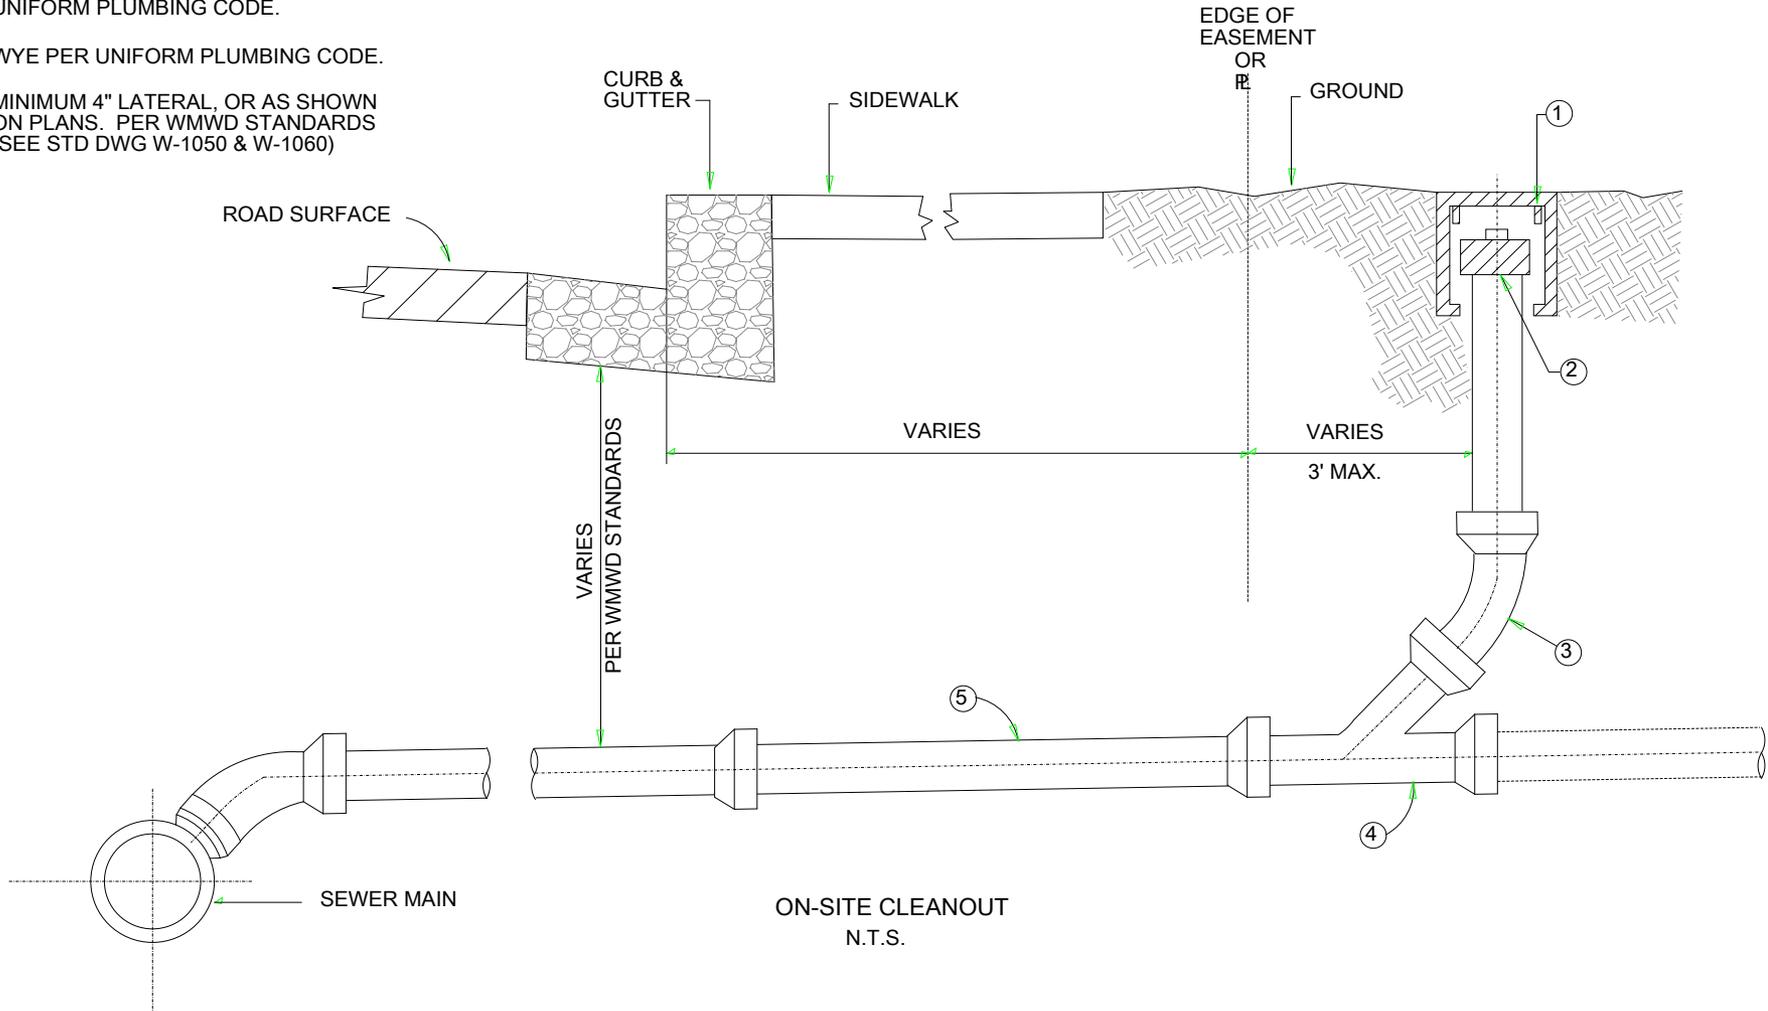

APPROVED DATE: January 1, 2011

*Joseph Penold*

DIRECTOR OF ENGINEERING

STANDARD DRAWING  
SEWER ON-SITE CLEANOUT

STD. DWG.  
NO.

W-1160