


**NOTES:**

1. ALL PIPE & FITTINGS BETWEEN AND INCLUDING THE STOPS SHALL:
  - A) BE MADE OF BRASS OR BRONZE
  - B) BE DESIGNED FOR MORE THAN 175 PSI (COLD) WATER WORKING PRESSURE.
2. ALL BARE STEEL OR IRON SHALL BE COATED AND PROTECTED AS PER SPECS. PRIOR TO PLACING BACKFILL.
3. PRESSURE TEST PRIOR TO WRAPPING OR BACKFILLING.
4. CORP. STOP FITTINGS AND SERVICE LINE WITHIN 3' OF SADDLE SHALL BE COATED WITH #1170 PRIMER AND 20 MIL. MIN. WRAP.
5. METER BOXES SHALL BE POLYMER WITH POLYMER CONCRETE ONE PIECE TOUCH READ LID.
6. ALL SERVICE PIPE AND TUBING SHALL BE LAID ON A CONSTANT SLOPE UP FROM THE WATER MAIN TO METER. NO DIPS OR POCKETS IN LINE WILL BE PERMITTED.
7. THREAD NOTATION SHOWS THIS: I.P. - IRON PIPE THREAD.
8. METER BOX IS TO BE LOCATED PER AGENCY OF LOCAL JURISDICTION COORDINATE LOCATION ALONG LOT FRONTAGE WITH W.M.W.D. INSPECTOR.
9. WHEN METER IS INSTALLED IT IS TO BE PAINTED APPROVED PURPLE.

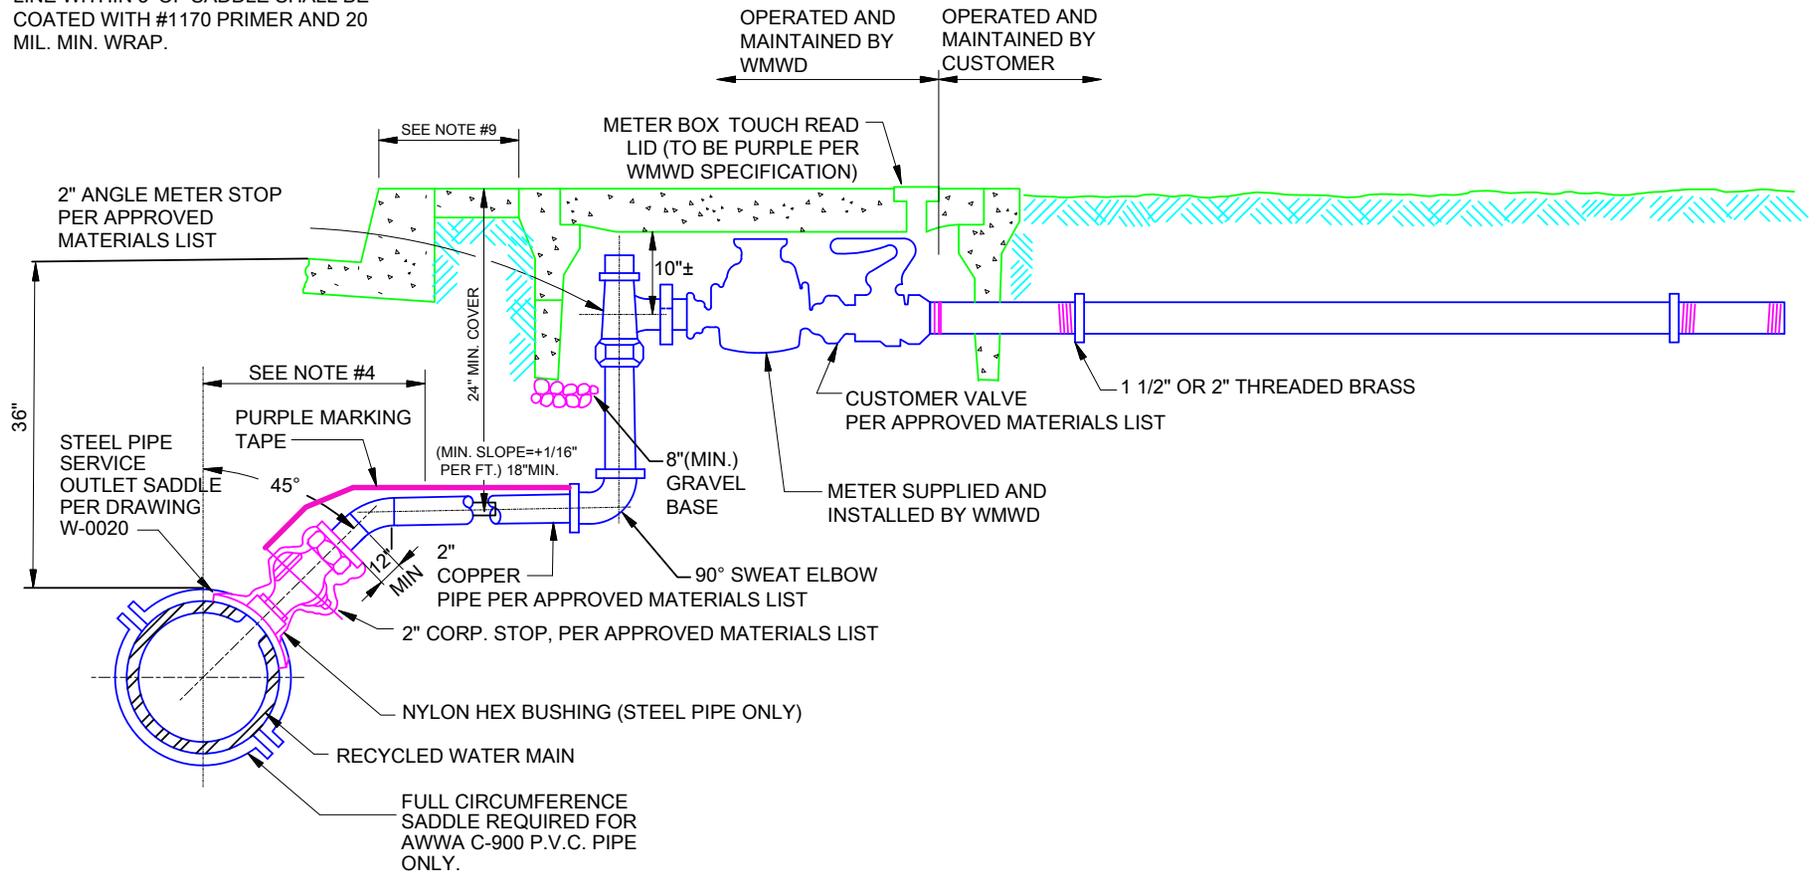

APPROVED DATE: January 1, 2011

*Jay Broudy*

\_\_\_\_\_  
DIRECTOR OF ENGINEERING

RECYCLED WATER STANDARD DRAWING  
RECYCLED WATER SERVICE  
1 1/2" AND 2"

STD. DWG. NO.  
W-1210