


**NOTES:**

1. PAINT EXPOSED SECTIONS "SAFETY YELLOW" (DOMESTIC WATERLINE) OR RECYCLED PURPLE (RW PIPELINE)
2. ALL MATERIALS FURNISHED TO BE OF THE PIPE PRESSURE CLASS CALLED FOR ON PLANS.
3. UNLESS NOTED, ALL THREADS TO BE STANDARD IRON PIPE SIZE THREADS.
4. GUARD POSTS, AS REQUIRED ON PLANS OR SPECIFICATIONS, SEE DRAWING #W-1520.
5. CORPORATION STOP AND FITTINGS AT WATER PIPELINE SHALL BE PRIMED AND WRAPPED WITH 20 MIL. MIN.
6. VALVE BOX SHALL BE 8 3/4" DIA. BROOKS PRODUCTS NO. 1-RT OR EQUIVALENT.

\* PER LOCAL AGENCY

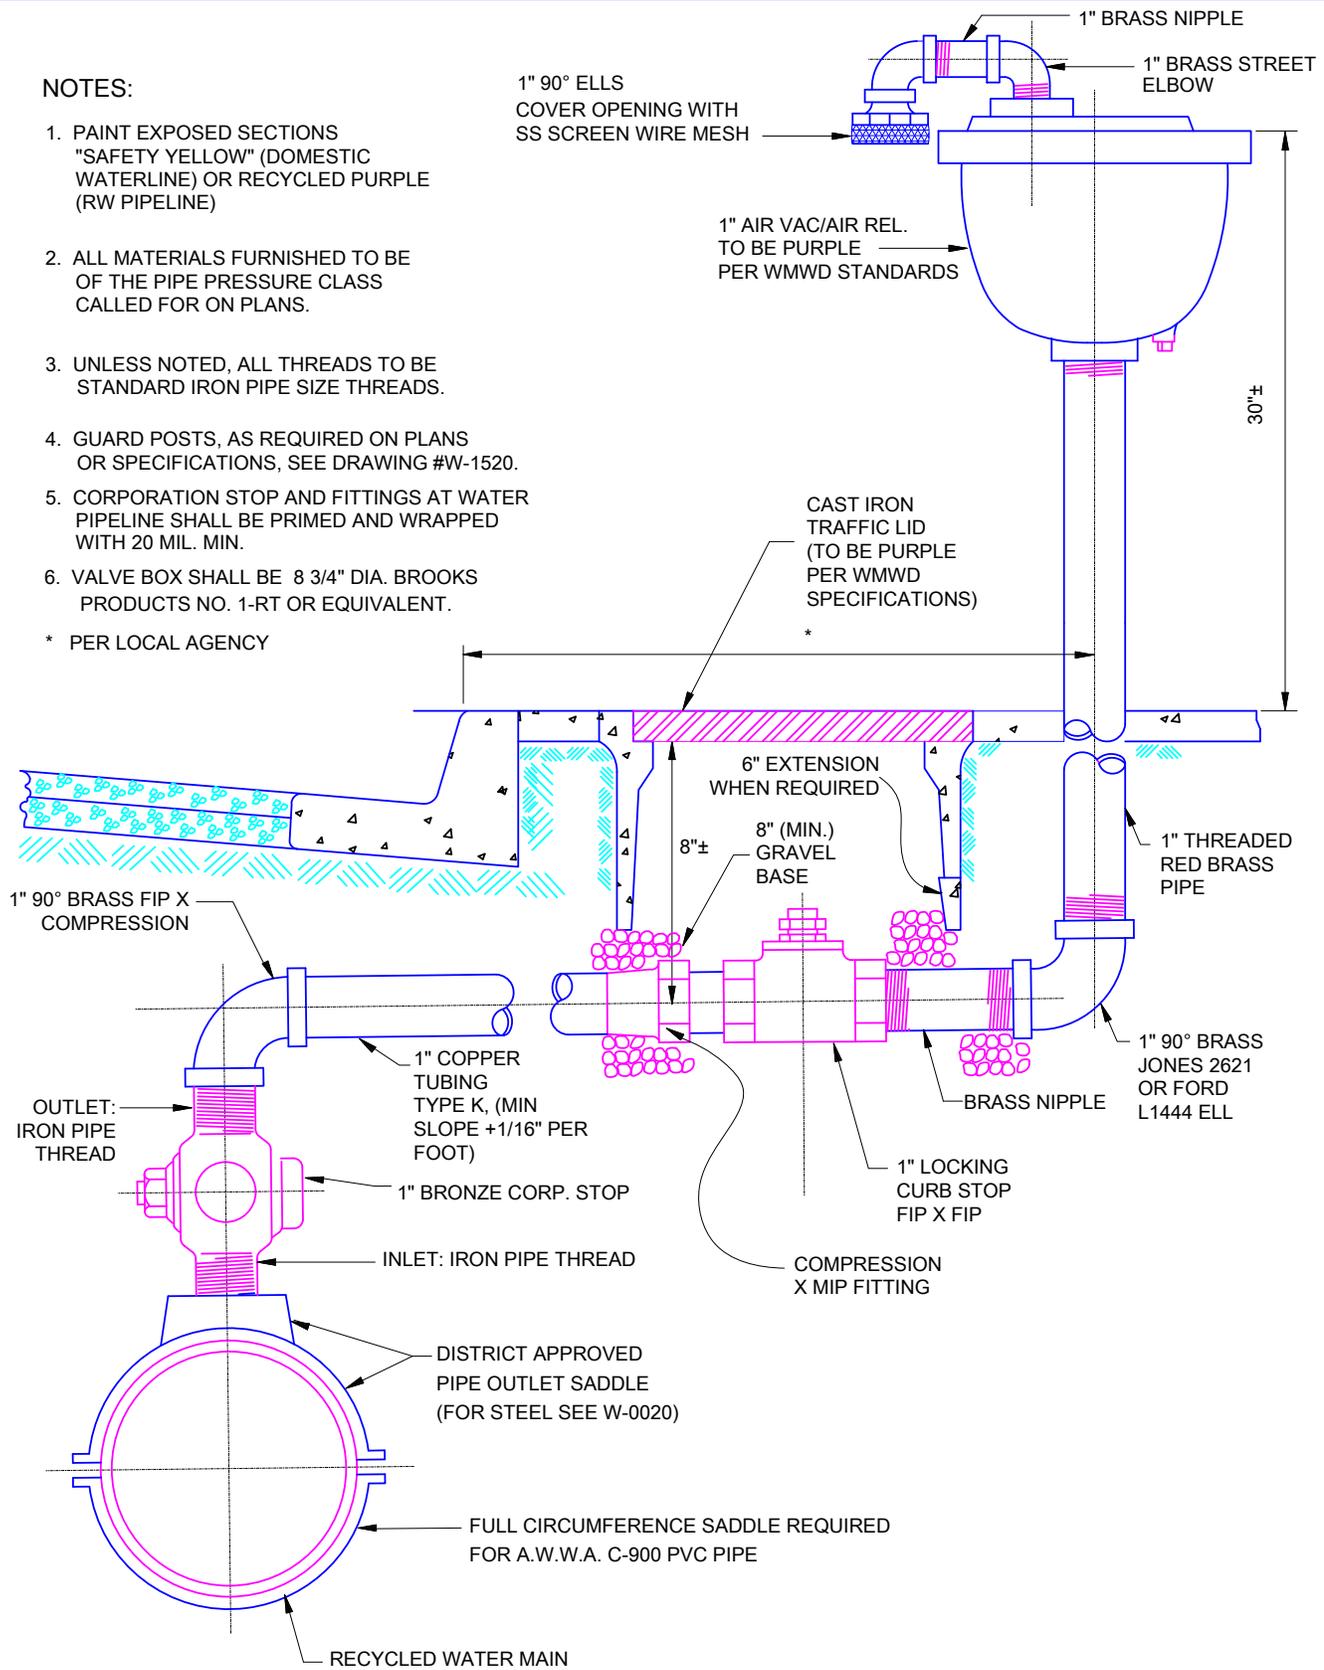

APPROVED DATE: January 1, 2011

*Joseph Brandy*

\_\_\_\_\_  
DIRECTOR OF ENGINEERING

RECYCLED WATER STANDARD DRAWING  
1" AIR VACUUM & AIR RELEASE  
VALVE ASSEMBLY

STD. DWG. NO.  
W-1225