


NOTES:

1. PAINT EXPOSED SECTIONS "SAFETY YELLOW" (DOMESTIC WATERLINE) PURPLE FOR RECYCLED
2. ALL MATERIALS FURNISHED TO BE OF THE PIPE PRESSURE CLASS CALLED FOR ON PLANS.
3. UNLESS NOTED, ALL THREADS TO BE STANDARD IRON PIPE SIZE THREADS.
4. GUARD POSTS, AS REQUIRED ON PLANS OR SPECIFICATIONS, SEE DRAWING #W-1520.
5. CORPORATION STOP AND FITTINGS AT RECYCLED WATER PIPELINE SHALL BE PRIMED AND WRAPPED WITH 20 MIL. MIN.
6. VALVE BOX SHALL BE 8 3/4" DIA. BROOKS PRODUCTS NO. 1-RT OR EQUIVALENT.
7. AIR VACUUM & AIR RELEASE ASSEMBLIES LARGER THAN 2" REQUIRE WESTERN'S APPROVAL.

* PER LOCAL AGENCY

2" 90° ELLS
COVER OPENING WITH
SS SCREEN WIRE MESH

2" AIR VAC/AIR REL.
(TO BE PURPLE PER
WMWD SPECIFICATIONS)

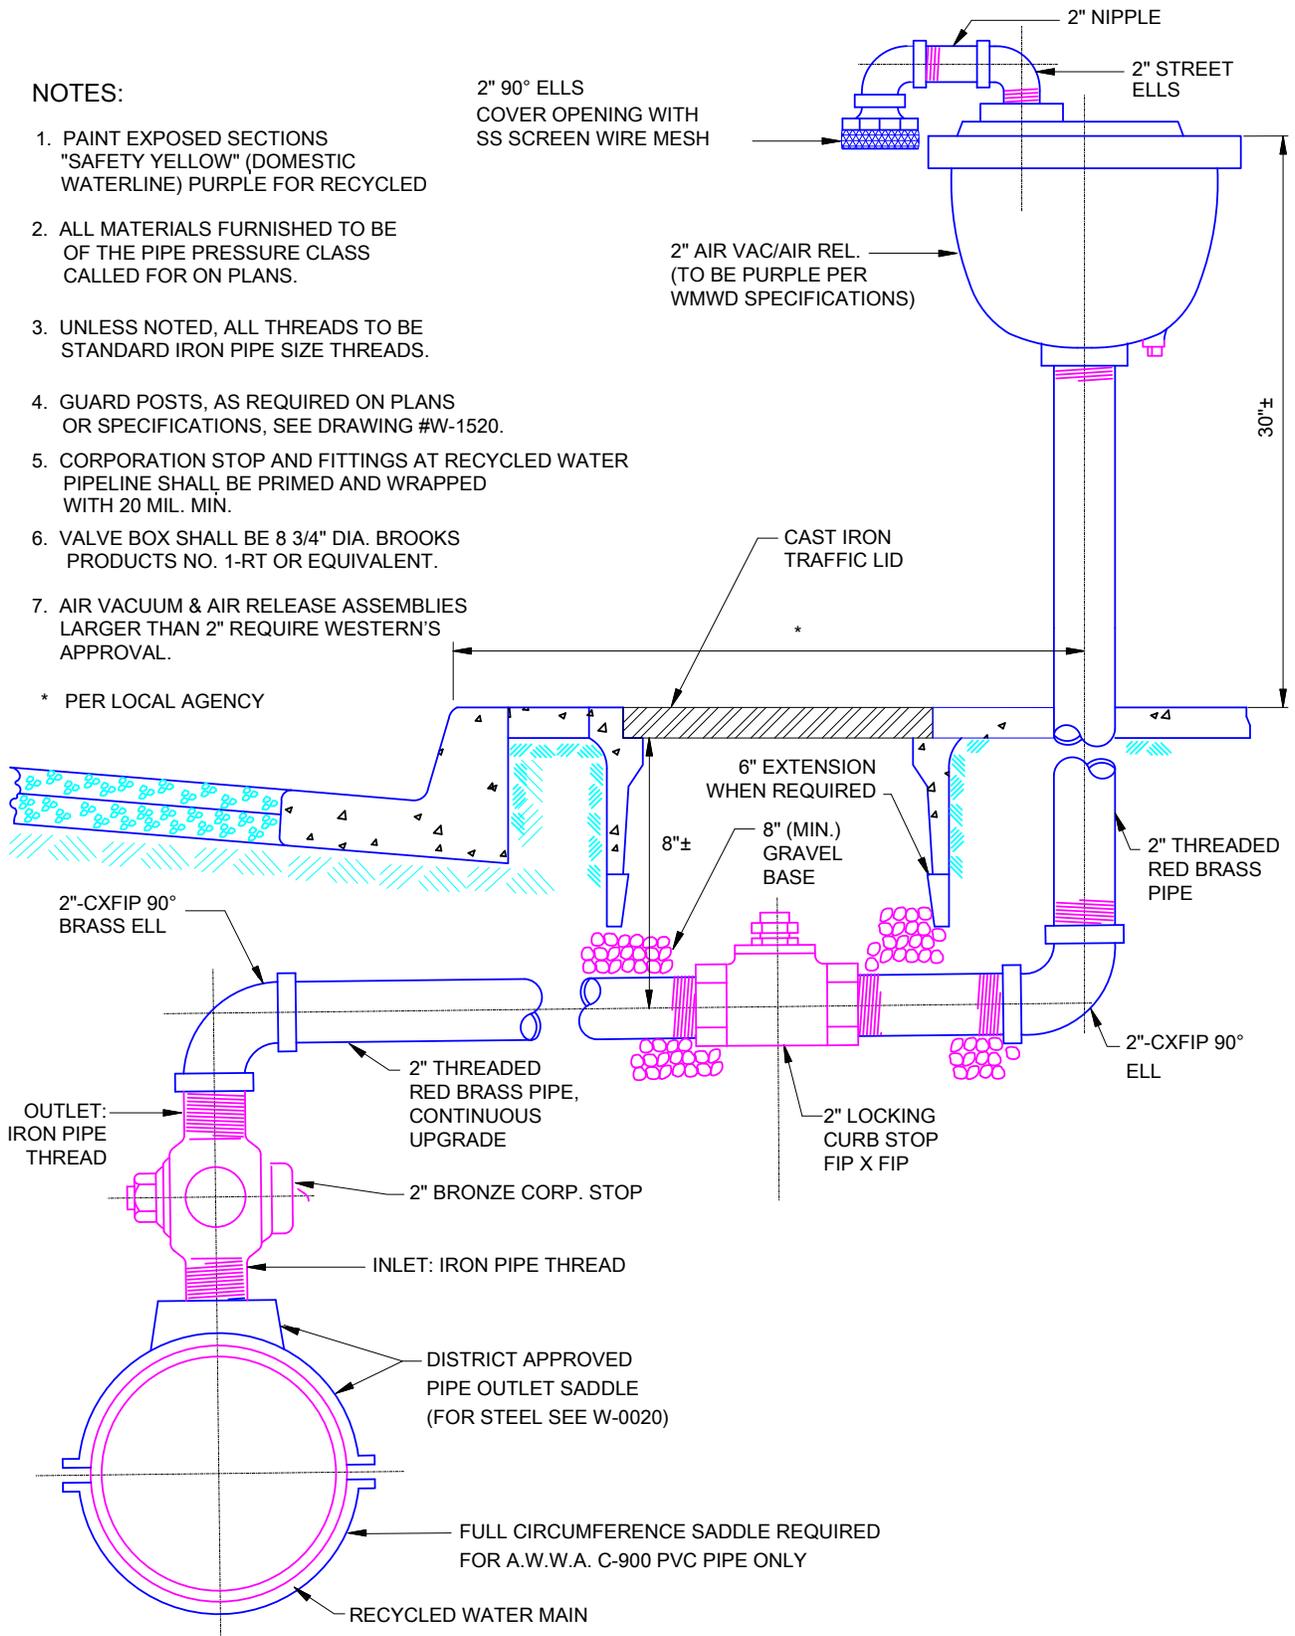

APPROVED DATE: January 1, 2011

Joseph Brandy
DIRECTOR OF ENGINEERING

RECYCLED WATER STANDARD DRAWING
2" AIR VACUUM & AIR RELEASE
VALVE ASSEMBLY

STD. DWG.
NO.

W-1235