


*PER LOCAL AGENCY OF JURISDICTION

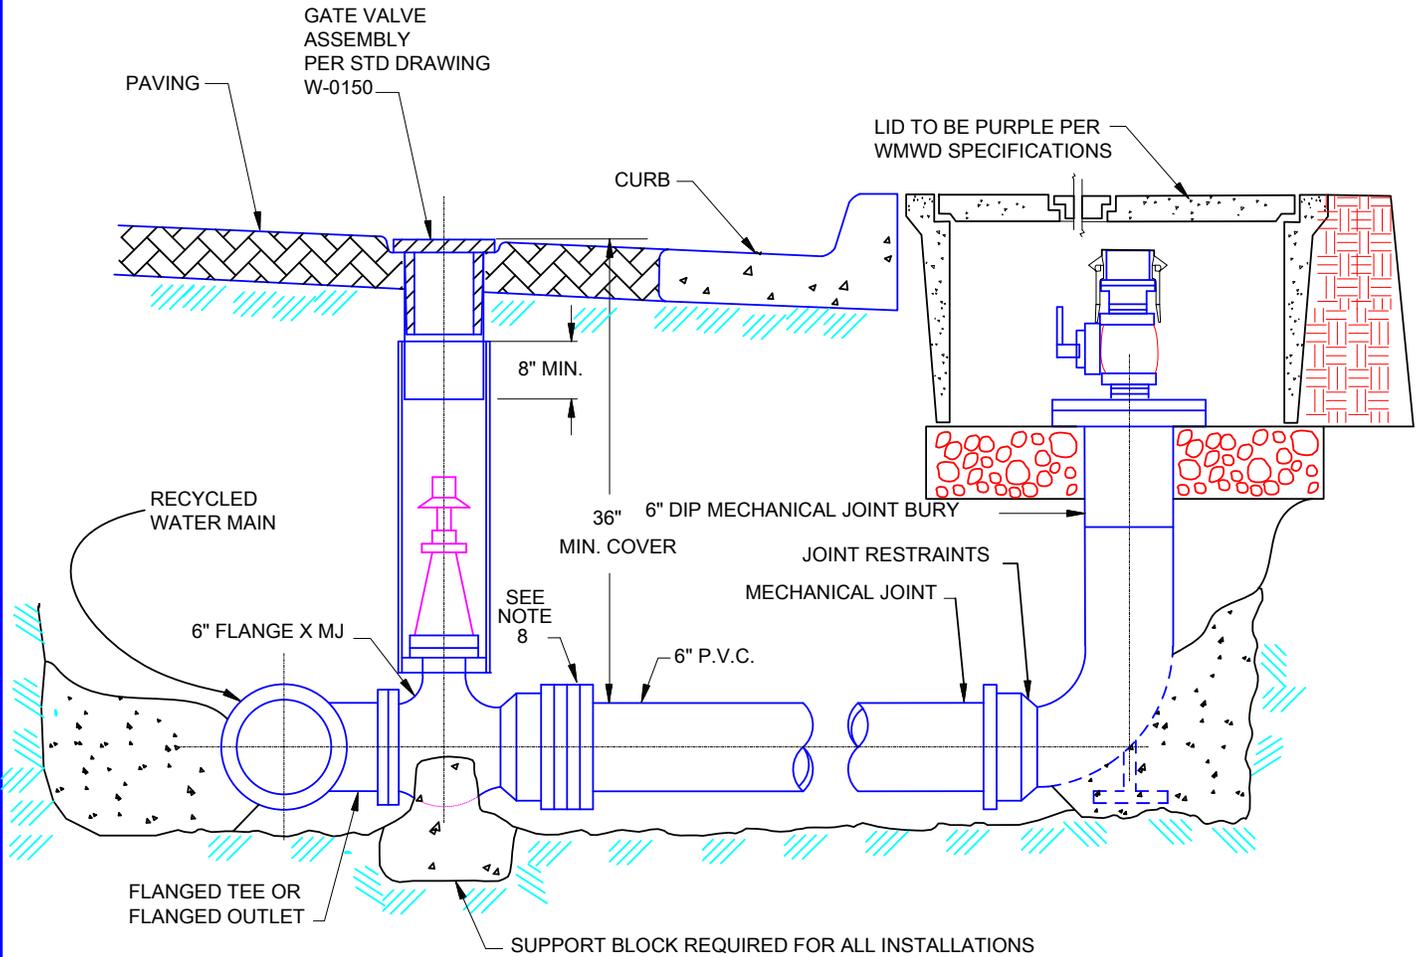

NOTES:

1. ALL MATLS SHALL BE CLASS 150 (MIN).
2. COAT ALL NUTS AND BOLTS PER COATING STD & 20 MIL MIN. WRAP.
3. REPAIR PIPE COATING WITH APPROVED MATERIAL OF SIMILAR NATURE.
4. IN UNPAVED AREAS, GATE VALVE RISER & CAP SHALL BE INSTALLED TO GRADE.
5. HOSE THREADS TO BE NATIONAL STANDARD.
6. SET HYDRANT WITH OUTLETS AT 45° TO CURB.
7. ALL SUPPORT BLOCKS TO BE POURED AGAINST UNDISTURBED EARTH. USE CONCRETE PER WESTERNSTANDARD.
8. FOR MAINLINE PIPELINES GREATER THAN 12" DIAMETER, INSTALL FLEXIBLE COUPLING.
9. VALVE BOX AND METER BOX LIDS TO BE PAINTED PURPLE PANTONE 522C. PER WMWD SPECIFICATIONS.
10. BALL VALVE AND CAM LOCK TO BE PAINTED PURPLE PANTONE 522C.
11. BLOW OFF LOCATIONS:
 - A. BLOW OFF SHALL BE PLACED
 1. 1'-6" BEHIND CURB FACE WHEN THE WIDTH OF SIDEWALK IS 8' OR WIDER
 2. 7'-6" BEHIND CURB FACE WHEN THE WIDTH OF SIDEWALK IS 8' OR WIDER.
 3. 7'-6" BEHIND CURB FACE WHEN THERE IS NO SIDEWALK.
 4. 1'-6" WITHIN ROAD RIGHT-OF-WAY WHEN NO CURBS OR SIDEWALKS ARE PROPOSED.
 - B. BLOW OFF TO BE 1' BACK FROM INTERSECTION OF SIDEWALK WITH CORNER APRON.
 - C. AT OTHER THAN STREET INTERSECTIONS BLOW TO BE ON LOT LINES.

	APPROVED DATE: <u>January 1, 2011</u>  DIRECTOR OF ENGINEERING	RECYCLED WATER STANDARD DRAWING 6" BLOWOFF ASSEMBLY (BELOW GROUND)	STD. DWG. NO. W-1265